




OIL ANALYSIS REPORT

Sample Rating Trend

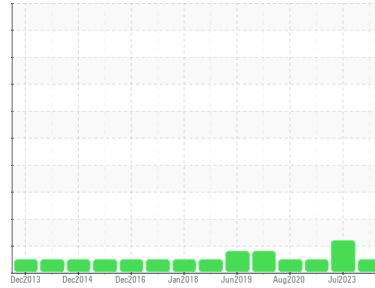

NORMAL



Area
L2
 Machine Id
UNION Grey Water Gearbox-58033C
 Component
Gearbox
 Fluid
DIESEL ENGINE OIL SAE 10W (8 QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0771985	WC0771998	WC0552816
Sample Date	Client Info			02 Jan 2024	02 Jul 2023	03 Sep 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	ATTENTION	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	3	3	3
Chromium	ppm	ASTM D5185m	>15	<1	0	0
Nickel	ppm	ASTM D5185m	>15	0	<1	0
Titanium	ppm	ASTM D5185m		108	100	83
Silver	ppm	ASTM D5185m		0	<1	0
Aluminum	ppm	ASTM D5185m	>25	2	<1	<1
Lead	ppm	ASTM D5185m	>100	0	0	0
Copper	ppm	ASTM D5185m	>200	<1	<1	2
Tin	ppm	ASTM D5185m	>25	<1	<1	0
Antimony	ppm	ASTM D5185m	>5	---	---	---
Vanadium	ppm	ASTM D5185m		1	<1	<1
Cadmium	ppm	ASTM D5185m		0	0	0





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	168	200	179
Barium	ppm	ASTM D5185m	10	0	0	0
Molybdenum	ppm	ASTM D5185m	100	<1	<1	<1
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	450	764	674	655
Calcium	ppm	ASTM D5185m	3000	1471	1371	1303
Phosphorus	ppm	ASTM D5185m	1150	923	1066	973
Zinc	ppm	ASTM D5185m	1350	1231	1156	1050
Sulfur	ppm	ASTM D5185m	4250	3655	3823	3531

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	7	8	5
Sodium	ppm	ASTM D5185m		0	0	4
Potassium	ppm	ASTM D5185m	>20	5	4	<1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	8405	▲ 26681	19922
Particles >6µm		ASTM D7647	>5000	1300	▲ 5727	2520
Particles >14µm		ASTM D7647	>640	32	352	98
Particles >21µm		ASTM D7647	>160	3	83	25
Particles >38µm		ASTM D7647	>40	0	4	1
Particles >71µm		ASTM D7647	>10	0	1	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	20/17/12	▲ 22/20/16	21/19/14



OIL ANALYSIS REPORT

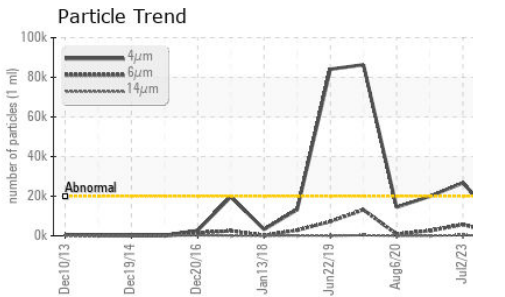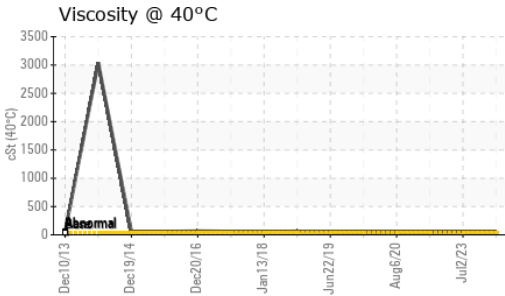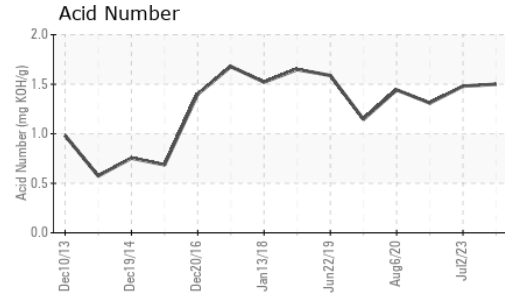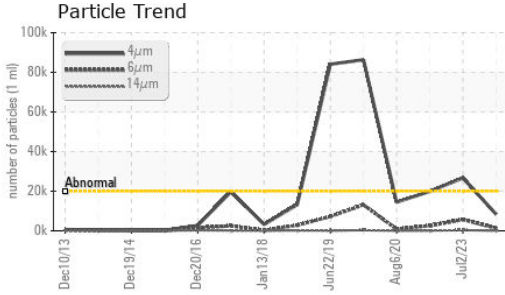


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		1.50	1.48	1.31






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	40	50.9	55.52	44.4

SAMPLE IMAGES

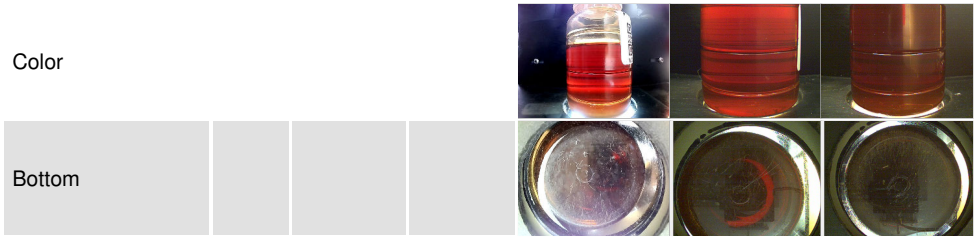

GRAPHS

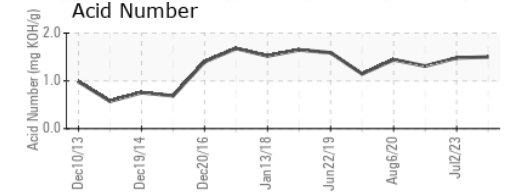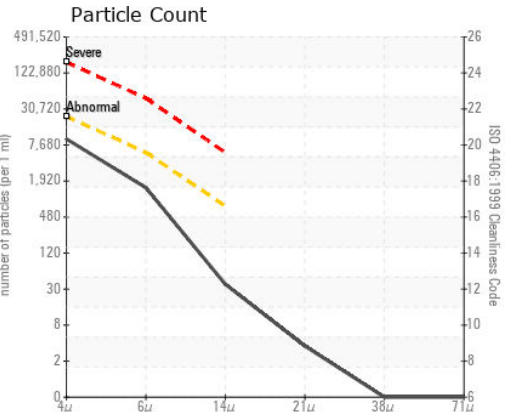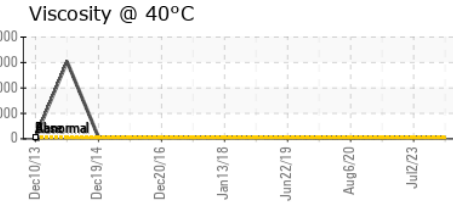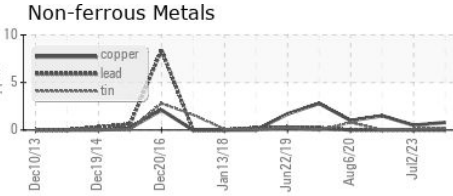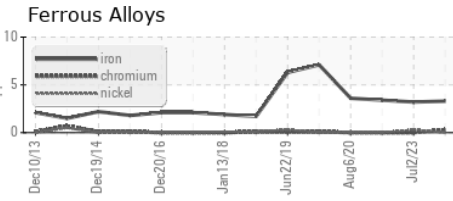

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0771985 Received : 16 Jan 2024
 Lab Number : 06061912 Diagnosed : 18 Jan 2024
 Unique Number : 10833294 Diagnostician : Don Baldrige
 Test Package : IND 2 (Additional Tests: PrtCount)

Conoco Phillips ALASKA INC
 C/O LAF (ALPINE), 6441 S AIRPARK PL
 ANCHORAGE, AK
 US 99502
 Contact: Chris Van Ryzin Ben DeRaeve
 alp1084@conocophillips.com
 T: (907)670-4128
 F: (907)670-4137

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)