




# OIL ANALYSIS REPORT

Sample Rating Trend

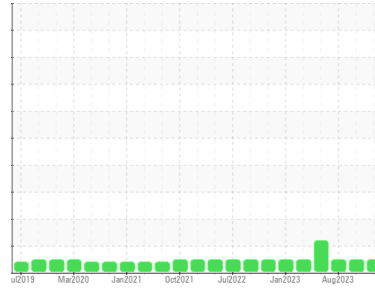

**NORMAL**



Area  
**Fermentation**  
 Machine Id  
**Lightnin FFG39MB01 Main Fermentor, Agitator**  
 Component  
**Gearbox**  
 Fluid  
**JAX FGG-AW ISO 220 (28 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0857616</b>	WC0819245	WC0808212
Sample Date	Client Info		<b>11 Jan 2024</b>	17 Oct 2023	08 Aug 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	<b>1</b>	1	6
Chromium	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >15	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>2</b>	0	1
Lead	ppm	ASTM D5185m >100	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >200	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Phosphorus	ppm	ASTM D5185m	<b>449</b>	488	491
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>604</b>	618	727

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	0
Water	%	ASTM D6304 >0.2	<b>0.003</b>	0.005	0.001
ppm Water	ppm	ASTM D6304 >2000	<b>31</b>	51.8	6.6

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>8346</b>	11626	18484
Particles >6µm	ASTM D7647	>5000	<b>688</b>	1042	1604
Particles >14µm	ASTM D7647	>640	<b>25</b>	43	57
Particles >21µm	ASTM D7647	>160	<b>6</b>	7	14
Particles >38µm	ASTM D7647	>40	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>20/17/12</b>	21/17/13	21/18/13

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.31</b>	0.31	0.31




# OIL ANALYSIS REPORT

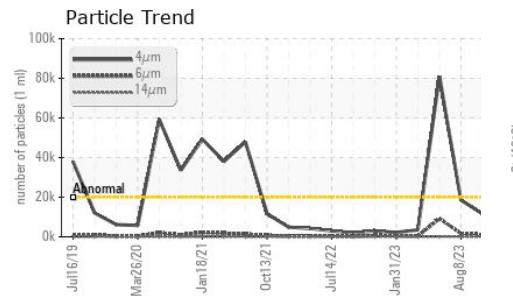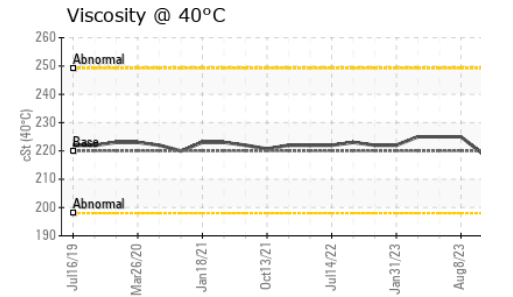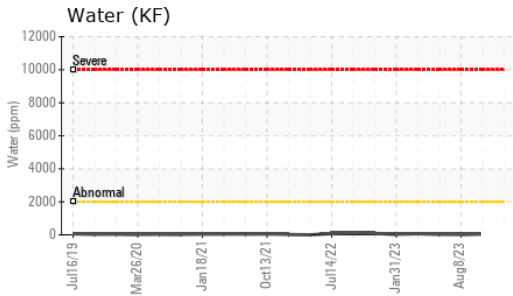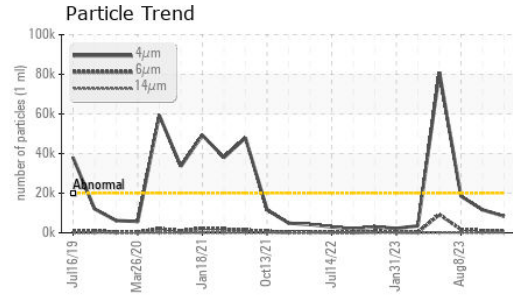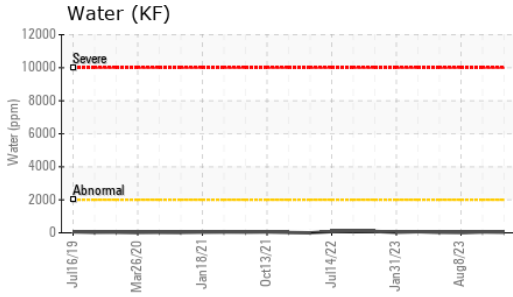






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 220	226	219	225

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

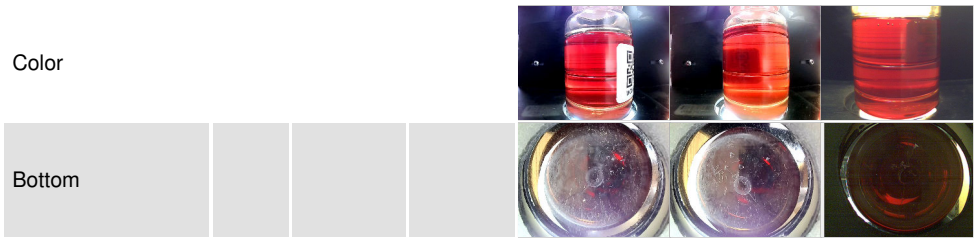

## GRAPHS

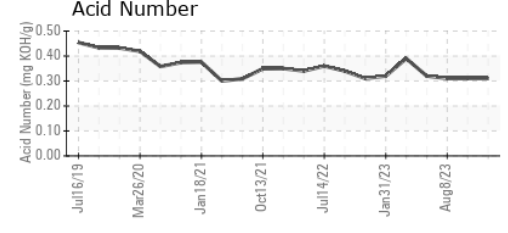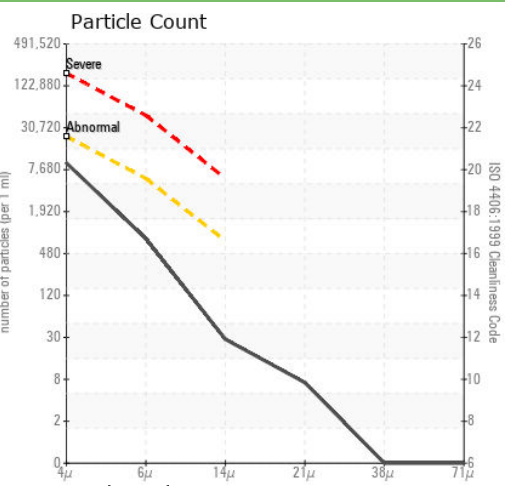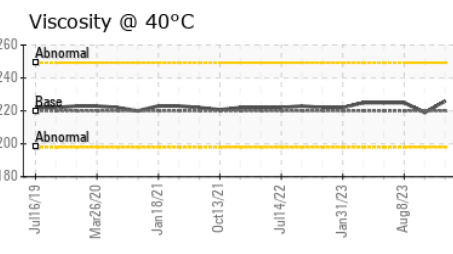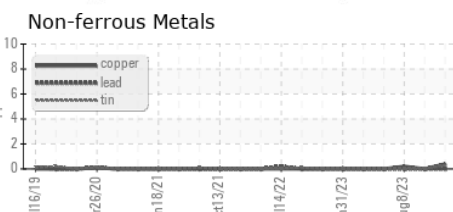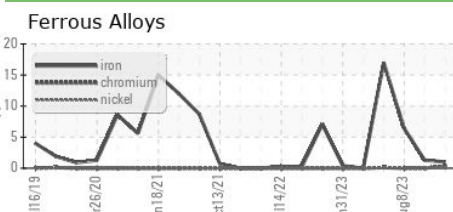

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0857616 **Received** : 16 Jan 2024  
**Lab Number** : 06061947 **Diagnosed** : 18 Jan 2024  
**Unique Number** : 10833329 **Diagnostician** : Don Baldrige

**NOVOZYMES**  
 P.O. BOX 576, 77 PERRY CHAPEL CHURCH ROAD  
 FRANKLINTON, NC  
 US 27525  
 Contact: BRUCE THOMAS  
 brct@novozymes.com  
 T: (919)494-3146  
 F: (919)494-3456

**Certificate L2367**  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)