

OIL ANALYSIS REPORT

Sample Rating Trend

May(221) Jan(224

NORMAL



3416716 (S/N 1774)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

CAMPLE INCOR	AATION	or a the earl	May2021	Jan 2024	la balanca d	history O
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCA009272	KCP36672	
Sample Date		Client Info		08 Jan 2024	24 May 2021	
Machine Age	hrs	Client Info		72465	57658	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	Changed	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum	ppm	ASTM D5185m	>10	1	<1	
Lead	ppm	ASTM D5185m	>10	0	2	
Copper	ppm	ASTM D5185m	>50	5	4	
Tin	ppm	ASTM D5185m	>10	0	0	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	25	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	<1	0	
Calcium	ppm	ASTM D5185m	0	<1	0	
Phosphorus	ppm	ASTM D5185m	0	10	<1	
Zinc	ppm	ASTM D5185m	0	0	0	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	3	
Sodium	ppm	ASTM D5185m		0	<1	
Potassium	ppm	ASTM D5185m	>20	0	5	
Water	%	ASTM D6304	>0.05	0.008	0.009	
ppm Water	ppm	ASTM D6304	>500	86	99.3	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		613	3788	
Particles >6µm		ASTM D7647	>1300	207	911	
Particles >14µm		ASTM D7647	>80	19	52	
Particles >21µm		ASTM D7647	>20	7	11	
Particles >38µm		ASTM D7647	>4	1	0	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/15/11	17/13	
FLUID DEGRADA	TION _	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.48	0.453	



OIL ANALYSIS REPORT

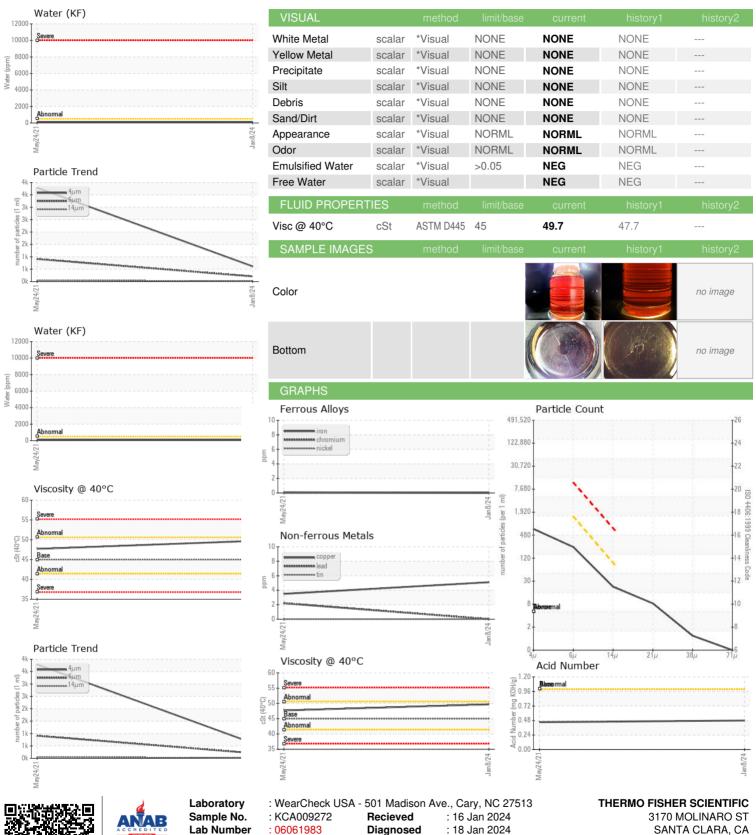





Certificate L2367

Lab Number **Unique Number** Test Package

: 06061983 : 10833365

Diagnosed Diagnostician : IND 2

: 18 Jan 2024 : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: LAWRENCE GURULE - THESANCAL

US 95054

T:

F:

Contact: LAWRENCE GURULE

lawrence.gurule@thermofisher.com