

OIL ANALYSIS REPORT

8840903 (S/N 1773)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Sample Rating Trend



Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC100640		
Sample Date		Client Info		02 Jan 2024		
Machine Age	hrs	Client Info		1269		
Oil Age	hrs	Client Info		1269		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	10		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	66		
Calcium	ppm	ASTM D5185m	2	1		
Phosphorus	ppm	ASTM D5185m		12		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m	<i>></i> 20	6		
Potassium	ppm	ASTM D5185m	>20	4		
Water	%	ASTM D6304		0.011		
ppm Water	ppm	ASTM D6304		118		
FLUID CLEANLIN		method	limit/base	current	history1	history2
Particles >4um		ASTM D7647		713		
Particles >6μm		ASTM D7647	>1300	246		
Particles >14µm		ASTM D7647	>80	18		
Particles >21µm		ASTM D7647	>20	4		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/11		
FLUID DEGRADA	TION	method	limit/base		history	hictory?
T LOID DEGNADA	HION	method	mini/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.33



OIL ANALYSIS REPORT

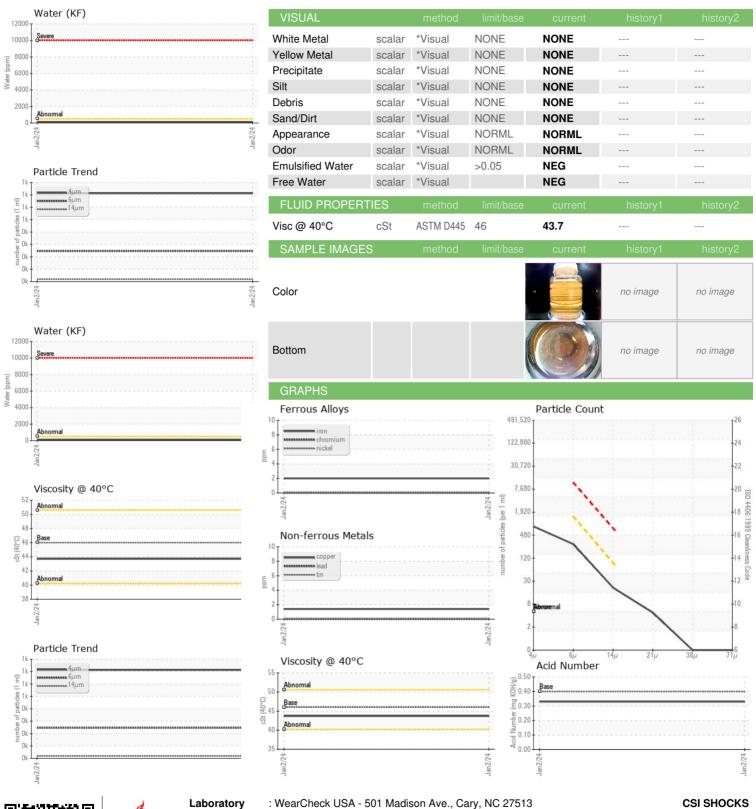





Certificate L2367

Laboratory Sample No. Lab Number Unique Number Test Package

: KC100640 : 06061989 : 10833371 : IND 2

Recieved

: 16 Jan 2024 Diagnosed : 18 Jan 2024 : Don Baldridge Diagnostician

451 JOHNSON LN, SUITE A BROWNSBURG, IN US 46112

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: