

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machine Id 6748385 (S/N 1045) Component

Compressor Fluid KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA006581	KCP53128	
Sample Date		Client Info		09 Jan 2024	25 Jan 2023	
Machine Age	hrs	Client Info		16244	13026	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	1	
Chromium		ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
	ppm					
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm		>10	3	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m		<1	<1	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	2	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m		0	<1	
Calcium	ppm	ASTM D5185m		0	<1	
Phosphorus	ppm	ASTM D5185m	500	151	100	
Zinc	ppm	ASTM D5185m		113	26	
Sulfur	ppm	ASTM D5185m		1467	1634	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		<1	0	
Potassium	ppm	ASTM D5185m	>20	<1	2	
Water	%	ASTM D6304	>0.05	0.006	0.047	
ppm Water	ppm	ASTM D6304	>500	61	470	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		10191	20645	
Particles >6µm		ASTM D7647	>1300	A 3546	6 133	
Particles >14µm		ASTM D7647	>80	A 386	▲ 562	
Particles >21µm		ASTM D7647	>20	<u> </u>	1 05	
Particles >38µm		ASTM D7647	>4	3	9	
Particles >71µm		ASTM D7647		0	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>	<u> </u>	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.55	0.25	
	ing NOTing	7.0 FW D0040	1.0	0.00	0.20	





Built for a lifetime







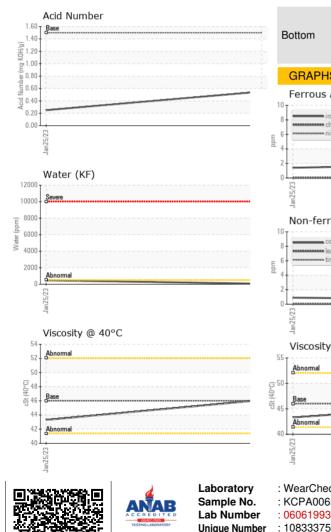

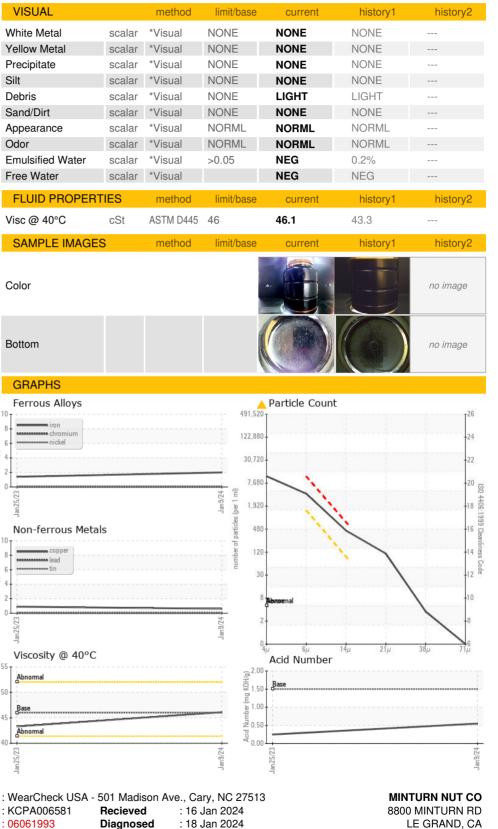

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnostician : Don Baldridge

Certificate L2367

US 95333

T:

F:

Contact: JOSEPH

joseph@minturnnut.com