




# OIL ANALYSIS REPORT

Sample Rating Trend

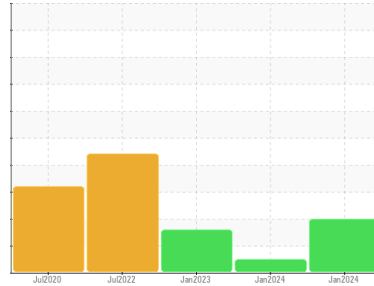

Machine Id  
**KAESER SM 10T 5091432 (S/N 1280)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA008914</b>	KCPA008884	KCP54911
Sample Date	Client Info			<b>10 Jan 2024</b>	10 Jan 2024	17 Jan 2023
Machine Age	hrs	Client Info		<b>23252</b>	20543	16903
Oil Age	hrs	Client Info		<b>0</b>	0	31
Oil Changed	Client Info			<b>N/A</b>	N/A	Not Changd
Sample Status				<b>ABNORMAL</b>	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	6
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>1</b>	2	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>10</b>	12	4
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	44
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>8</b>	61	67
Calcium	ppm	ASTM D5185m	2	<b>0</b>	<1	1
Phosphorus	ppm	ASTM D5185m		<b>12</b>	31	4
Zinc	ppm	ASTM D5185m		<b>17</b>	7	15
Sulfur	ppm	ASTM D5185m		<b>17240</b>	18503	17265

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>2</b>	3	4
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	2	1
Water	%	ASTM D6304	>0.05	<b>0.008</b>	0.031	0.016
ppm Water	ppm	ASTM D6304	>500	<b>83</b>	318	165.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>20546</b>	5783	138586
Particles >6µm		ASTM D7647	>1300	<b>▲ 8339</b>	1055	▲ 50092
Particles >14µm		ASTM D7647	>80	<b>▲ 876</b>	61	▲ 241
Particles >21µm		ASTM D7647	>20	<b>▲ 232</b>	17	▲ 33
Particles >38µm		ASTM D7647	>4	<b>▲ 12</b>	1	1
Particles >71µm		ASTM D7647	>3	<b>1</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 22/20/17</b>	20/17/13	▲ 24/23/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.32</b>	0.37	0.48


# OIL ANALYSIS REPORT

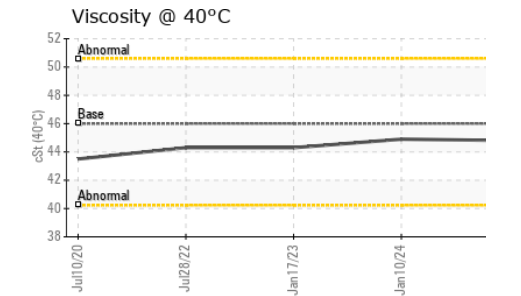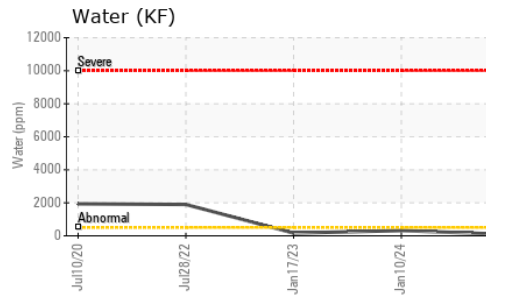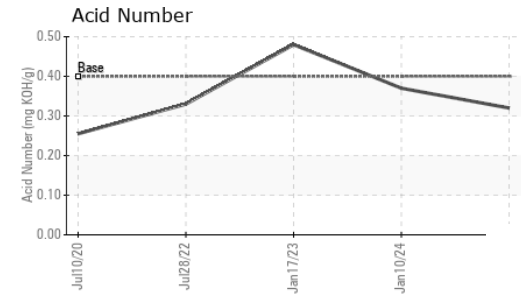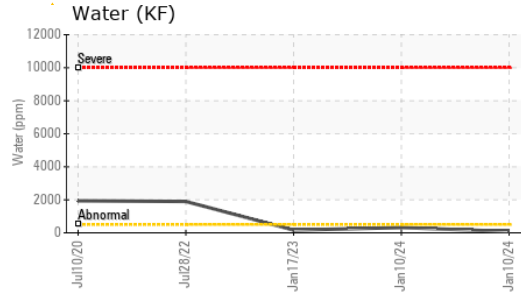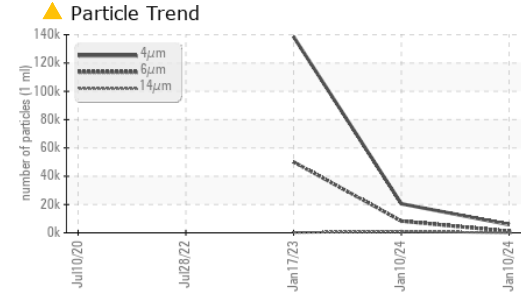






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	<b>44.8</b>	44.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

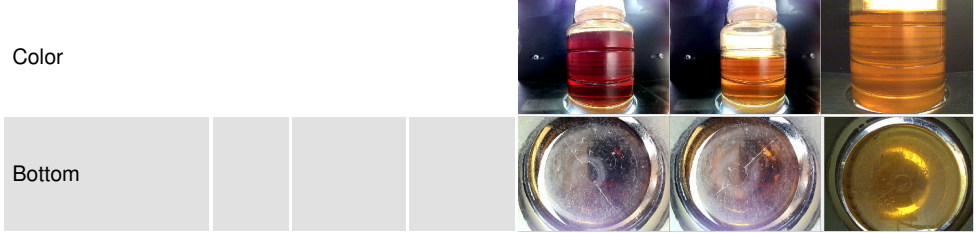

## GRAPHS

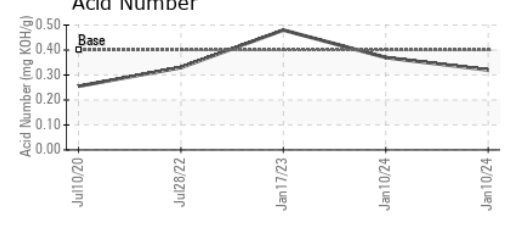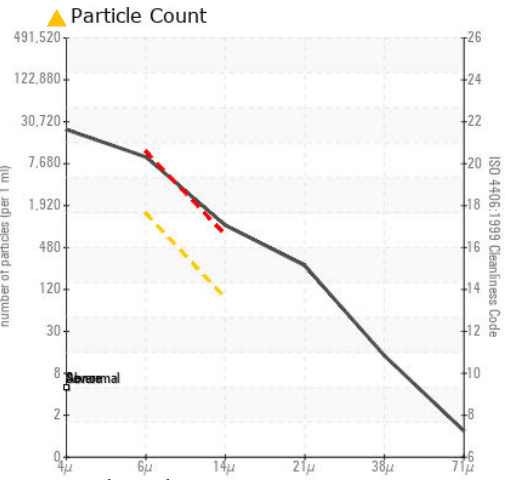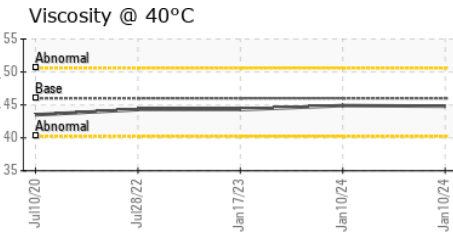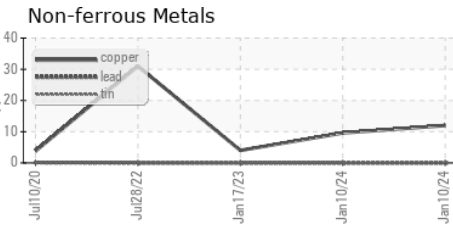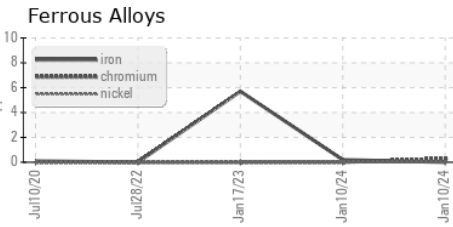

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA008914 **Received** : 16 Jan 2024  
**Lab Number** : 06061997 **Diagnosed** : 18 Jan 2024  
**Unique Number** : 10833379 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**UPS**  
 100 BUSINESS PARK DR  
 BUTNER, NC  
 US 27509  
 Contact: D JOHNSON  
 DJOHNSON2@UPS.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)