




OIL ANALYSIS REPORT

Sample Rating Trend

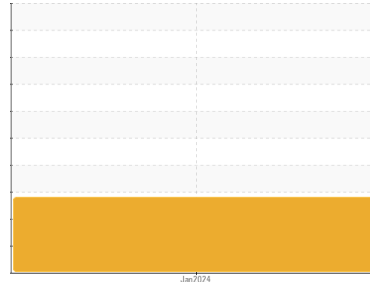

WEAR



Machine Id
KAESER CSD 100 4998876 (S/N 1212)

Component
Compressor

Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

▲ Wear

The aluminum level is abnormal. All other component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA006525	---	---
Sample Date	Client Info	11 Jan 2024	---	---
Machine Age	hrs	Client Info	10618	---
Oil Age	hrs	Client Info	0	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	15	---	---
Chromium	ppm	ASTM D5185m >10	0	---	---
Nickel	ppm	ASTM D5185m >3	0	---	---
Titanium	ppm	ASTM D5185m >3	0	---	---
Silver	ppm	ASTM D5185m >2	0	---	---
Aluminum	ppm	ASTM D5185m >10	▲ 13	---	---
Lead	ppm	ASTM D5185m >10	0	---	---
Copper	ppm	ASTM D5185m >50	2	---	---
Tin	ppm	ASTM D5185m >10	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	1	---	---
Calcium	ppm	ASTM D5185m	0	---	---
Phosphorus	ppm	ASTM D5185m 500	292	---	---
Zinc	ppm	ASTM D5185m	67	---	---
Sulfur	ppm	ASTM D5185m	4214	---	---

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	---	---
Sodium	ppm	ASTM D5185m	<1	---	---
Potassium	ppm	ASTM D5185m >20	<1	---	---
Water	%	ASTM D6304 >0.05	0.007	---	---
ppm Water	ppm	ASTM D6304 >500	72	---	---





FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	10808	---	---
Particles >6µm	ASTM D7647 >1300	▲ 5202	---	---
Particles >14µm	ASTM D7647 >80	▲ 437	---	---
Particles >21µm	ASTM D7647 >20	▲ 101	---	---
Particles >38µm	ASTM D7647 >4	▲ 5	---	---
Particles >71µm	ASTM D7647 >3	0	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 21/20/16	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	1.05	---	---


OIL ANALYSIS REPORT

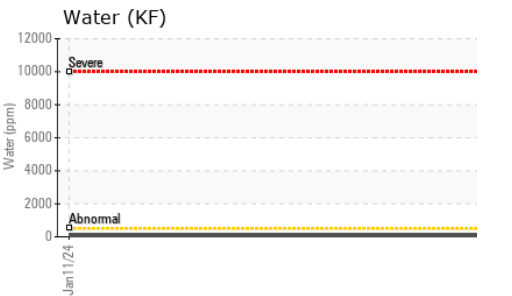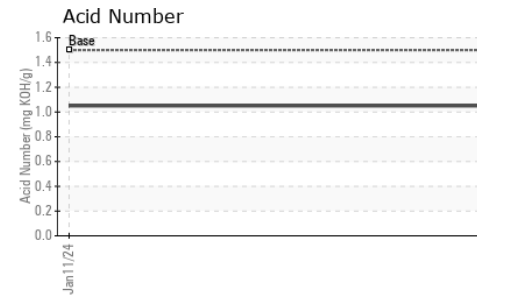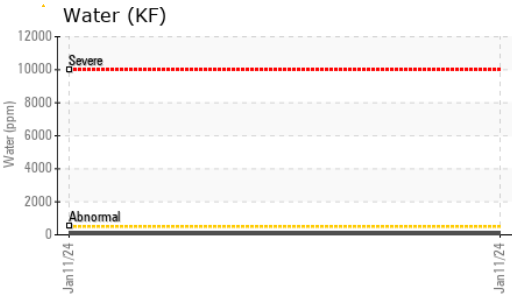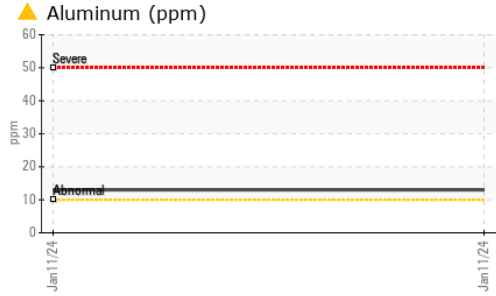



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	47.1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

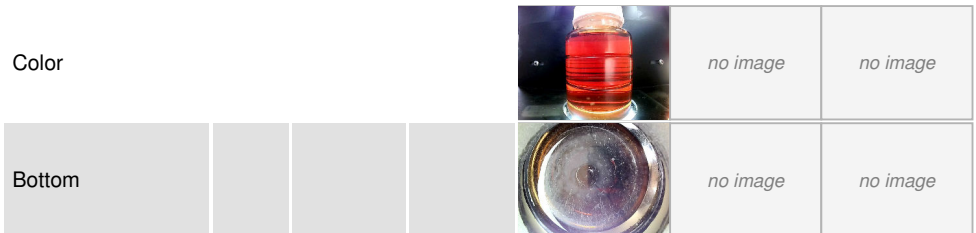

GRAPHS

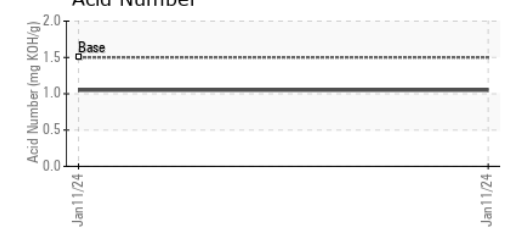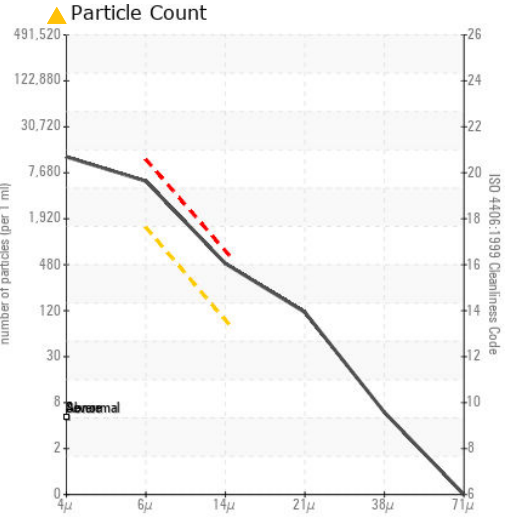

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA006525 **Recieved** : 16 Jan 2024
Lab Number : 06061999 **Diagnosed** : 18 Jan 2024
Unique Number : 10833381 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

GEORGE CHIALA FARMS INC
 9351 FIARVIEW RD
 HOLLISTER, CA
 US 95023
 Contact: JIM CASILLAS
 JIM.CASILLAS@GCFARMS.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)