




# OIL ANALYSIS REPORT

Sample Rating Trend

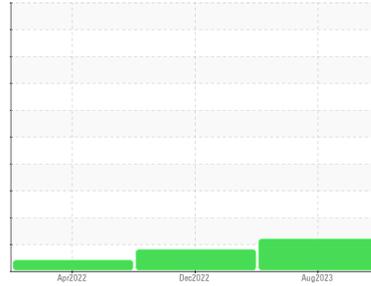

Machine Id  
**7917236 (S/N 1039)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

- Recommendation**  
 No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**  
 All component wear rates are normal.
- Contamination**  
 There is a moderate amount of particulates present in the oil.
- Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC96372</b>	KC103208	KC99429
Sample Date	Client Info		<b>02 Aug 2023</b>	15 Dec 2022	16 Apr 2022
Machine Age	hrs	Client Info	<b>12031</b>	8416	2985
Oil Age	hrs	Client Info	<b>0</b>	301	2985
Oil Changed	Client Info		<b>N/A</b>	Not Changd	Not Changd
Sample Status			<b>ATTENTION</b>	ATTENTION	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>5</b>	4	5
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>8</b>	▲ 26	13
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m >50	<b>3</b>	2	5
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m 90	<b>&lt;1</b>	2	<1
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>206</b>	527	225
Zinc	ppm	ASTM D5185m	<b>184</b>	192	59

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	2
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304 >0.05	<b>0.003</b>	0.005	0.002
ppm Water	ppm	ASTM D6304 >500	<b>39</b>	54.5	18.5






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>2844</b>	1232	---
Particles >6µm	ASTM D7647 >1300		<b>889</b>	353	---
Particles >14µm	ASTM D7647 >80		▲ <b>90</b>	39	---
Particles >21µm	ASTM D7647 >20		▲ <b>28</b>	15	---
Particles >38µm	ASTM D7647 >4		<b>3</b>	1	---
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>19/17/14</b>	17/16/12	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.56</b>	1.36	0.61

# OIL ANALYSIS REPORT

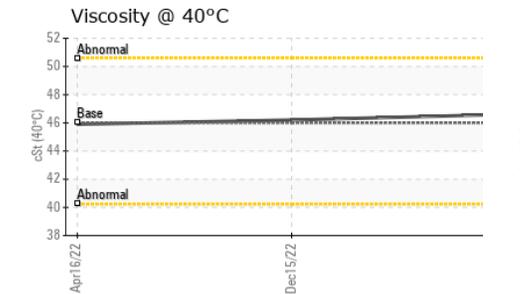
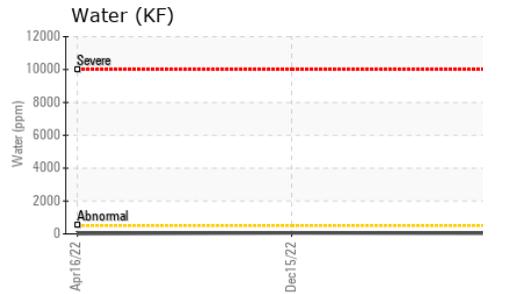
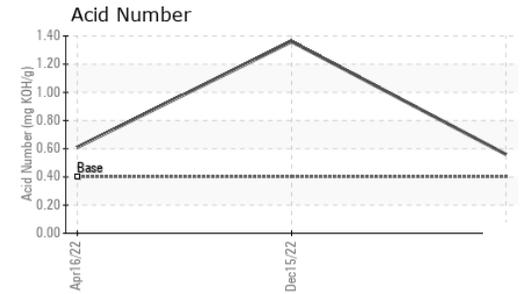
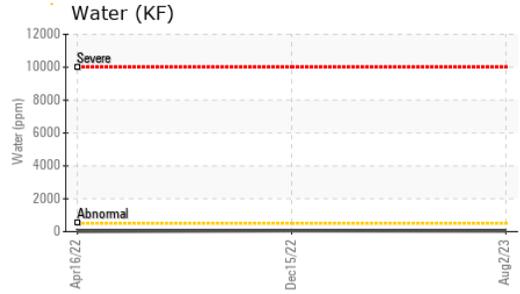
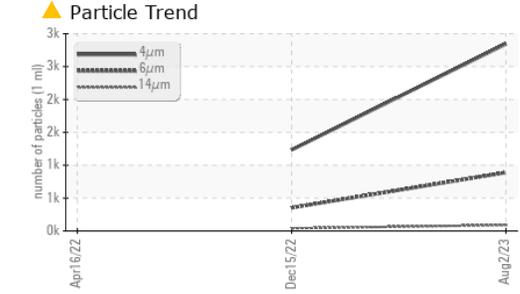


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	LIGHT
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	<b>46.6</b>	46.2	45.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

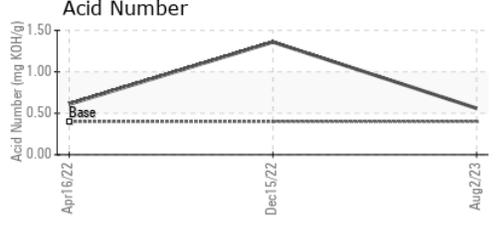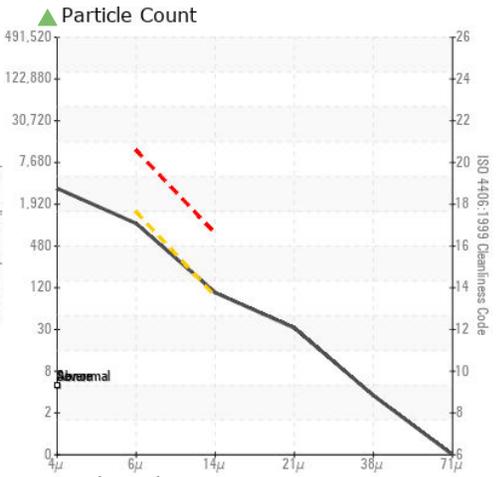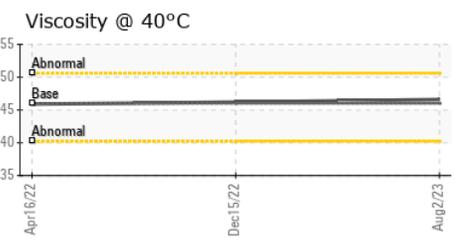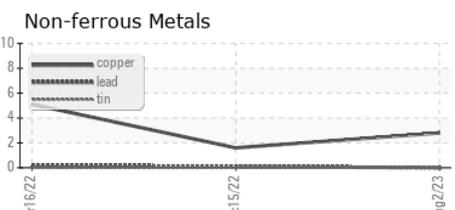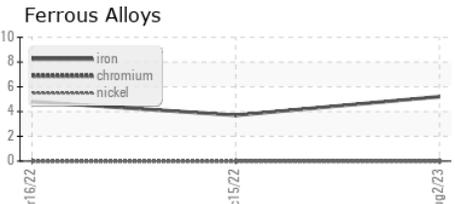

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC96372 **Received** : 16 Jan 2024  
**Lab Number** : 06062009 **Diagnosed** : 18 Jan 2024  
**Unique Number** : 10833391 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**DRUG PLASTICS CLOSURES**  
 2875 W 800 N  
 EDINBURGH, IN  
 US 46124  
 Contact: TIM BEEKER  
 timbeeker@drugplastics.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)