




OIL ANALYSIS REPORT

Sample Rating Trend

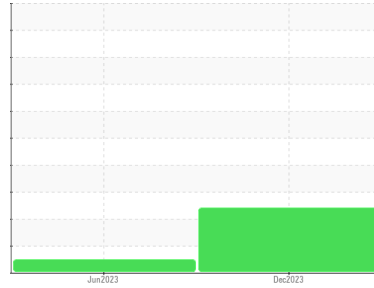

Machine Id
8694098 (S/N 1322)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation
 Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC127571	KCPA003477	---
Sample Date	Client Info	08 Dec 2023	14 Jun 2023	---
Machine Age	hrs	6334	3303	---
Oil Age	hrs	0	0	---
Oil Changed	Client Info	N/A	N/A	---
Sample Status		ABNORMAL	NORMAL	---

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	4	0	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	1	2	---
Lead	ppm	ASTM D5185m >10	0	0	---
Copper	ppm	ASTM D5185m >50	15	11	---
Tin	ppm	ASTM D5185m >10	0	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m 90	0	5	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	0	0	---
Magnesium	ppm	ASTM D5185m 90	5	5	---
Calcium	ppm	ASTM D5185m 2	0	0	---
Phosphorus	ppm	ASTM D5185m	11	<1	---
Zinc	ppm	ASTM D5185m	<1	10	---

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	2	0	---
Sodium	ppm	ASTM D5185m	2	3	---
Potassium	ppm	ASTM D5185m >20	<1	1	---
Water	%	ASTM D6304 >0.05	0.009	0.009	---
ppm Water	ppm	ASTM D6304 >500	92	95.3	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	198610	1631	---
Particles >6µm	ASTM D7647 >1300	▲ 125259	620	---
Particles >14µm	ASTM D7647 >80	▲ 14306	52	---
Particles >21µm	ASTM D7647 >20	▲ 4093	8	---
Particles >38µm	ASTM D7647 >4	▲ 152	0	---
Particles >71µm	ASTM D7647 >3	▲ 4	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 25/24/21	18/16/13	---

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.41	0.43	---


OIL ANALYSIS REPORT

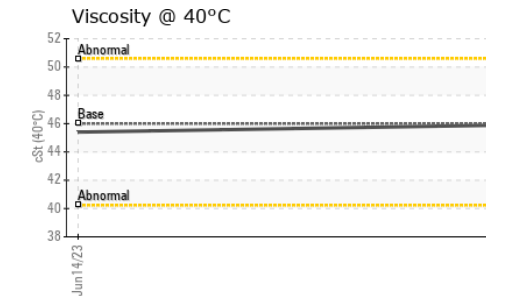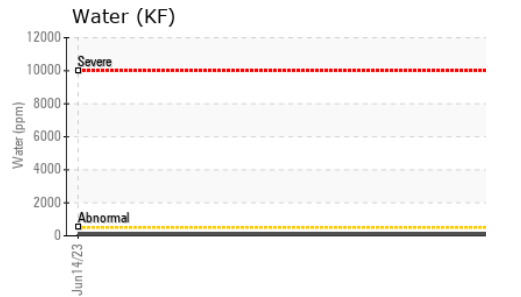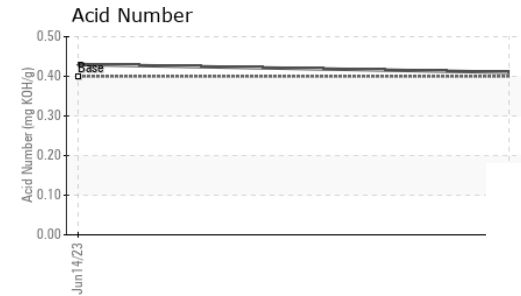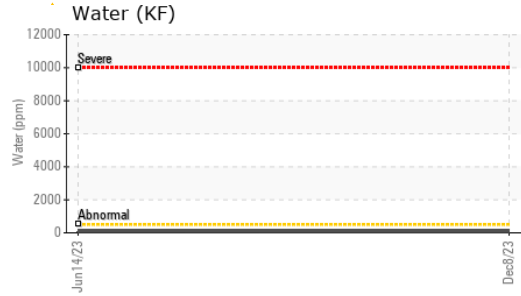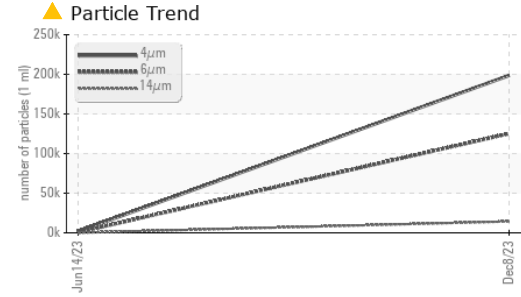





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	LIGHT	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.9	45.4	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

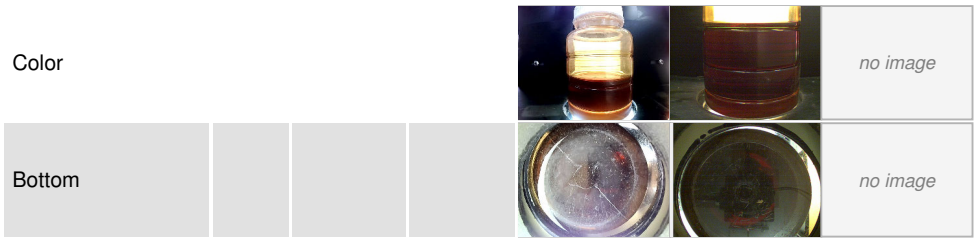

GRAPHS

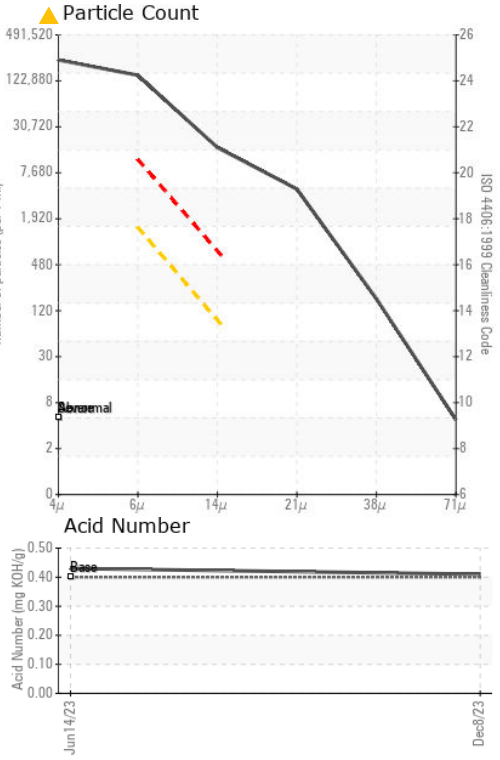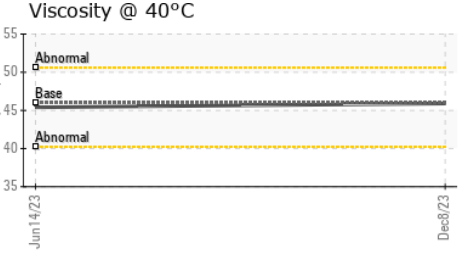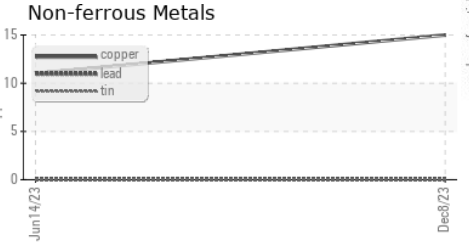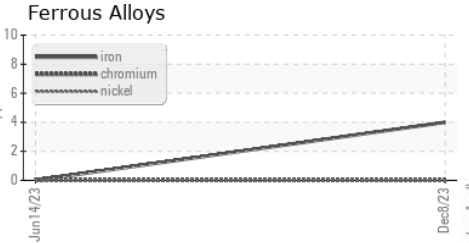

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC127571 **Received** : 16 Jan 2024
Lab Number : 06062019 **Diagnosed** : 18 Jan 2024
Unique Number : 10833401 **Diagnostician** : Don Baldrige
Test Package : IND 2

DIVERSIFIED PLASTICS
 3860 SOCIAL CIRCLE PKWY
 SOCIAL CIRCLE, GA
 US 30025
 Contact: SHAWN
 SHAWN@DPIROTO.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)