

# **OIL ANALYSIS REPORT**

KAESER 8627774

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)





### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		<u>-</u>		Jan 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA010344		
Sample Date		Client Info		02 Jan 2024		
Machine Age	hrs	Client Info		1471		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	1		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	57		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	82		
Calcium	ppm	ASTM D5185m	0	4		
Phosphorus	ppm	ASTM D5185m	0	11		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	19581		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon		ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m	>20	20		
Potassium		ASTM D5185m	>20	8		
	ppm %		>0.05	_		
Water ppm Water	ppm	ASTM D6304 ASTM D6304	>50.05	0.021 220		
FLUID CLEANLIN		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		42875		
Particles >6μm		ASTM D7647	>1300	△ 20613		
Particles >14µm		ASTM D7647	>80	△ 2343		
Particles >21μm		ASTM D7647		△ 531		
Particles >38µm		ASTM D7647	>4	▲ 21		
Particles >71µm		ASTM D7647		1		
Oil Cleanliness		ISO 4406 (c)	>/17/13	△ 23/22/18		
	A TION	. ,				
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.36		



## **OIL ANALYSIS REPORT**

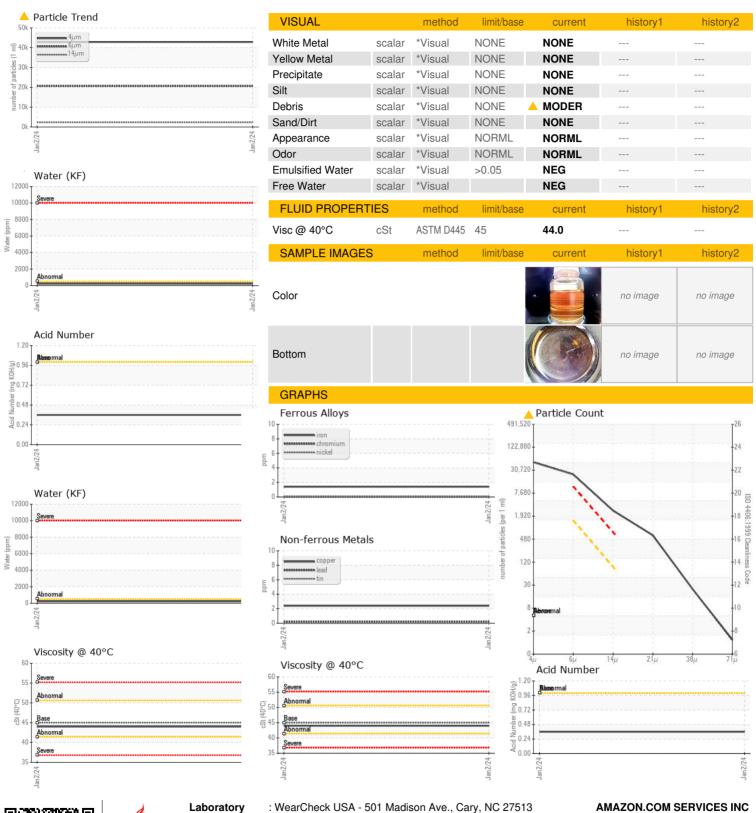





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** 

: KCPA010344 : 06062021

: 10833403

Recieved Diagnosed

: 16 Jan 2024 : 18 Jan 2024 Diagnostician : Don Baldridge

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

4500 WILBUR AVE OAKLEY, CA US 94561

Contact: Service Manager DECKERER@AMAZON.COM

T:

F: