




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

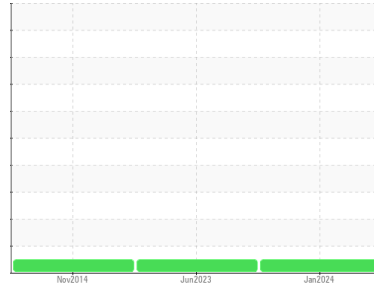

Machine Id  
**SB-3 (S/N 11551K85625811)**

Component  
**Refrigeration Compressor**  
Fluid  
**USPI 1009-68 SC (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0005052</b>	USP248392	USP145234
Sample Date	Client Info		<b>15 Jan 2024</b>	24 Jun 2023	14 Nov 2014
Machine Age	hrs	Client Info	<b>0</b>	26373	47624
Oil Age	hrs	Client Info	<b>0</b>	80	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>&lt;1</b>	0	9
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>1</b>	<1	<1
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	3
Copper	ppm	ASTM D5185m >8	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 50	<b>0</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304 >0.01	<b>0.004</b>	0.001	0.004
ppm Water	ppm	ASTM D6304 >100	<b>46</b>	7.2	40

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>3927</b>	934	1064
Particles >6µm	ASTM D7647	>2500	<b>1088</b>	269	579
Particles >14µm	ASTM D7647	>320	<b>32</b>	23	98
Particles >21µm	ASTM D7647	>80	<b>8</b>	7	33
Particles >38µm	ASTM D7647	>20	<b>1</b>	1	5
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>19/17/12</b>	17/15/12	17/16/14

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	<b>0.012</b>	0.015	0.015




# OIL ANALYSIS REPORT

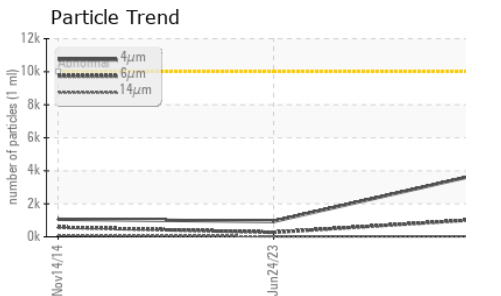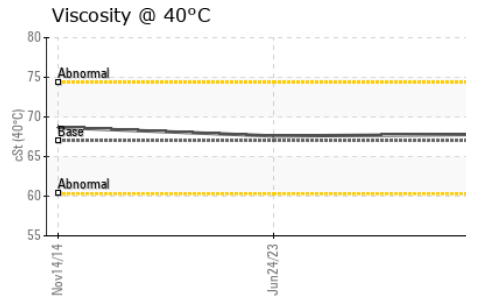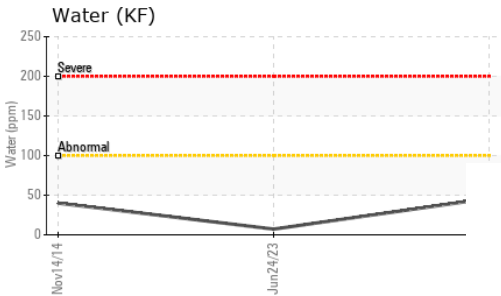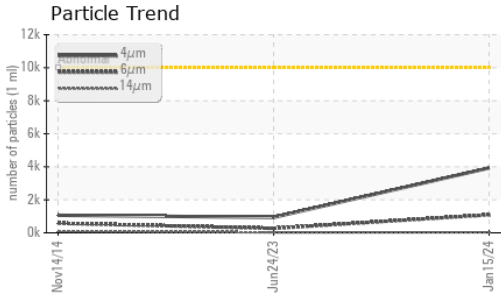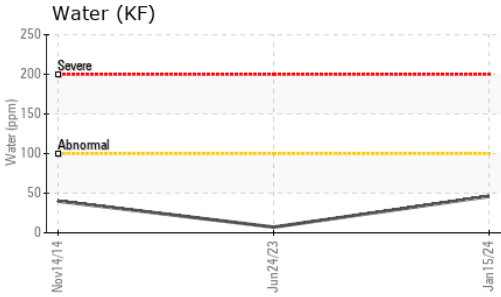






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 67	<b>67.8</b>	67.6	68.68

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

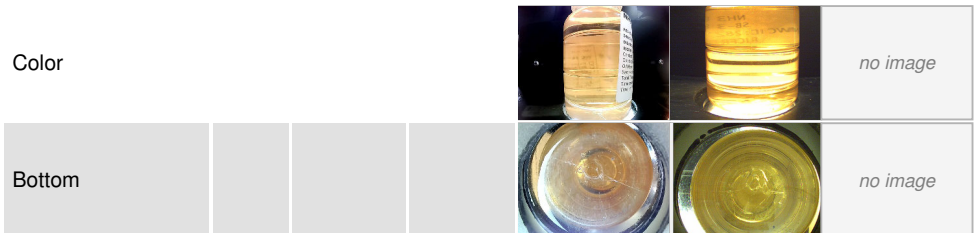

## GRAPHS

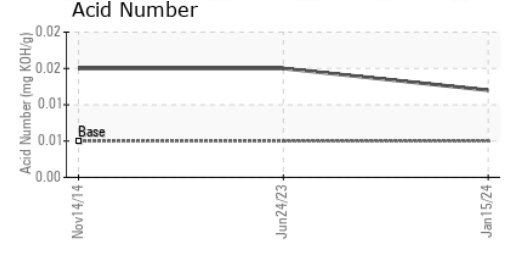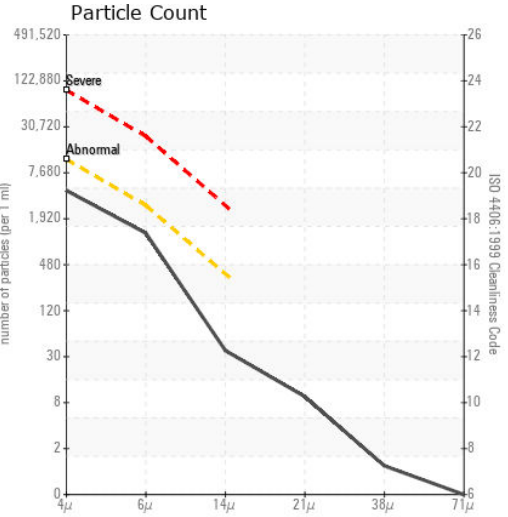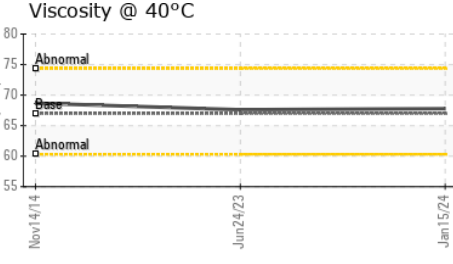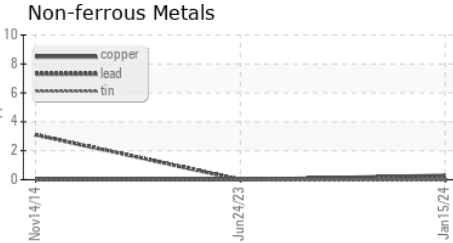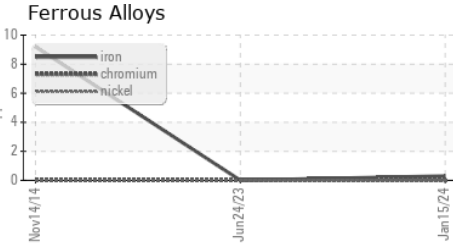

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0005052 **Received** : 16 Jan 2024  
**Lab Number** : **06062053** **Diagnosed** : 18 Jan 2024  
**Unique Number** : 10833435 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

**CONAGRA - RICH'S FOODS - RICFRI**  
 7350 COMMERCE LN NE  
 FRIDLEY, MN  
 US 55432  
 Contact: HENRY WINTER  
 henry.winterjr@conagrafood.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)