OIL ANALYSIS REPORT

Sample Rating Trend

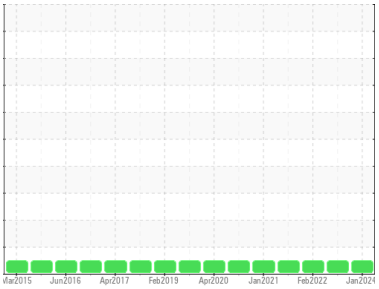

NORMAL

Area
CMPL
Machine Id
CMPL CMPL EXIT PINCH ROLL (S/N 16-5300-0315)
Component
Gearbox
Fluid
GEAR OIL ISO 220 (--- QTS)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**RP0038458**	RP0028674	RP0024469
Sample Date		Client Info		**12 Jan 2024**	10 Aug 2022	03 Feb 2022
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**NORMAL**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		**20**	15	20
Iron	ppm	ASTM D5185m	>200	**14**	13	14
Chromium	ppm	ASTM D5185m	>15	**0**	0	0
Nickel	ppm	ASTM D5185m	>15	**0**	0	0
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>25	**1**	<1	<1
Lead	ppm	ASTM D5185m	>100	**0**	0	0
Copper	ppm	ASTM D5185m	>200	**<1**	<1	<1
Tin	ppm	ASTM D5185m	>25	**0**	0	0
Antimony	ppm	ASTM D5185m	>5	**---**	---	0
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	**0**	3	18
Barium	ppm	ASTM D5185m	15	**0**	<1	0
Molybdenum	ppm	ASTM D5185m	15	**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	<1	0
Magnesium	ppm	ASTM D5185m	50	**0**	0	0
Calcium	ppm	ASTM D5185m	50	**34**	25	35
Phosphorus	ppm	ASTM D5185m	350	**145**	108	153
Zinc	ppm	ASTM D5185m	100	**0**	11	2

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	**3**	2	3
Sodium	ppm	ASTM D5185m		**<1**	<1	<1
Potassium	ppm	ASTM D5185m	>20	**<1**	0	0
Water	%	ASTM D6304	>0.2	**0.004**	0.014	0.004
ppm Water	ppm	ASTM D6304	>2000	**43**	141.9	43.9

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	**0.24**	0.23	0.28

OIL ANALYSIS REPORT

Water (KF)

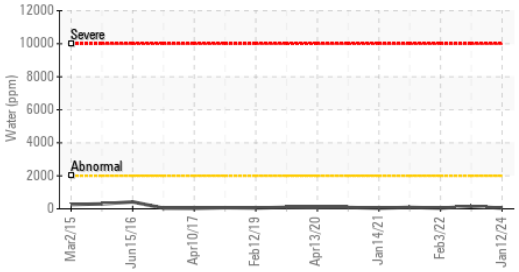

Water (KF)

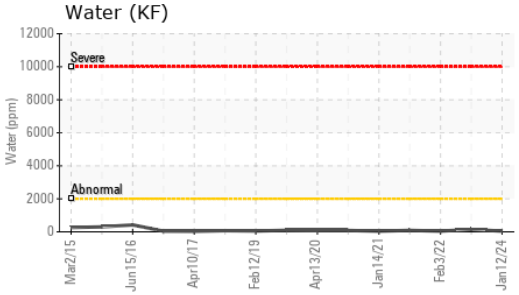

Viscosity @ 40°C

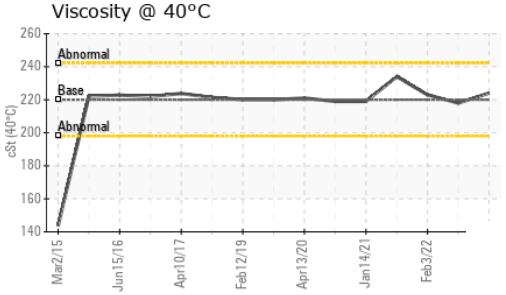

PQ

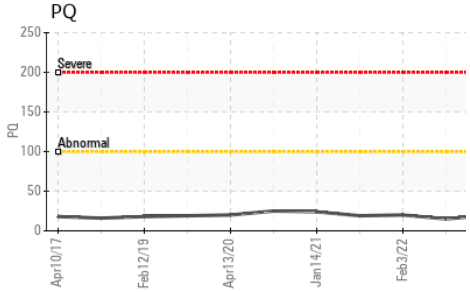

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	VLITE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	**224**	218	223

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom			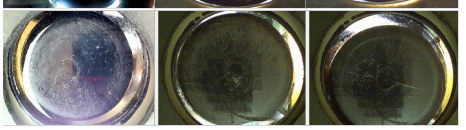		

GRAPHS

Ferrous Alloys

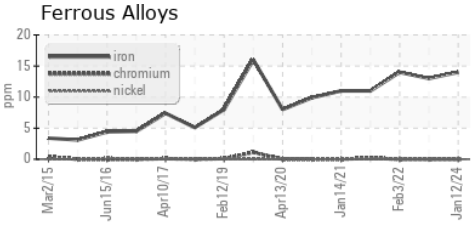

PQ

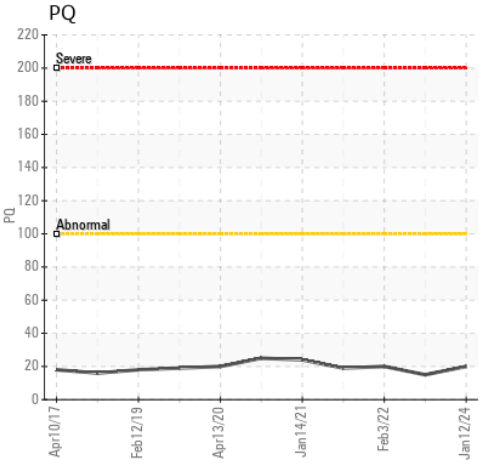

Non-ferrous Metals

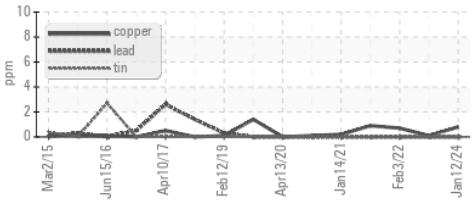

Viscosity @ 40°C

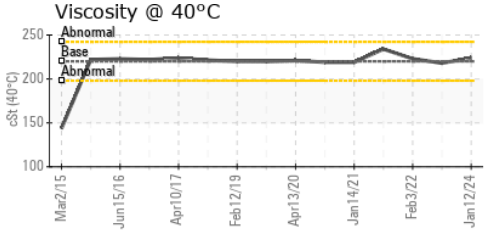

Acid Number

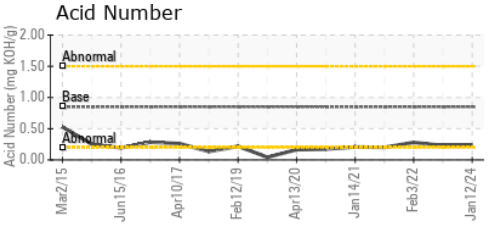

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0038458 **Recieved** : 16 Jan 2024
Lab Number : 06062065 **Diagnosed** : 18 Jan 2024
Unique Number : 10833447 **Diagnostician** : Don Baldridge
Test Package : IND 2 (Additional Tests: PQ)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

OUTOKUMPU STAINLESS USA
HWY 43 N
CALVERT, AL
US 36513
Contact: MARIO JOHNSON
Mario.johnson@outokumpu.com
T: (251)321-4105
F: x:

Report Id: OUTCALAL [WUSCAR] 06062065 (Generated: 01/18/2024 13:44:14) Rev: 1

Submitted By: DALE ROBINSON