


# **OIL ANALYSIS REPORT**

# Area ACAS 110 [7764]

Component

Compressor



#### DIAGNOSIS

## Recommendation

Resample at the next service interval to monitor.

ATLAS COPCO ITJ217449

#### Wear

All component wear rates are normal.

## Contamination

There is no indication of any contamination in the oil


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Janzuza		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06062092		
Sample Date		Client Info		02 Jan 2024		
Machine Age	hrs	Client Info		20467		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	0		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		<1		
Phosphorus	ppm	ASTM D5185m		326		
Zinc	ppm	ASTM D5185m		30		
Sulfur	ppm	ASTM D5185m		37		
CONTAMINANTS	}	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	3		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.19		



# **OIL ANALYSIS REPORT**

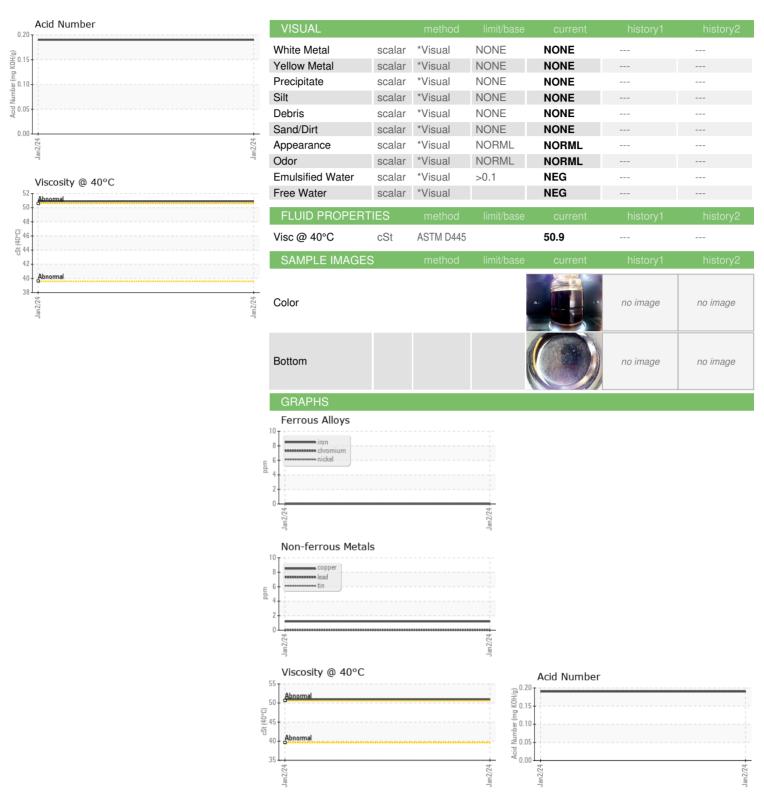





Certificate L2367

Laboratory Sample No. Lab Number Test Package : IND 2

Unique Number

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06062092 : 06062092 : 10833474

Recieved

Diagnosed Diagnostician

: 16 Jan 2024 : 18 Jan 2024 : Don Baldridge ADVANCED COMPRESSED AIR SOLUTIONS (ACAS) 9421 FM 2920 RD BLDG 23

TOMBALL, TX US 77375

Contact: JIM SUAREZ jim@advancedcompressedair.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: