




# OIL ANALYSIS REPORT

Sample Rating Trend

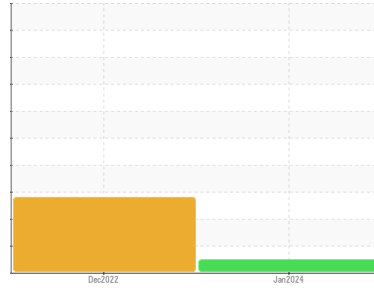

**NORMAL**



Machine Id  
**8253901 (S/N 1830)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC06062711</b>	KC05741520	---
Sample Date	Client Info			<b>04 Jan 2024</b>	28 Dec 2022	---
Machine Age	hrs	Client Info		<b>3331</b>	1830	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	<1	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>1</b>	2	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m	90	<b>16</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	90	<b>72</b>	36	---
Calcium	ppm	ASTM D5185m	2	<b>1</b>	0	---
Phosphorus	ppm	ASTM D5185m		<b>46</b>	21	---
Zinc	ppm	ASTM D5185m		<b>0</b>	0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>9</b>	6	---
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	4	---
Water	%	ASTM D6304	>0.05	<b>0.008</b>	▲ 0.103	---
ppm Water	ppm	ASTM D6304	>500	<b>84</b>	▲ 1030	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>2260</b>	---	---
Particles >6µm		ASTM D7647	>1300	<b>948</b>	---	---
Particles >14µm		ASTM D7647	>80	<b>64</b>	---	---
Particles >21µm		ASTM D7647	>20	<b>12</b>	---	---
Particles >38µm		ASTM D7647	>4	<b>1</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>18/17/13</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.39</b>	0.31	---


# OIL ANALYSIS REPORT

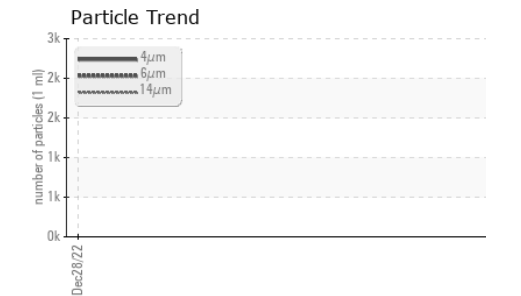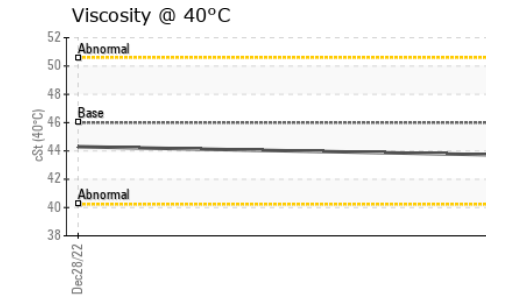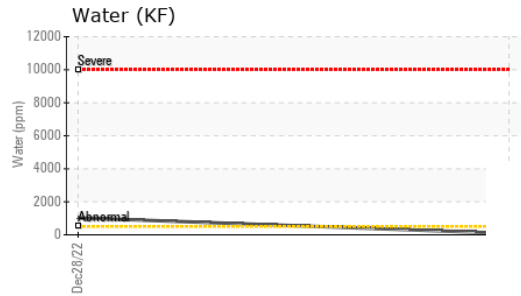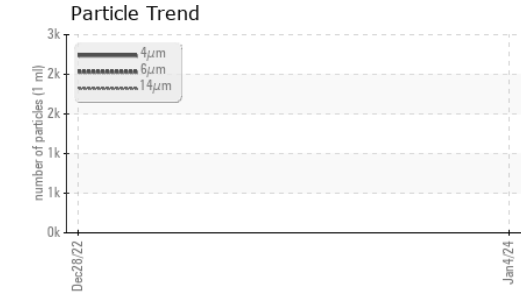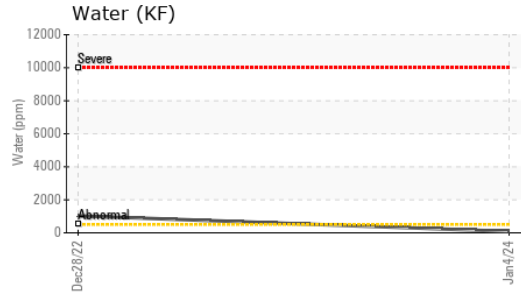





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	▲ HAZY
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	43.7	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

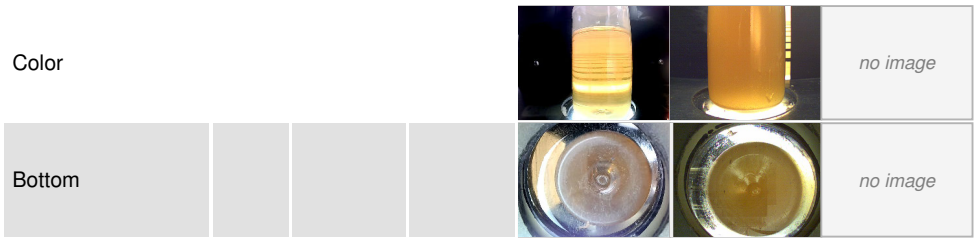

## GRAPHS

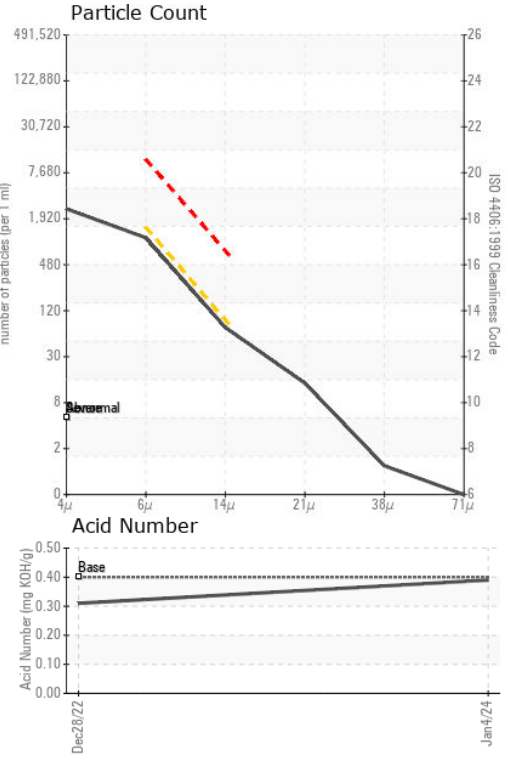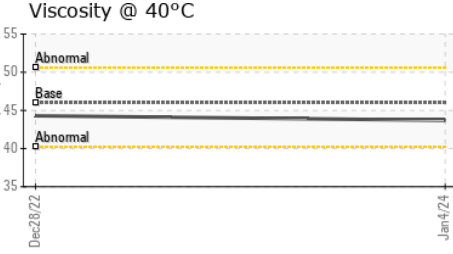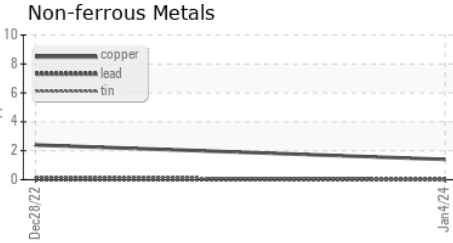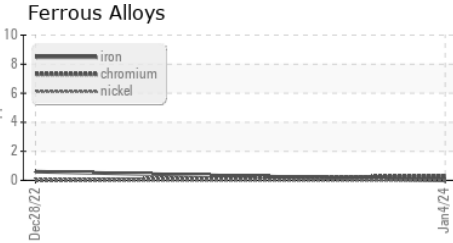

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC06062711 **Received** : 17 Jan 2024  
**Lab Number** : 06062711 **Diagnosed** : 19 Jan 2024  
**Unique Number** : 10834093 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**DOUBLE E TOOLING**  
 212 ROCK SPRINGS RD  
 LULA, GA  
 US  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: