

OIL ANALYSIS REPORT



WATER

KAESER 8845937

Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		and the state		Dec2023	Interface and	history O
SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06062712		
Sample Date		Client Info		14 Dec 2023		
Machine Age	hrs	Client Info		4696		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	9		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	3		
Molybdenum	ppm	ASTM D5185m	00	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	25		
Calcium	ppm	ASTM D5185m		<1		
Phosphorus	ppm	ASTM D5185m	L	47		
Zinc	ppm	ASTM D5185m		0		
				U		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	6		
Water	%	ASTM D6304	>0.05	<u> </u>		
ppm Water	ppm	ASTM D6304	>500	6 550		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		236598		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	🔺 1614		
Particles >38µm		ASTM D7647	>4	<mark>人</mark> 61		
Particles >71µm		ASTM D7647	>3	2		
Oil Cleanliness		ISO 4406 (c)	>/17/13	25/25/21		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.33		




OIL ANALYSIS REPORT

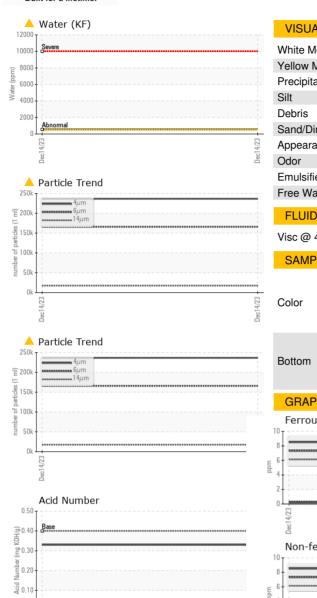



0.00

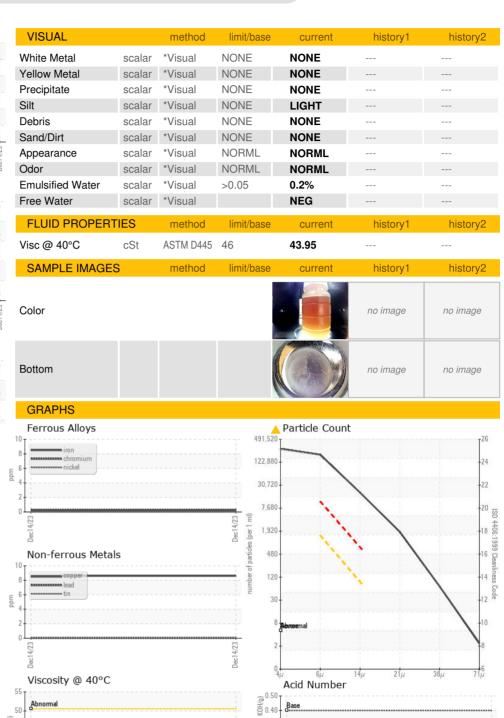

Ē 0.30

· 문 0.20

0.10 Acid

0.00

Dec1

Dec14/23 -

: 17 Jan 2024

: 24 Jan 2024

: Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: KC06062712

:06062712

: 10834094

: IND 2

45 ŝ

40

35

Laboratory

Sample No.

Lab Number

Unique Number

Test Package

Dec14/23

Abnorma

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Diagnostician

Recieved

Diagnosed

Certificate L2367

Contact/Location: Service Manager - PEAJEF

PEACH STATE FREIGHTLINER

1755 DRY POND RD

Contact: Service Manager

JEFFERSON, GA

US 30549