


OIL ANALYSIS REPORT

Sample Rating Trend



WATER

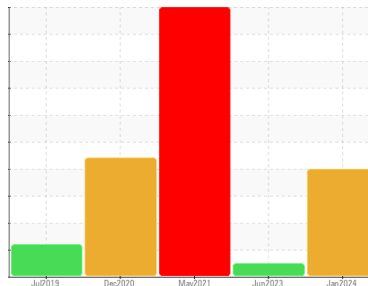

Machine Id
KAESER SX 4 6722974 (S/N 6908)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC06062719	KC05883343	KC05271624
Sample Date	Client Info	02 Jan 2024	21 Jun 2023	27 May 2021
Machine Age	hrs	13331	10189	6280
Oil Age	hrs	0	0	4988
Oil Changed	Client Info	N/A	N/A	Changed
Sample Status		ABNORMAL	NORMAL	SEVERE

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	0	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	0	0
Lead	ppm	ASTM D5185m >10	0	<1	<1
Copper	ppm	ASTM D5185m >50	8	5	2
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	12
Barium	ppm	ASTM D5185m 90	2	0	3
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 90	26	10	8
Calcium	ppm	ASTM D5185m 2	2	0	0
Phosphorus	ppm	ASTM D5185m	0	0	4
Zinc	ppm	ASTM D5185m	15	18	29

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	0
Sodium	ppm	ASTM D5185m	5	4	<1
Potassium	ppm	ASTM D5185m >20	0	3	0
Water	%	ASTM D6304 >0.05	▲ 0.059	0.010	● 1.70
ppm Water	ppm	ASTM D6304 >500	▲ 590	104.6	● 17000






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	103058	4531	1717
Particles >6µm	ASTM D7647 >1300	▲ 36031	1136	935
Particles >14µm	ASTM D7647 >80	▲ 3577	46	▲ 159
Particles >21µm	ASTM D7647 >20	▲ 1147	10	▲ 54
Particles >38µm	ASTM D7647 >4	▲ 72	1	▲ 8
Particles >71µm	ASTM D7647 >3	▲ 4	0	1
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 24/22/19	19/17/13	▲ 17/14

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.31	0.21	0.170


OIL ANALYSIS REPORT

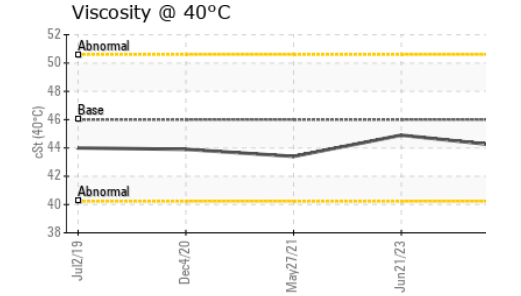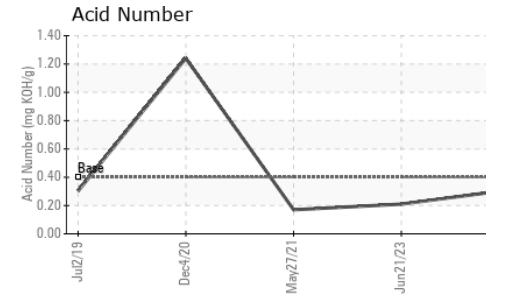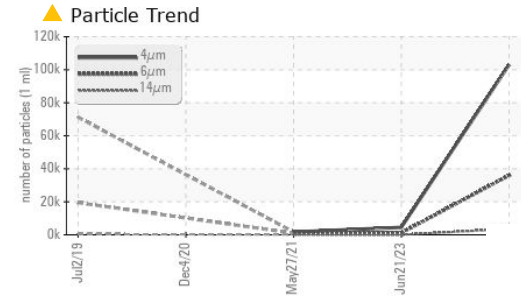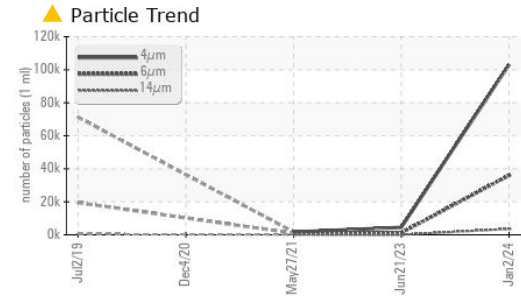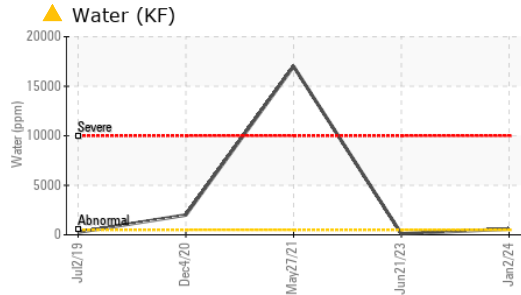






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.1	44.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

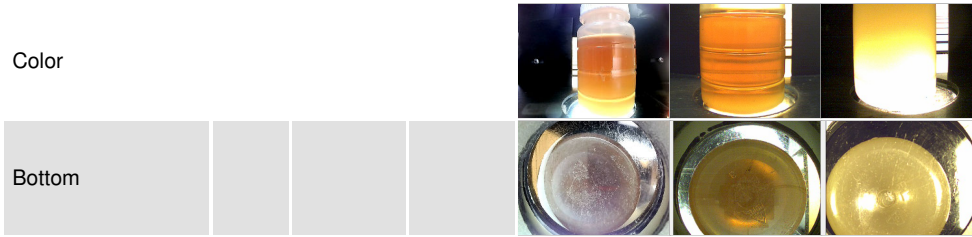

GRAPHS

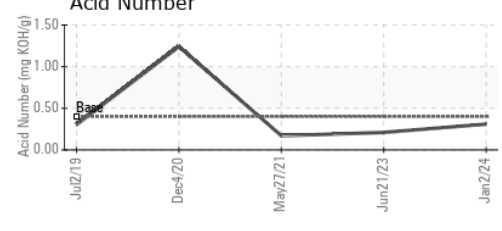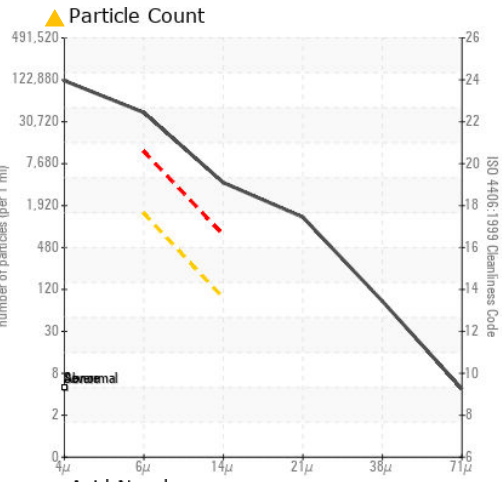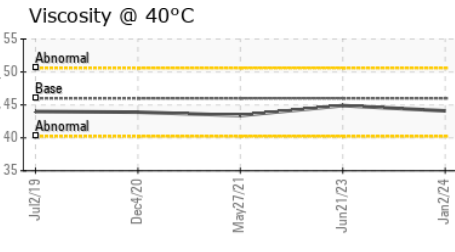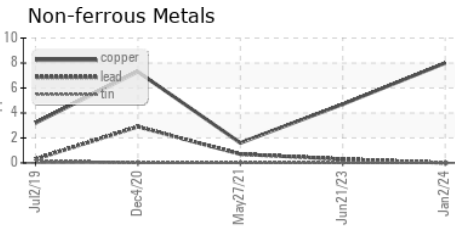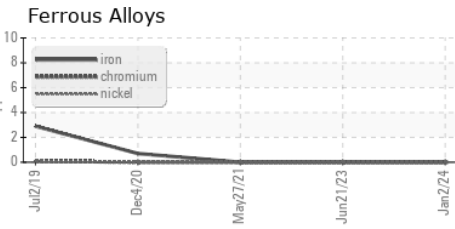

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC06062719 **Received** : 17 Jan 2024
Lab Number : 06062719 **Diagnosed** : 24 Jan 2024
Unique Number : 10834101 **Diagnostician** : Doug Bogart
Test Package : IND 2

NORTH EAST GEORGIA MEDICAL CENTER
 743 SPRING ST NE
 GAINESVILLE, GA
 US 30501
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: