




OIL ANALYSIS REPORT

Sample Rating Trend

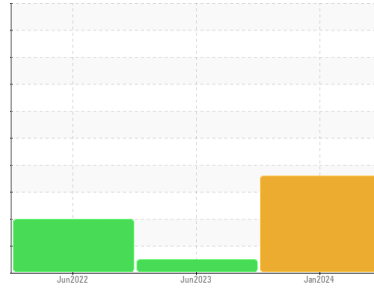

WATER



Machine Id
KAESER SX7.5 8182460 (S/N 1279)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC06062732	KC05897469	KC05573265
Sample Date	Client Info	02 Jan 2024	22 Jun 2023	13 Jun 2022
Machine Age	hrs	13117	0	2965
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	Changed
Sample Status		ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	0	1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	<1	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	<1	<1
Lead	ppm	ASTM D5185m >10	0	<1	0
Copper	ppm	ASTM D5185m >50	6	12	4
Tin	ppm	ASTM D5185m >10	0	0	<1
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m 90	4	0	13
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 90	45	12	36
Calcium	ppm	ASTM D5185m 2	1	0	0
Phosphorus	ppm	ASTM D5185m	0	<1	7
Zinc	ppm	ASTM D5185m	8	3	2

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	0
Sodium	ppm	ASTM D5185m	7	6	11
Potassium	ppm	ASTM D5185m >20	0	4	0
Water	%	ASTM D6304 >0.05	▲ 0.087	0.009	0.018
ppm Water	ppm	ASTM D6304 >500	▲ 870	92.0	187.5






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	33659	3032	25951
Particles >6µm	ASTM D7647 >1300	▲ 6187	1052	▲ 10632
Particles >14µm	ASTM D7647 >80	▲ 423	75	▲ 865
Particles >21µm	ASTM D7647 >20	▲ 117	17	▲ 158
Particles >38µm	ASTM D7647 >4	▲ 7	0	▲ 18
Particles >71µm	ASTM D7647 >3	0	0	1
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 22/20/16	19/17/13	▲ 22/21/17

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.32	0.26	0.32


OIL ANALYSIS REPORT

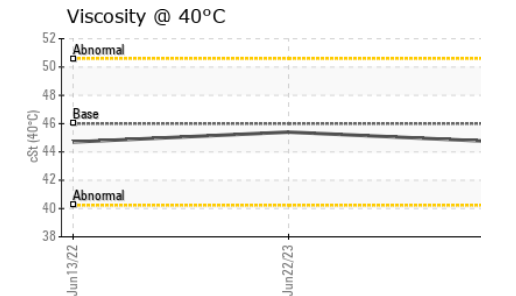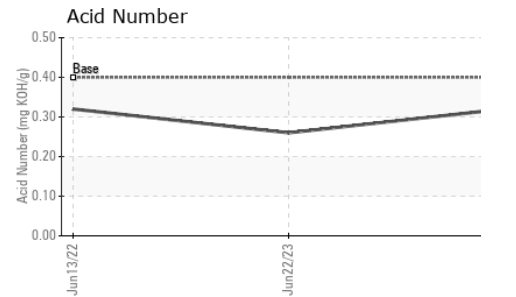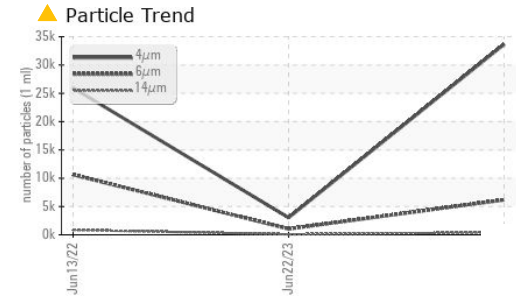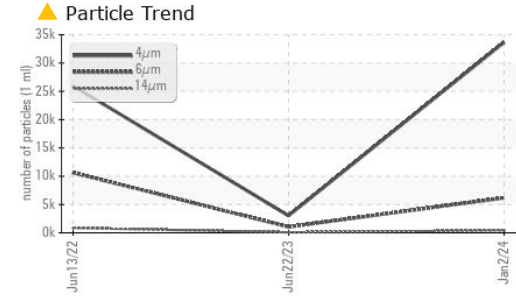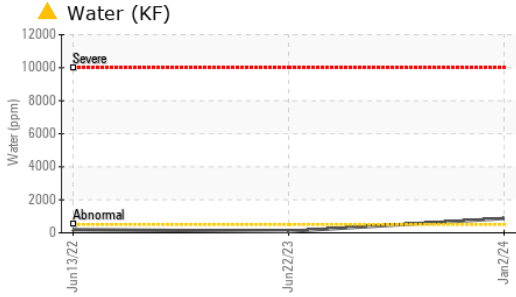





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	MODER	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	44.7	45.4	44.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

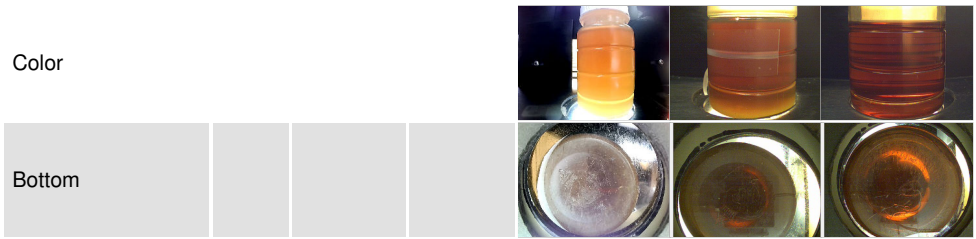

GRAPHS

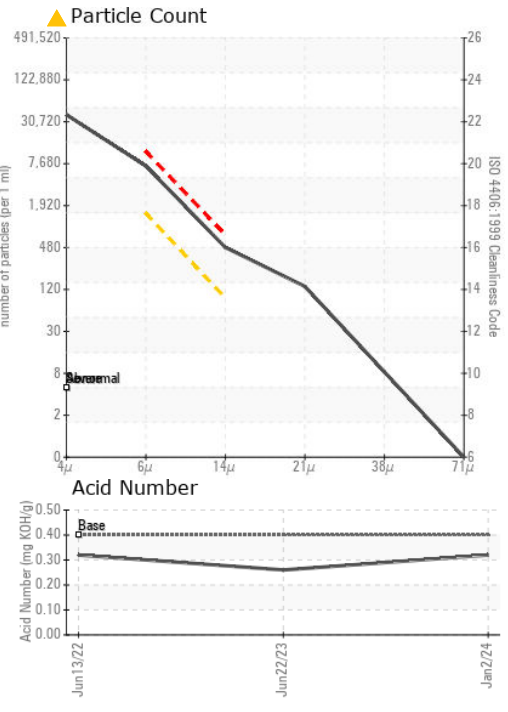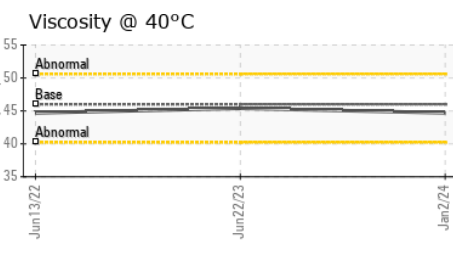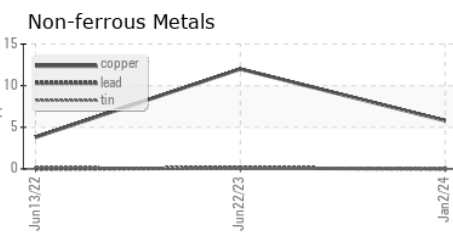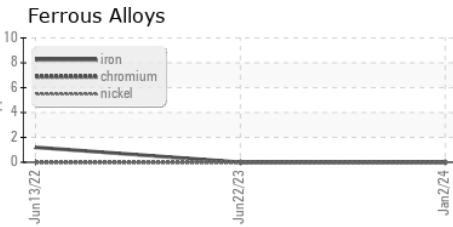

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : KC06062732
 Lab Number : **06062732**
 Unique Number : 10834114
 Test Package : IND 2
 Recieved : 17 Jan 2024
 Diagnosed : 24 Jan 2024
 Diagnostician : Doug Bogart

NORTH EAST GEORGIA MEDICAL CENTER
 743 SPRING ST NE
 GAINESVILLE, GA
 US 30501
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: