

OIL ANALYSIS REPORT





KAESER 8482124

Component Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06062733		
Sample Date		Client Info		11 Jan 2024		
Machine Age	hrs	Client Info		1052		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	4		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		1		
Magnesium	ppm	ASTM D5185m	90	21		
Calcium	ppm	ASTM D5185m	2	1		
Phosphorus	ppm	ASTM D5185m	-	0		
Zinc	ppm	ASTM D5185m		44		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m	>20	7		
Potassium		ASTM D5185m	>20	7		
Water	ppm %	ASTM D3103III		0.036		
ppm Water	ppm	ASTM D0304 ASTM D6304	>500	367		
FLUID CLEANLIN		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		6788		
Particles >6µm		ASTM D7647	>1300	▲ 2392		
Particles >14µm		ASTM D7647	>80	▲ 162		
Particles >21µm		ASTM D7647	>20	▲ 47		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	▲ 20/18/15		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
		ASTM D8045	0.4			
Acid Number (AN)	mg KOH/g	70 HVI D0040	0.4	0.25		




OIL ANALYSIS REPORT





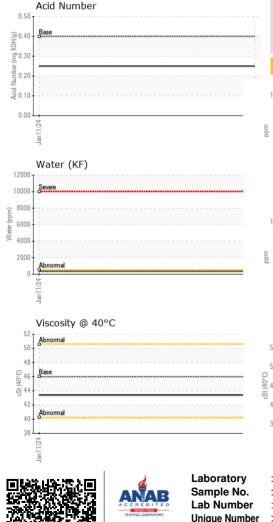

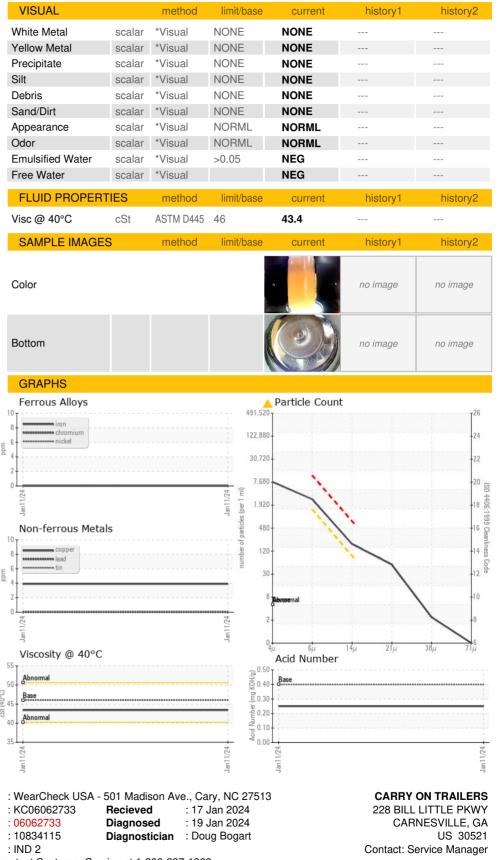

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Test Package

T:

F: