


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

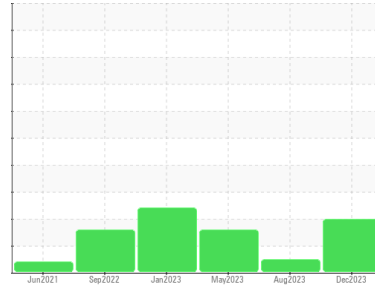

Machine Id
KAESER 7176309

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC06062736	KC05949164	KC05850636
Sample Date	Client Info	15 Dec 2023	31 Aug 2023	05 May 2023
Machine Age	hrs	6874	6319	5729
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	NORMAL	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	<1	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	<1	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >10	<1	0	2
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	2	6	4
Tin	ppm	ASTM D5185m >10	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	39	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m 90	81	34	19
Calcium	ppm	ASTM D5185m 2	4	0	0
Phosphorus	ppm	ASTM D5185m	0	3	0
Zinc	ppm	ASTM D5185m	17	18	0

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	0
Sodium	ppm	ASTM D5185m	12	12	15
Potassium	ppm	ASTM D5185m >20	<1	3	4
Water	%	ASTM D6304 >0.05	0.012	0.011	0.016
ppm Water	ppm	ASTM D6304 >500	128	116.5	166.3






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	50774	1761	6294
Particles >6µm	ASTM D7647 >1300	▲ 26642	610	▲ 1575
Particles >14µm	ASTM D7647 >80	▲ 5555	52	▲ 123
Particles >21µm	ASTM D7647 >20	▲ 1941	13	▲ 31
Particles >38µm	ASTM D7647 >4	▲ 94	0	1
Particles >71µm	ASTM D7647 >3	3	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 23/22/20	18/16/13	▲ 20/18/14

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.382	0.27	0.34

OIL ANALYSIS REPORT

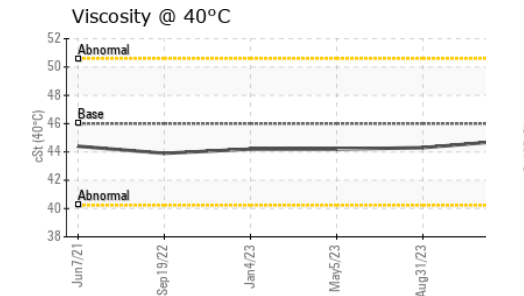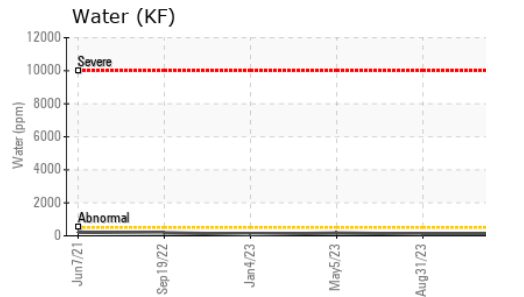
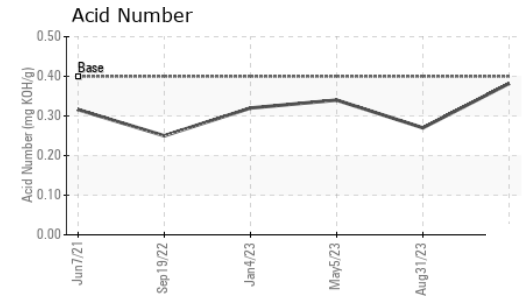
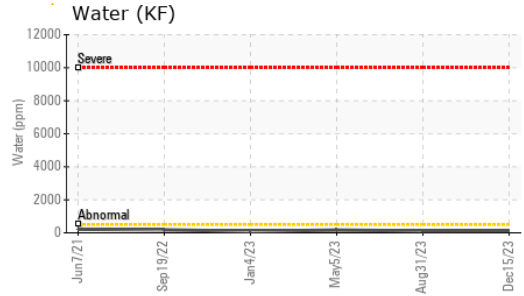
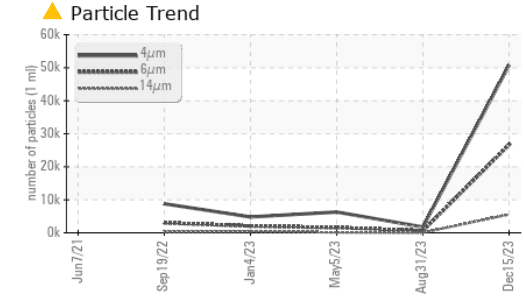


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.8	44.3	44.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

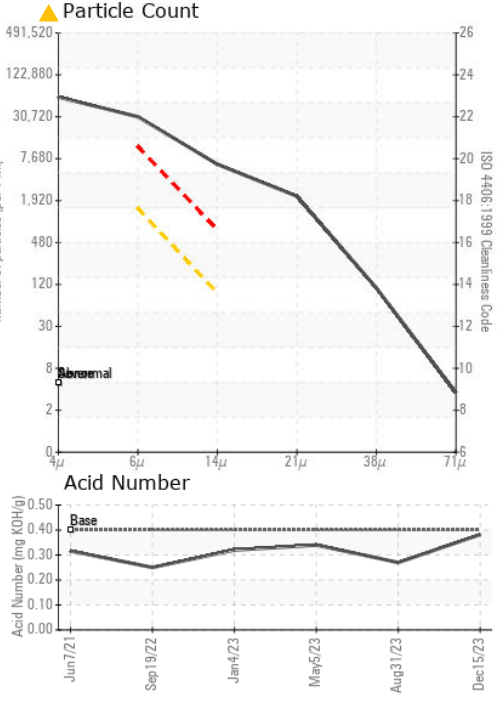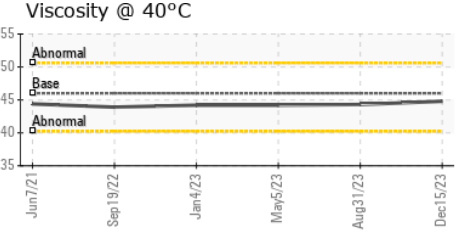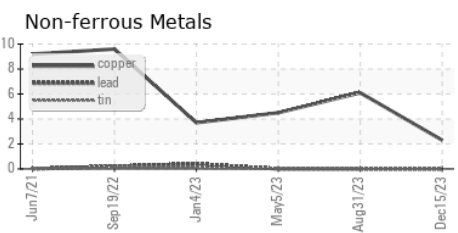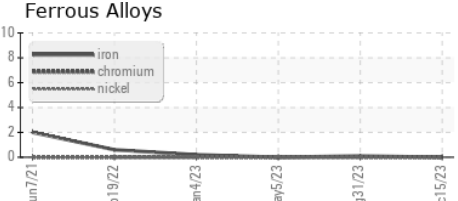

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC06062736 **Received** : 17 Jan 2024
Lab Number : 06062736 **Diagnosed** : 19 Jan 2024
Unique Number : 10834118 **Diagnostician** : Doug Bogart
Test Package : IND 2

CONDITIONED AIR SYSTEMS
 2410 HILTON WAY SW
 GAINESVILLE, GA
 US 30501
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: