


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

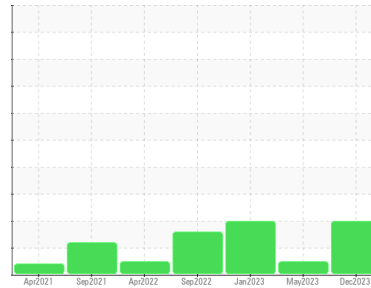

Machine Id  
**KAESER 7693902 (S/N 1554)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is a high amount of particulates present in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION**

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC06062739</b>	KC103792	KC05741509
Sample Date	Client Info	<b>22 Dec 2023</b>	19 May 2023	05 Jan 2023
Machine Age	hrs	<b>23494</b>	18556	15343
Oil Age	hrs	<b>0</b>	3215	0
Oil Changed	Client Info	<b>N/A</b>	Changed	N/A
Sample Status		<b>ABNORMAL</b>	NORMAL	ABNORMAL

**WEAR METALS**

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	2	4
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	1	2
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>4</b>	4	5
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

**ADDITIVES**

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>1</b>	0	1
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m 500	<b>87</b>	233	329
Zinc	ppm	ASTM D5185m	<b>48</b>	184	223

**CONTAMINANTS**

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	0
Water	%	ASTM D6304 >0.05	<b>0.002</b>	0.003	0.007
ppm Water	ppm	ASTM D6304 >500	<b>18</b>	32.6	76.4






**FLUID CLEANLINESS**

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>6835</b>	700	20161
Particles >6µm	ASTM D7647 >1300	<b>▲ 1944</b>	185	▲ 8720
Particles >14µm	ASTM D7647 >80	<b>▲ 173</b>	13	▲ 547
Particles >21µm	ASTM D7647 >20	<b>▲ 64</b>	3	▲ 114
Particles >38µm	ASTM D7647 >4	<b>▲ 5</b>	0	▲ 10
Particles >71µm	ASTM D7647 >3	<b>1</b>	0	1
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>▲ 20/18/15</b>	17/15/11	▲ 22/20/16

**FLUID DEGRADATION**

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.5	<b>0.50</b>	0.76	0.76

# OIL ANALYSIS REPORT

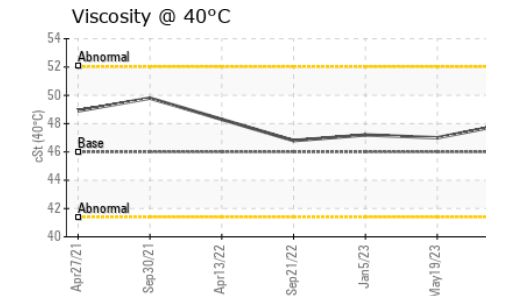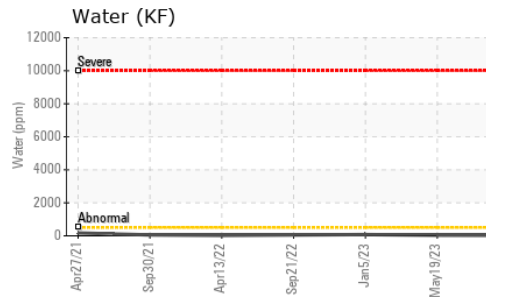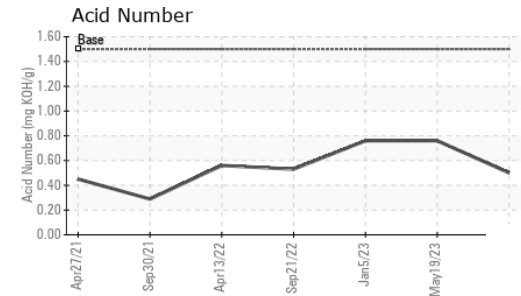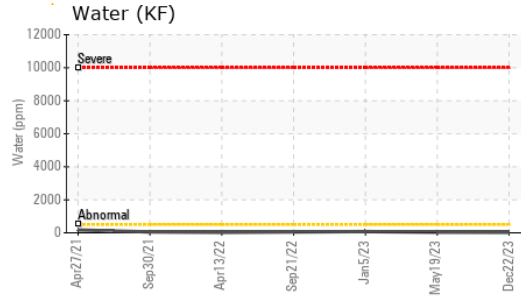
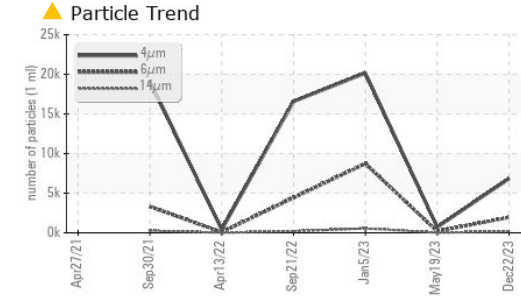


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	48.0	47.0	47.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

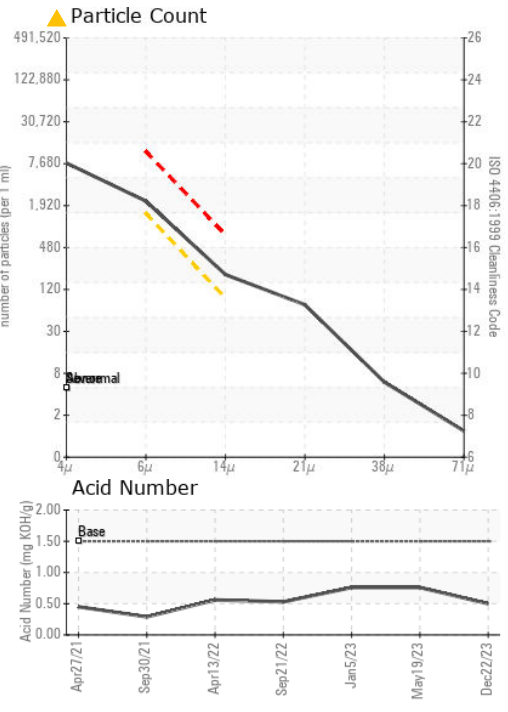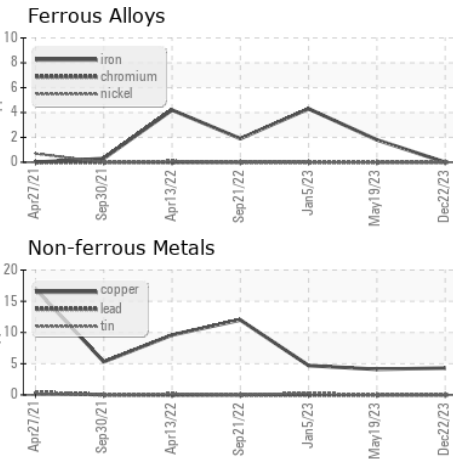

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC06062739 **Recieved** : 17 Jan 2024  
**Lab Number** : 06062739 **Diagnosed** : 19 Jan 2024  
**Unique Number** : 10834121 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**FIELDAL**  
 656 SHUFORD ST  
 LAVONIA, GA  
 US 30553  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)