




OIL ANALYSIS REPORT

Sample Rating Trend

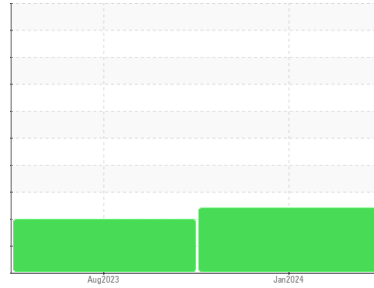

WATER



Machine Id
KAESER SX 7.5 8909795 (S/N 1436)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a light concentration of water present in the oil. There is a high amount of visible silt present in the sample.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC06062744	KC05933583	---
Sample Date	Client Info			02 Jan 2024	03 Aug 2023	---
Machine Age	hrs	Client Info		6129	2483	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			N/A	N/A	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	<1	0	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	11	<1	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m	90	1	12	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m	90	32	88	---
Calcium	ppm	ASTM D5185m	2	2	0	---
Phosphorus	ppm	ASTM D5185m		0	0	---
Zinc	ppm	ASTM D5185m		14	5	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	0	---
Sodium	ppm	ASTM D5185m		4	8	---
Potassium	ppm	ASTM D5185m	>20	<1	11	---
Water	%	ASTM D6304	>0.05	▲ 0.091	▲ 0.057	---
ppm Water	ppm	ASTM D6304	>500	▲ 910	▲ 578.8	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32	0.39	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	▲ HEAVY	NONE	---
Debris	scalar	*Visual	NONE	NONE	▲ MODER	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG	---
Free Water	scalar	*Visual		NEG	fact/location: ? ? -	NORGAIGA

OIL ANALYSIS REPORT

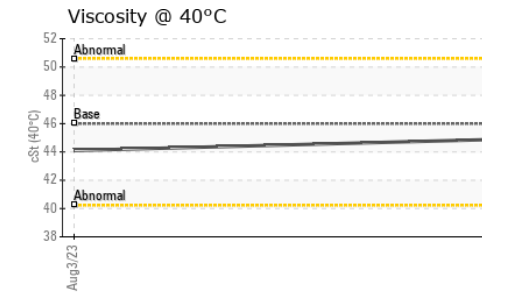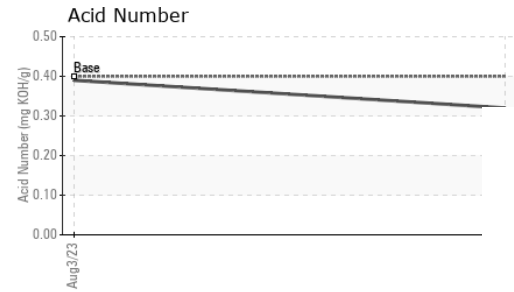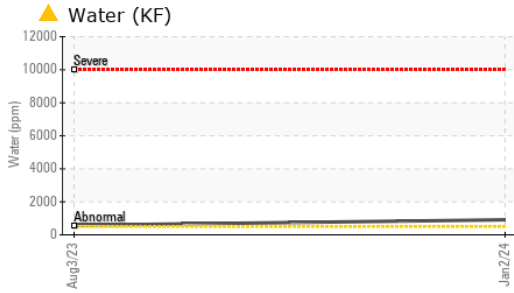





FLUID PROPERTIES

method	limit/base	current	history1	history2		
Visc @ 40°C	cSt	ASTM D445	46	44.9	44.1	---

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				no image
Bottom				no image

GRAPHS

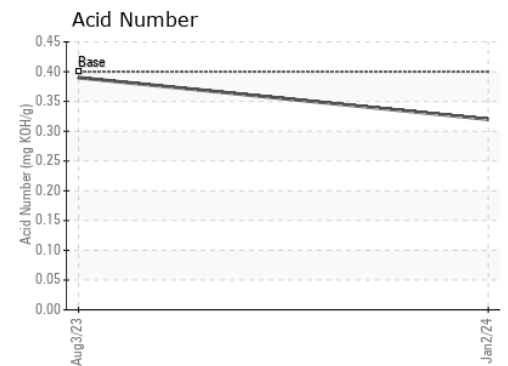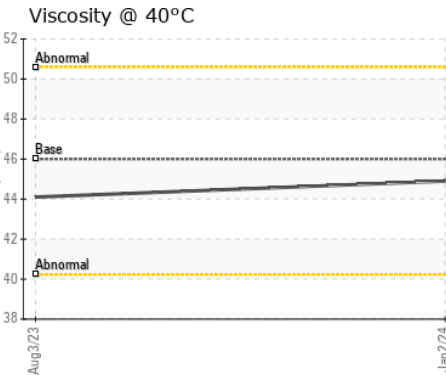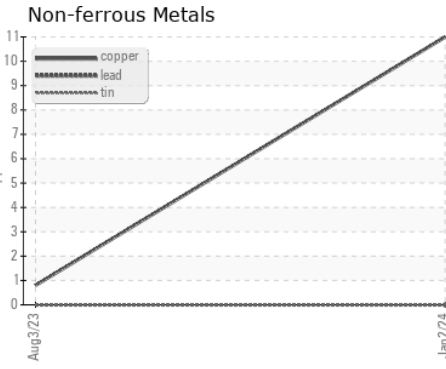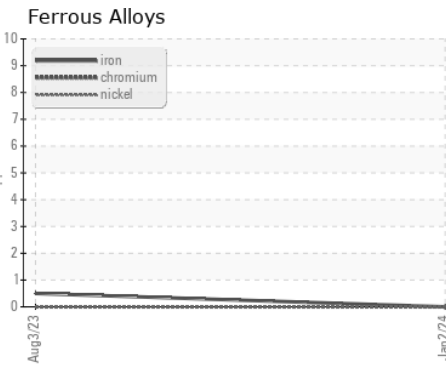

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC06062744 **Received** : 17 Jan 2024
Lab Number : 06062744 **Diagnosed** : 25 Jan 2024
Unique Number : 10834126 **Diagnostician** : Jonathan Hester
Test Package : IND 2

NORTH EAST GEORGIA MEDICAL CENTER
 743 SPRING ST NE
 GAINESVILLE, GA
 US 30501
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: