


OIL ANALYSIS REPORT

Sample Rating Trend

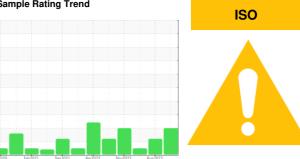

7176159 (S/N 1057)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jul2020	Feb 2021 Sep 2021	Apr2022 Nov2022 Ar	ug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06062746	KC72732	KC05792114
Sample Date		Client Info		03 Jan 2024	22 Aug 2023	02 Mar 2023
Machine Age	hrs	Client Info		28637	26260	23594
Oil Age	hrs	Client Info		0	6362	0
Oil Changed		Client Info		N/A	Changed	N/A
Sample Status				ABNORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	<1
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	11	10	8
Tin	ppm	ASTM D5185m	>10	0	<1	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	90	30	7	18
Calcium	ppm	ASTM D5185m	2	<1	0	0
Phosphorus	ppm	ASTM D5185m		0	1	1
Zinc	ppm	ASTM D5185m		57	41	64
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m		11	2	7
Potassium	ppm	ASTM D5185m	>20	<1	3	2
Water	%	ASTM D6304	>0.05	0.014	0.004	0.013
ppm Water	ppm	ASTM D6304	>500	140	48.4	134.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		48315	1401	1842
Particles >6µm		ASTM D7647	>1300	<u>^</u> 20693	580	526
Particles >14µm		ASTM D7647	>80	2290	▲ 109	72
Particles >21µm		ASTM D7647	>20	△ 503	4 2	25
Particles >38µm		ASTM D7647	>4	<u> </u>	4	2
Particles >71µm		ASTM D7647	>3	0	1	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	23/22/18	18/16/14	18/16/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.39	0.38	0.40



OIL ANALYSIS REPORT







Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

Test Package

: KC06062746 : 06062746

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Recieved : 10834128

Diagnosed : 24 Jan 2024 Diagnostician : Doug Bogart

: 17 Jan 2024

SELIT 112 SELIT DR COMMERCE, GA US 30309

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: