




# OIL ANALYSIS REPORT

Sample Rating Trend

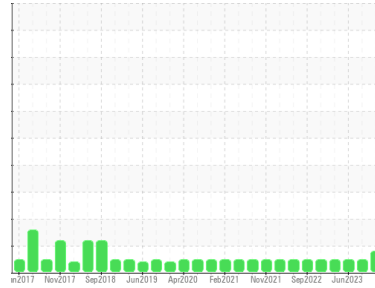

**SEDIMENT**



Machine Id  
**ATLAS COPCO AIR 2 (S/N 8972 4314 05)**  
 Component  
**Air Compressor**  
 Fluid  
**USPI MAX FG AIR 46 (--- QTS)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of visible silt present in the sample.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM300634</b>	USPM29828	USPM27232
Sample Date	Client Info		<b>09 Jan 2024</b>	26 Sep 2023	14 Jun 2023
Machine Age	hrs	Client Info	<b>4113</b>	3944	3883
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >4	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >40	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m >5	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	2
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 0	<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m 0	<b>0</b>	1	<1
Zinc	ppm	ASTM D5185m 0	<b>2</b>	0	0
Sulfur	ppm	ASTM D5185m 0	<b>0</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	<1
Water	%	ASTM D6304 >0.6	<b>0.003</b>	0.006	0.008
ppm Water	ppm	ASTM D6304 >6000	<b>39</b>	60.6	85.0

## FLUID CLEANLINESS




	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>---</b>	120	60
Particles >6µm	ASTM D7647	>2500	<b>---</b>	48	24
Particles >14µm	ASTM D7647	>320	<b>---</b>	12	7
Particles >21µm	ASTM D7647	>80	<b>---</b>	5	2
Particles >38µm	ASTM D7647	>20	<b>---</b>	1	0
Particles >71µm	ASTM D7647	>4	<b>---</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>18/15	<b>---</b>	13/11	12/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.16	<b>0.082</b>	0.094	0.046




# OIL ANALYSIS REPORT

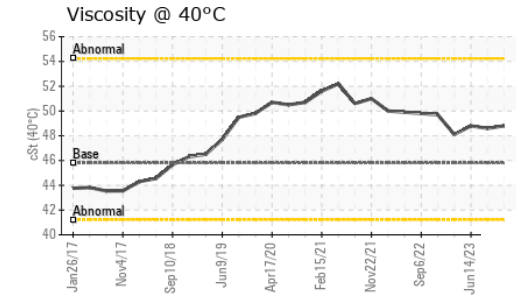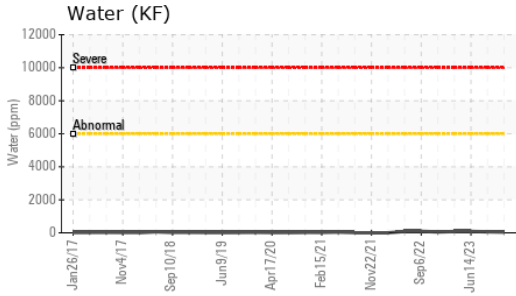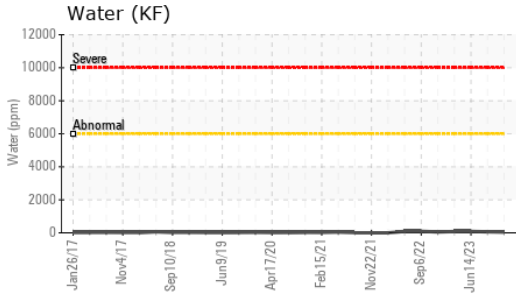





PARAMETER	VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	▲ MODER	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

PARAMETER	method	limit/base	current	history1	history2
FLUID PROPERTIES					
Visc @ 40°C	cSt	ASTM D445	45.8	48.8	48.6

PARAMETER	method	limit/base	current	history1	history2
SAMPLE IMAGES					

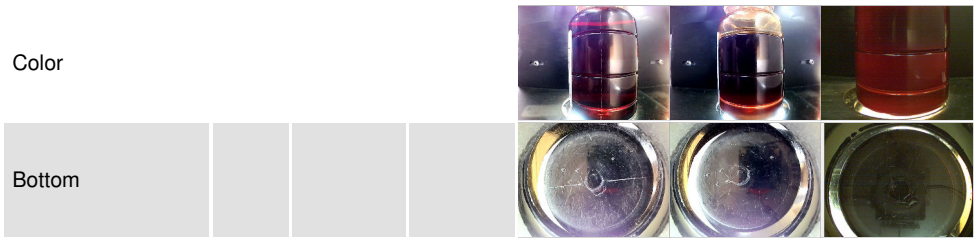

## GRAPHS

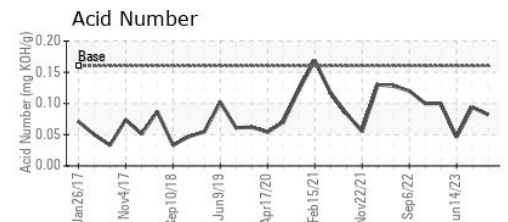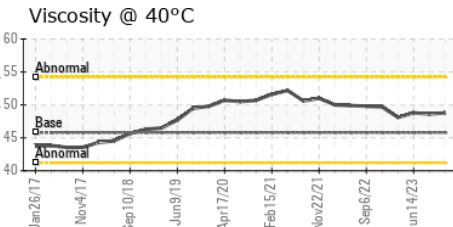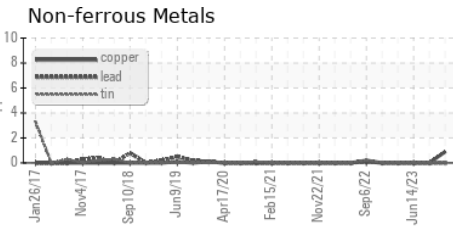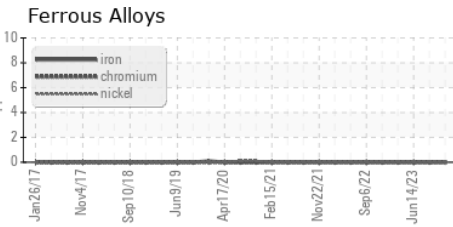

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM300634 **Recieved** : 17 Jan 2024  
**Lab Number** : 06062754 **Diagnosed** : 19 Jan 2024  
**Unique Number** : 10834136 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**TYSON-COUNCIL BLUFFS-USP**  
 COUNCIL BLUFFS, IA  
 US  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: