OIL ANALYSIS REPORT

Sample Rating Trend

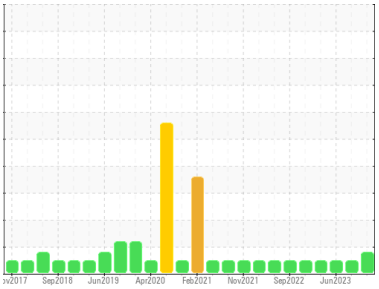

SEDIMENT

Machine Id
SULLAIR 4 SULLAIR (S/N 201612130019)
Component
Air Compressor
Fluid
USPI MAX FG AIR 46 (--- QTS)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of visible silt present in the sample.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**USPM30631**	USPM29827	USPM27234
Sample Date		Client Info		**16 Jan 2024**	02 Oct 2023	14 Jun 2023
Machine Age	hrs	Client Info		**0**	0	41904
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	0	0
Chromium	ppm	ASTM D5185m	>4	**0**	0	0
Nickel	ppm	ASTM D5185m	>4	**0**	0	0
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>10	**0**	1	0
Lead	ppm	ASTM D5185m	>20	**0**	0	0
Copper	ppm	ASTM D5185m	>40	**<1**	0	0
Tin	ppm	ASTM D5185m	>5	**0**	0	0
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	**0**	0	0
Barium	ppm	ASTM D5185m	0	**0**	0	2
Molybdenum	ppm	ASTM D5185m	0	**0**	0	0
Manganese	ppm	ASTM D5185m		**<1**	0	0
Magnesium	ppm	ASTM D5185m	0	**<1**	0	0
Calcium	ppm	ASTM D5185m	0	**<1**	0	0
Phosphorus	ppm	ASTM D5185m	0	**0**	1	4
Zinc	ppm	ASTM D5185m	0	**2**	0	0
Sulfur	ppm	ASTM D5185m	0	**0**	0	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**0**	0	0
Sodium	ppm	ASTM D5185m		**0**	0	0
Potassium	ppm	ASTM D5185m	>20	**0**	<1	<1
Water	%	ASTM D6304	>0.6	**0.005**	0.006	0.008
ppm Water	ppm	ASTM D6304	>6000	**57**	69.8	81.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		**---**	121	97
Particles >6µm		ASTM D7647	>2500	**---**	40	33
Particles >14µm		ASTM D7647	>320	**---**	9	7
Particles >21µm		ASTM D7647	>80	**---**	2	3
Particles >38µm		ASTM D7647	>20	**---**	0	0
Particles >71µm		ASTM D7647	>4	**---**	0	0
Oil Cleanliness		ISO 4406 (c)	>--/18/15	**---**	14/12/10	14/12/10

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.16	**0.28**	0.23	0.19

OIL ANALYSIS REPORT

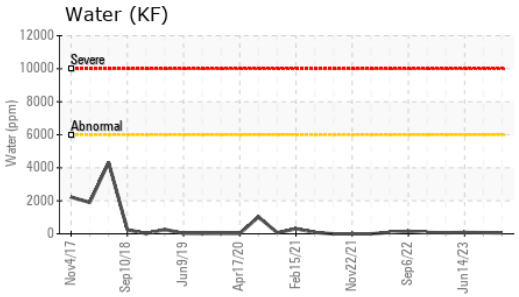

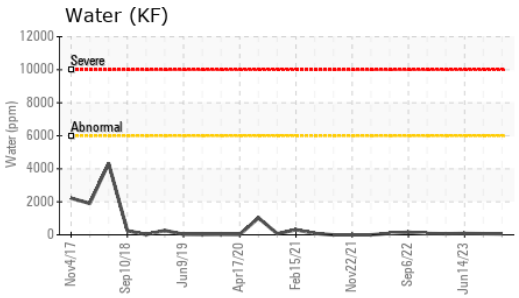

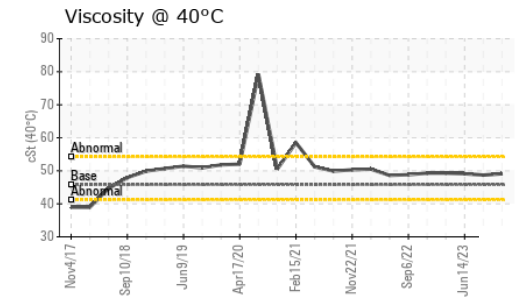

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	▲ **MODER**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.8	**49.1**	48.7	49.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom			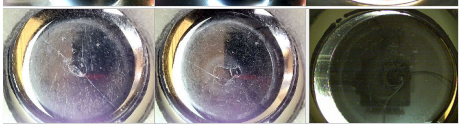		

GRAPHS

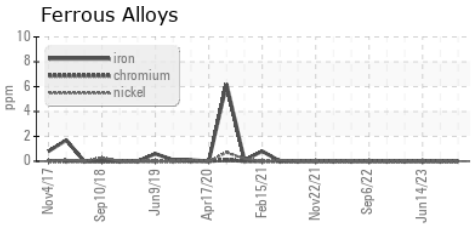

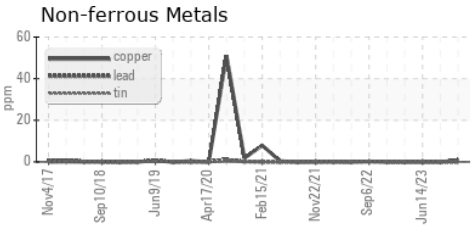

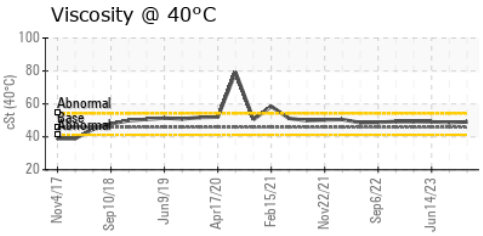

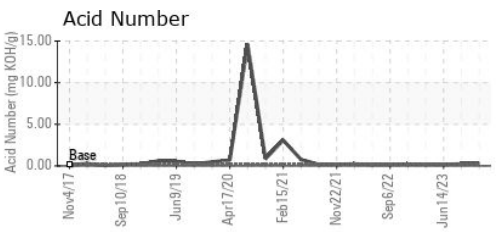

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USPM30631
Lab Number : 06062757
Unique Number : 10834139
Test Package : IND 2

Recieved : 17 Jan 2024
Diagnosed : 19 Jan 2024
Diagnostician : Doug Bogart

TYSON-COUNCIL BLUFFS-USP
COUNCIL BLUFFS, IA
US
Contact: SERVICE MANAGER
T:
F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)