



# OIL ANALYSIS REPORT

Sample Rating Trend


**NORMAL**



Machine Id  
**CP2 C-21 (S/N 10242H28981638)**

Component  
**Refrigeration Compressor**

Fluid  
**FRICK COMPRESSOR OIL #9 (--- GAL)**

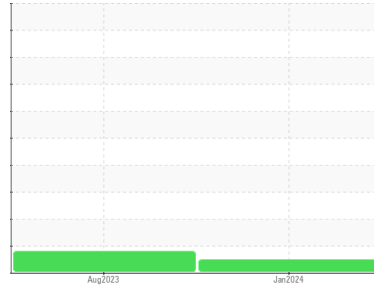

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0004765</b>	USP0000468	---
Sample Date	Client Info		<b>16 Jan 2024</b>	24 Aug 2023	---
Machine Age	hrs	Client Info	<b>0</b>	0	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>N/A</b>	N/A	---
Sample Status			<b>NORMAL</b>	ATTENTION	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	---
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >8	<b>&lt;1</b>	0	---
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	---
Zinc	ppm	ASTM D5185m	<b>2</b>	0	---
Sulfur	ppm	ASTM D5185m	<b>0</b>	0	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	0	---
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	---
Water	%	ASTM D6304 >0.01	<b>0.001</b>	0.001	---
ppm Water	ppm	ASTM D6304 >100	<b>11</b>	0.00	---

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>760</b>	▲ 14942	---
Particles >6µm	ASTM D7647	>2500	<b>185</b>	1813	---
Particles >14µm	ASTM D7647	>320	<b>23</b>	75	---
Particles >21µm	ASTM D7647	>80	<b>9</b>	13	---
Particles >38µm	ASTM D7647	>20	<b>0</b>	0	---
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>17/15/12</b>	▲ 21/18/13	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.014</b>	0.014	---




# OIL ANALYSIS REPORT

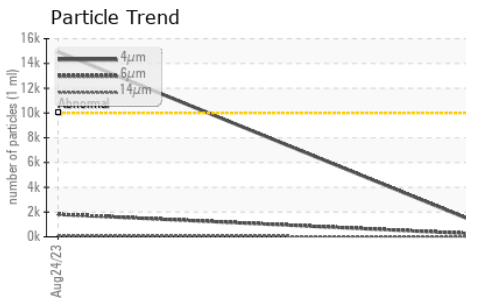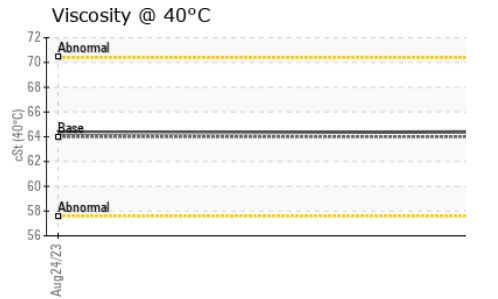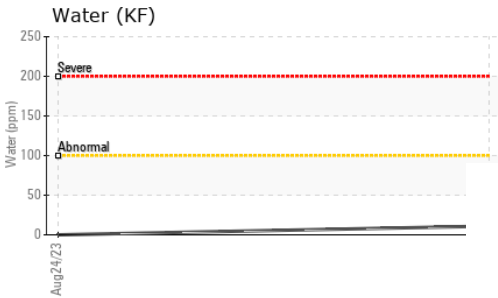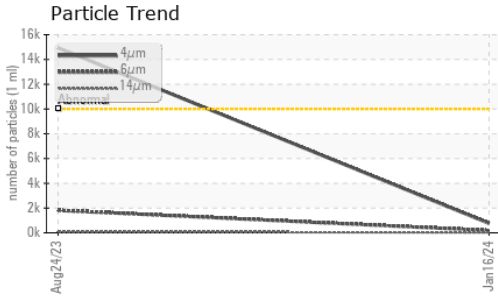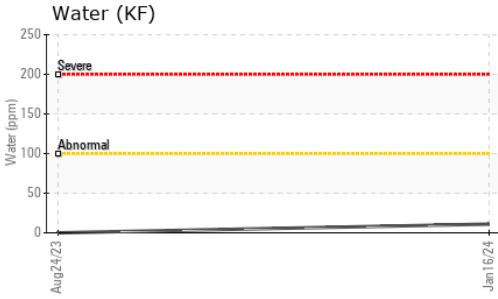





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	64.0	64.4	64.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

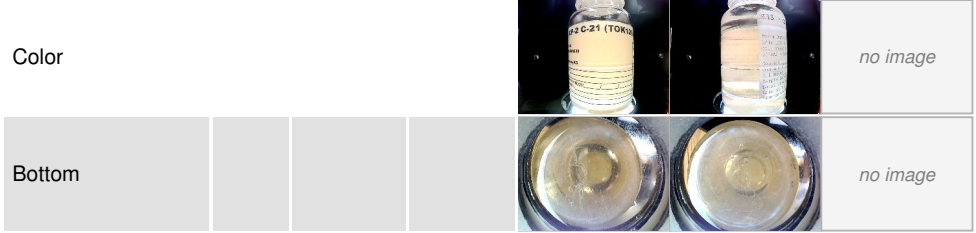

## GRAPHS

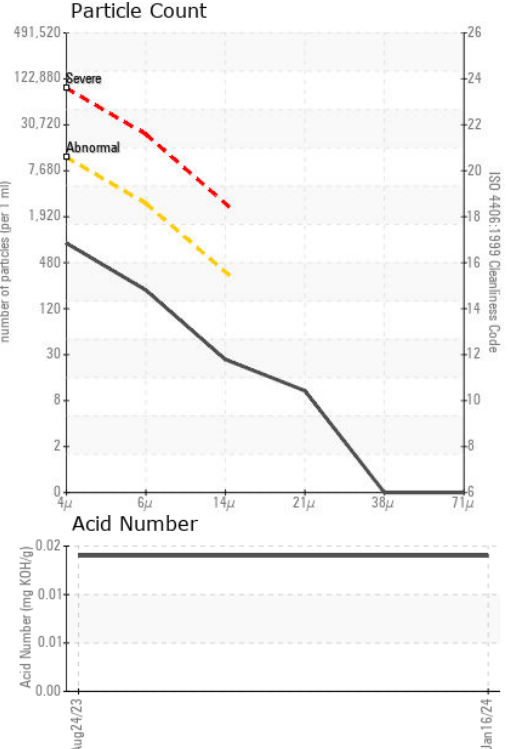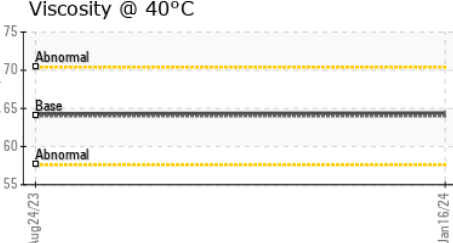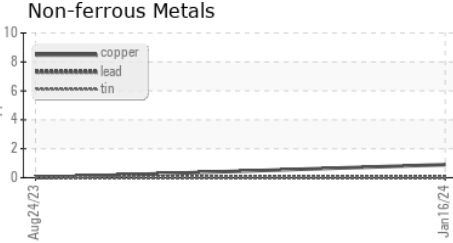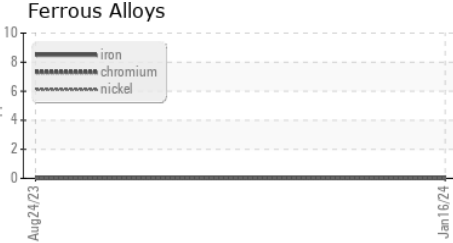

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USP0004765      **Received** : 17 Jan 2024  
 Lab Number : **06062836**      **Diagnosed** : 19 Jan 2024  
 Unique Number : 10834218      **Diagnostician** : Doug Bogart  
 Test Package : IND 2

**THE SCHWAN FOOD CO**  
 3019 SCANLAN AVE  
 SALINA, KS  
 US 67401  
 Contact: RICK DUVAL

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: