




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

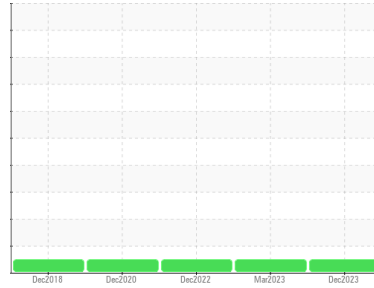

Machine Id  
**DAIKIN WSC COLLEGIATE (S/N STNU130100017)**

Component  
**Refrigeration Compressor**

Fluid  
**REFRIG COMP OIL ISO 32 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0632017</b>	WC0631907	WC0631982
Sample Date	Client Info			<b>28 Dec 2023</b>	13 Mar 2023	27 Dec 2022
Machine Age	hrs	Client Info		<b>0</b>	240	0
Oil Age	hrs	Client Info		<b>0</b>	240	0
Oil Changed	Client Info			<b>N/A</b>	Not Chngd	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	<b>0</b>	3	3
Chromium	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>50	<b>1</b>	1	0
Lead	ppm	ASTM D5185m	>2	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m	>100	<b>1</b>	3	2
Tin	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	5	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	5	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	5	<b>&lt;1</b>	<1	<1
Calcium	ppm	ASTM D5185m	12	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m	12	<b>1</b>	<1	1
Zinc	ppm	ASTM D5185m	12	<b>8</b>	3	7
Sulfur	ppm	ASTM D5185m	1000	<b>85</b>	108	77

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>29</b>	33	32
Sodium	ppm	ASTM D5185m		<b>0</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	1
Water	%	ASTM D6304	>0.02	<b>0.007</b>	0.002	0.002
ppm Water	ppm	ASTM D6304	>250	<b>71</b>	24.6	23.7

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.10	<b>0.014</b>	0.044	0.047




# OIL ANALYSIS REPORT

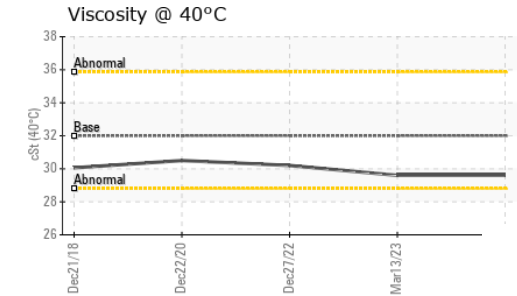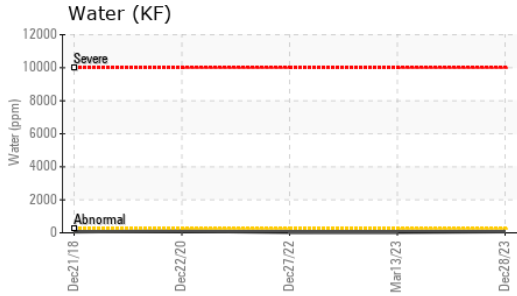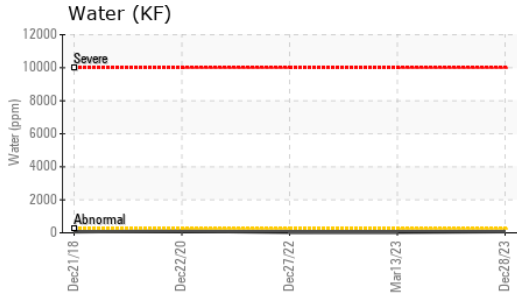





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.02	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 32	<b>29.6</b>	29.6	30.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

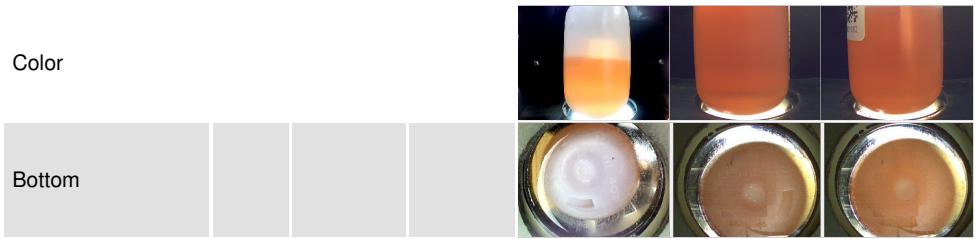

## GRAPHS

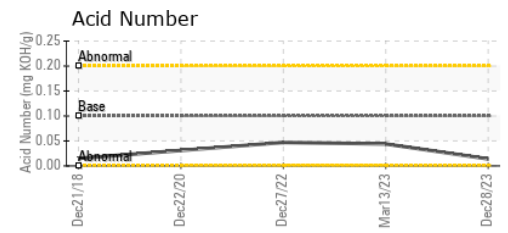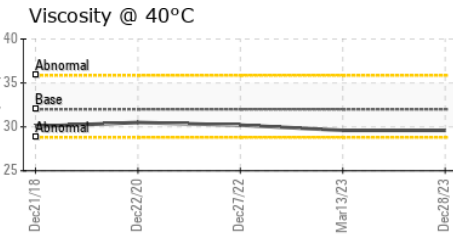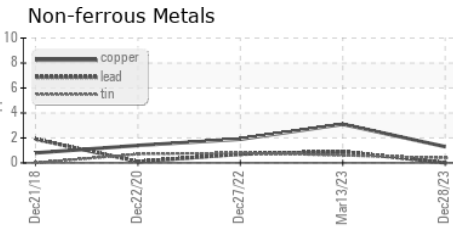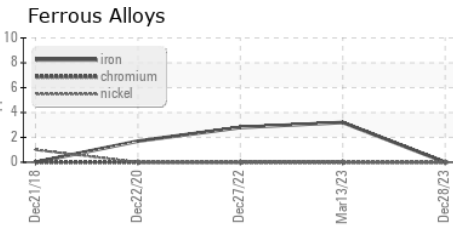

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0632017 **Recieved** : 17 Jan 2024  
**Lab Number** : **06062867** **Diagnosed** : 19 Jan 2024  
**Unique Number** : 10834249 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**DAIKIN APPLIED-RICHMOND**  
 3524 MAYLAND CT  
 RICHMOND, VA  
 US 23233  
 Contact: GANIS HEISLER  
 ganis.heisler@daikin.com  
 T: (804)747-4822  
 F: (804)747-6686

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)