


OIL ANALYSIS REPORT

Sample Rating Trend







VRU 3 PUMP 1

Non-Drive End Screw Compressor

ROYAL PURPLE SYNFILM GT 100 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

▲ Fluid Condition

The oil viscosity is lower than normal. Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid.

L)			Feb 2023	Oct2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		RP0033224	RP0028286	
Sample Date		Client Info		30 Oct 2023	16 Feb 2023	-
Machine Age	mths	Client Info		0	0	_
Oil Age	mths	Client Info		0	0	_
Oil Changed		Client Info		N/A	N/A	
Sample Status				ATTENTION	NORMAL	-
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>60	0	0	
Chromium	ppm	ASTM D5185m	>4	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	<1	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>5	0	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>30	0	0	
Tin	ppm	ASTM D5185m	>15	0	0	
Vanadium	ppm	ASTM D5185m		0	<1	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		0	<1	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	4	85	
Calcium	ppm	ASTM D5185m		2	0	
Phosphorus	ppm	ASTM D5185m	35	402	2	
Zinc	ppm	ASTM D5185m		0	3	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	35	3	
Sodium	ppm	ASTM D5185m		0	<1	
Potassium	ppm	ASTM D5185m	>20	0	<1	
Water	%	ASTM D6304	>0.1	0.003	0.024	
ppm Water	ppm	ASTM D6304	>1000	36	249.2	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.388	0.271	0.42	
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	


tionNEOGAN SEYL -- MAGHOU

NEG

scalar *Visual



OIL ANALYSIS REPORT

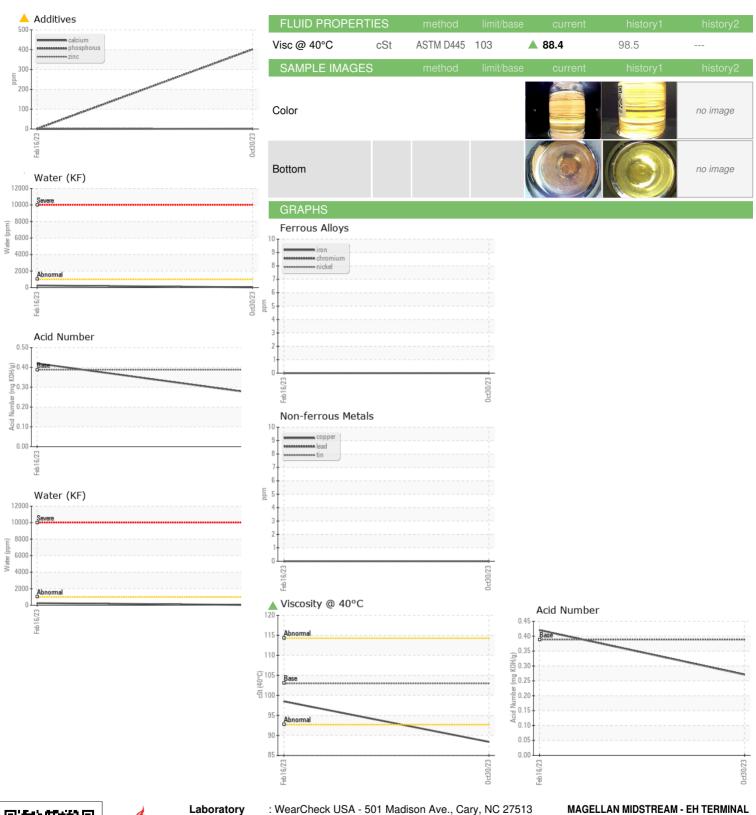



Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: RP0033224 : 06062896 : 10834278 Test Package : IND 2

Recieved : 17 Jan 2024 : 19 Jan 2024 Diagnosed Diagnostician : Don Baldridge **MAGELLAN MIDSTREAM - EH TERMINAL** 7901 WALLISVILLE RD HOUSTON, TX US 77029

Contact: LOGAN SEYL logan.seyl@magellanlp.com T:

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: