




# OIL ANALYSIS REPORT

Sample Rating Trend

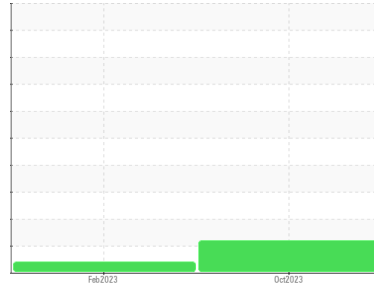

VISCOSITY



Machine Id  
**VRU 3 PUMP 2**

Component  
**Drive End Screw Compressor**

Fluid  
**ROYAL PURPLE SYNFILM GT 100 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### ▲ Fluid Condition

The oil viscosity is lower than normal. Additive levels indicate the addition of a different brand, or type of oil. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0033227</b>	RP0028285	---
Sample Date	Client Info		<b>30 Oct 2023</b>	16 Feb 2023	---
Machine Age	mths	Client Info	<b>0</b>	0	---
Oil Age	mths	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>N/A</b>	N/A	---
Sample Status			<b>ATTENTION</b>	ABNORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >60	<b>0</b>	2	---
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	---
Silver	ppm	ASTM D5185m	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >5	<b>0</b>	1	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >30	<b>0</b>	0	---
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	---
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m 90	<b>▲ &lt;1</b>	80	---
Calcium	ppm	ASTM D5185m	<b>1</b>	3	---
Phosphorus	ppm	ASTM D5185m 35	<b>▲ 393</b>	4	---
Zinc	ppm	ASTM D5185m	<b>0</b>	6	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>6</b>	2	---
Sodium	ppm	ASTM D5185m	<b>0</b>	2	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	---
Water	%	ASTM D6304 >0.1	<b>0.00</b>	0.023	---
ppm Water	ppm	ASTM D6304 >1000	<b>0</b>	232.0	---





## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.388	<b>0.23</b>	0.40	---

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual NONE	<b>NONE</b>	<b>▲ MODER</b>	---
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual >0.1	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual	<b>NEG</b>	NEG	---





# OIL ANALYSIS REPORT

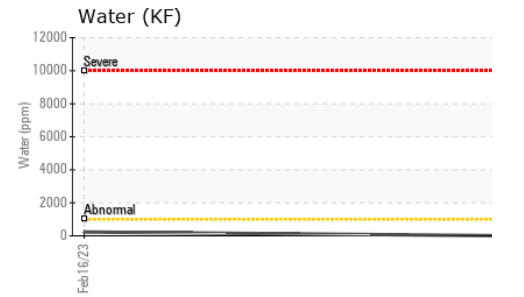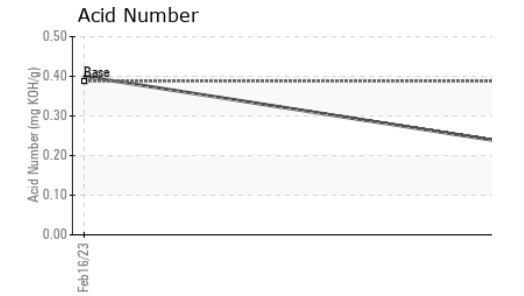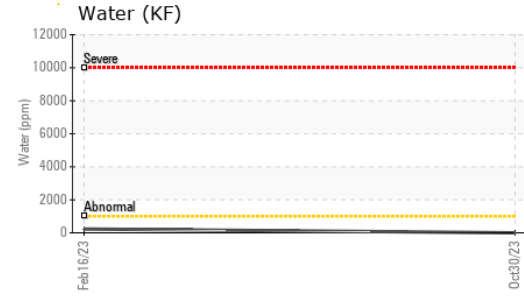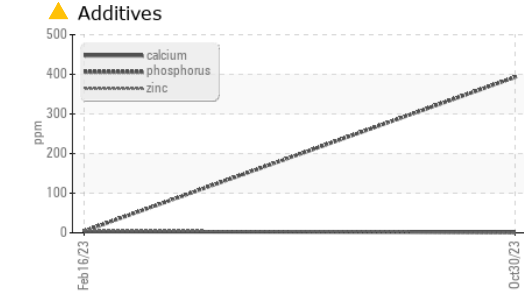

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 103	▲ 68.0	101	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					no image
Bottom					no image

## GRAPHS

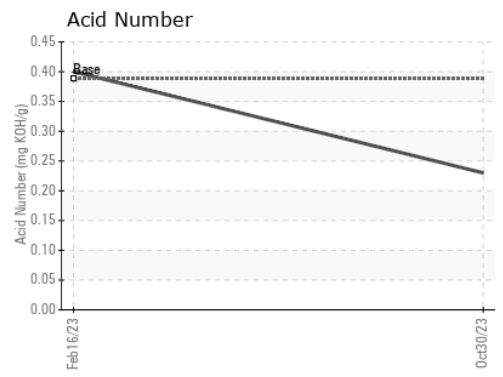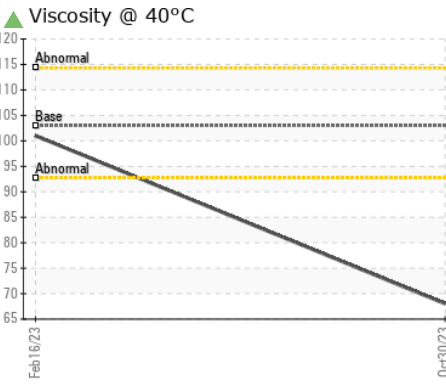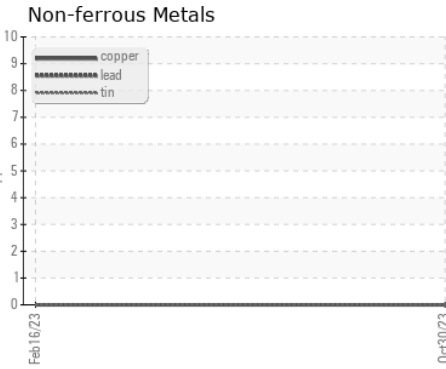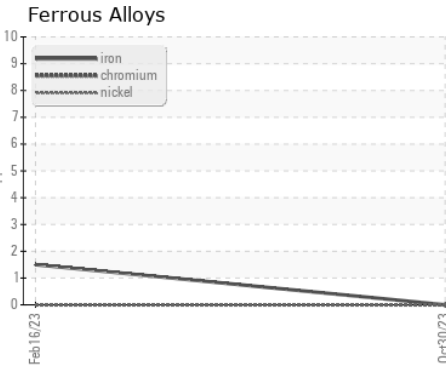

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0033227 **Received** : 17 Jan 2024  
**Lab Number** : 06062897 **Diagnosed** : 19 Jan 2024  
**Unique Number** : 10834279 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**MAGELLAN MIDSTREAM - EH TERMINAL**  
 7901 WALLISVILLE RD  
 HOUSTON, TX  
 US 77029  
 Contact: LOGAN SEYL  
 logan.seyl@magellanlp.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: