


OIL ANALYSIS REPORT

Sample Rating Trend



VIS DEBRIS

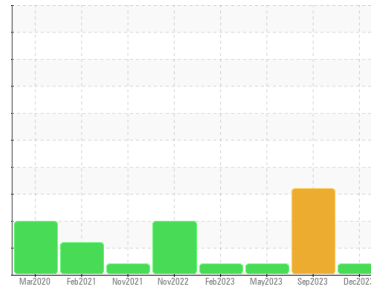

Machine Id
6665019 (S/N 1037)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

▲ Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC124459	KC124458	KC102294
Sample Date	Client Info		01 Dec 2023	12 Sep 2023	08 May 2023
Machine Age	hrs	Client Info	12876	12237	10990
Oil Age	hrs	Client Info	0	0	1301
Oil Changed	Client Info		N/A	N/A	Not Changd
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	0	<1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	2	3	4
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	10	11	10
Tin	ppm	ASTM D5185m >10	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	3	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 90	0	2	11
Calcium	ppm	ASTM D5185m 2	<1	0	0
Phosphorus	ppm	ASTM D5185m	47	2	3
Zinc	ppm	ASTM D5185m	20	30	58

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	<1	0
Sodium	ppm	ASTM D5185m	0	2	21
Potassium	ppm	ASTM D5185m >20	3	0	6
Water	%	ASTM D6304 >0.05	0.005	▲ 0.201	0.014
ppm Water	ppm	ASTM D6304 >500	59	▲ 2010	148.1




FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		---	2297	---
Particles >6µm	ASTM D7647	>1300	---	1251	---
Particles >14µm	ASTM D7647	>80	---	▲ 213	---
Particles >21µm	ASTM D7647	>20	---	▲ 72	---
Particles >38µm	ASTM D7647	>4	---	▲ 11	---
Particles >71µm	ASTM D7647	>3	---	1	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	---	▲ 18/17/15	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.31	0.29	0.35


OIL ANALYSIS REPORT

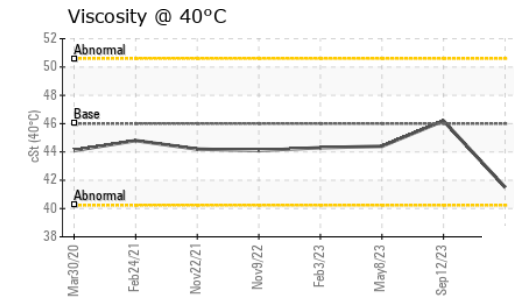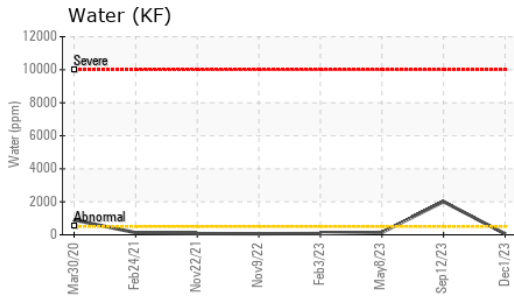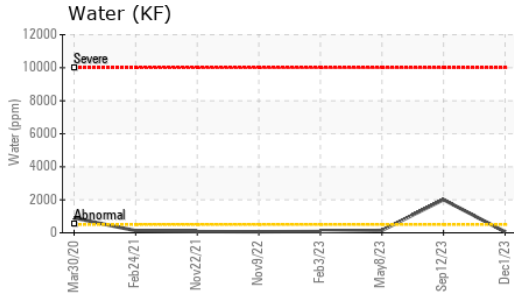





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	41.5	46.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

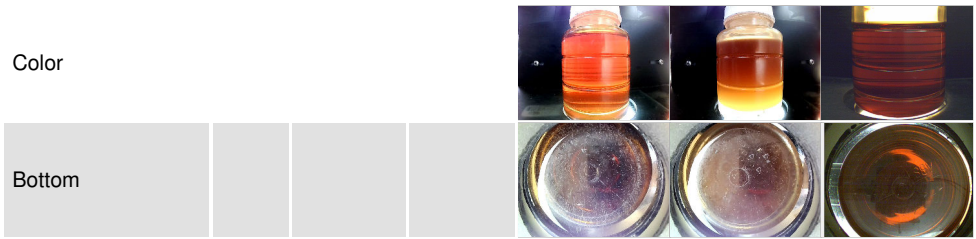

GRAPHS

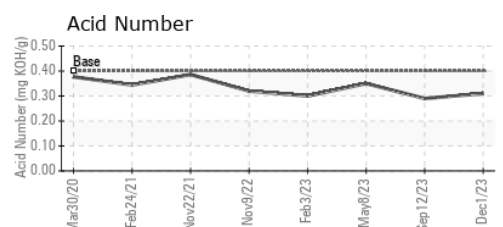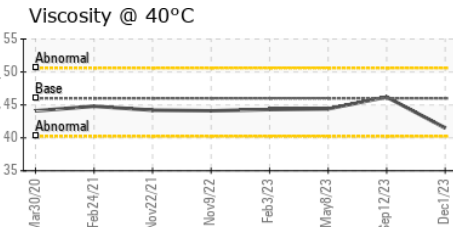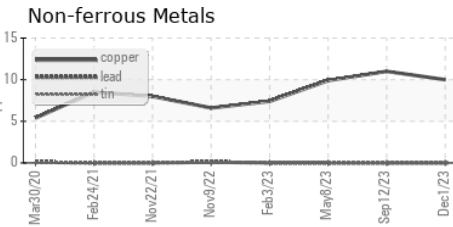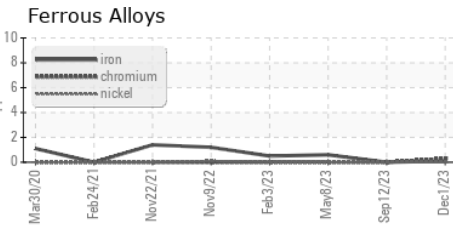

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC124459 **Recieved** : 17 Jan 2024
Lab Number : 06063579 **Diagnosed** : 19 Jan 2024
Unique Number : 10834961 **Diagnostician** : Don Baldrige
Test Package : IND 2

SPARTAN COMPOSITES
 135 GUS HIPP BLVD
 ROCKLEDGE, FL
 US 32955
 Contact: CHRISTINE BARNHART

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: