


OIL ANALYSIS REPORT



Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

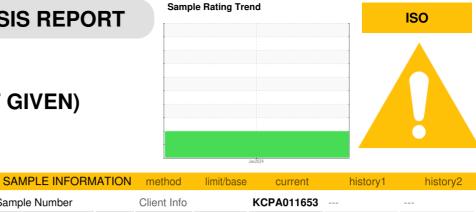



		methou	iiiiii/base	Current	history i	Thistory Z
Sample Number		Client Info		KCPA011653		
Sample Date		Client Info		05 Jan 2024		
Machine Age	hrs	Client Info		20311		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
		and the state	11		In the term of the	h la ha ma O
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	23		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm ppm	ASTM D5185m	90	3		
Molybdenum		ASTM D5185m	0	0		
•	ppm		0	0		
Manganese	ppm	ASTM D5185m	100	13		
Magnesium Calcium	ppm	ASTM D5185m ASTM D5185m	0	0		
	ppm		0	-		
Phosphorus	ppm	ASTM D5185m		46 72		
Zinc	ppm	ASTM D5185m				
Sulfur	ppm	ASTM D5185m	23500	21414		
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.05	0.012		
ppm Water	ppm	ASTM D6304	>500	124		
FLUID CLEANLIN	VESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		19104		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	667		
Particles >21µm		ASTM D7647		<u>^</u> 200		
Particles >38µm		ASTM D7647	>4	▲ 11		
Particles >71µm		ASTM D7647		0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	21/20/17		
FLUID DEGRAD		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.32		



OIL ANALYSIS REPORT

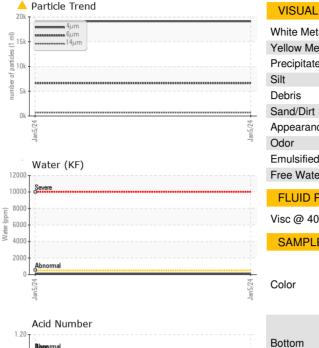

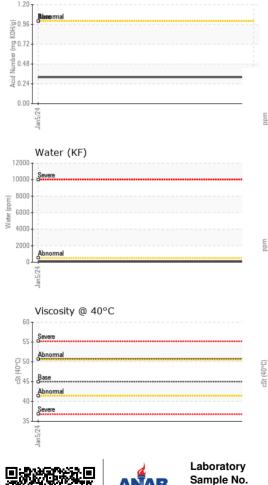

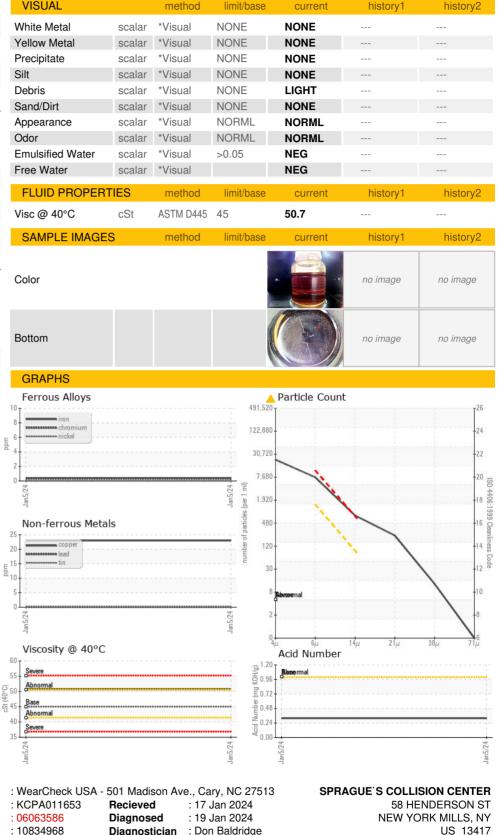

US 13417 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Test Package : IND 2 (Additional Tests: KF, PrtCount)

e Manager T: F:

Certificate L2367

Lab Number

Unique Number

Contact/Location: Service Manager - SPRNEW