

OIL ANALYSIS REPORT

Sample Rating Trend

ISO



KAESER 7463797

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Nov2022	Jan 2024		
0.44404 5 145004						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA008736	KCP47216D	
Sample Date		Client Info		08 Jan 2024	14 Nov 2022	
Machine Age	hrs	Client Info		7216	1217	
Oil Age	hrs	Client Info		0	1217	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	1	2	
Tin	ppm	ASTM D5185m	>10	- <1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES	PP	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	78	46	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	100	82	76	
Calcium	ppm	ASTM D5185m	0	5	3	
Phosphorus	ppm	ASTM D5185m	0	0	2	
Zinc	ppm	ASTM D5185m	0	0	3	
Sulfur	ppm	ASTM D5185m	23500	18995	21223	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	<1	
Sodium	ppm	ASTM D5185m		25	22	
Potassium	ppm	ASTM D5185m	>20	4	6	
Water	%	ASTM D6304	>0.05	0.020	0.020	
ppm Water	ppm	ASTM D6304	>500	205	204.0	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		12200	5923	
Particles >6µm		ASTM D7647	>1300	<u>2775</u>	879	
Particles >14μm		ASTM D7647	>80	154	49	
Particles >21µm		ASTM D7647	>20	A 36	14	
Particles >38μm		ASTM D7647	>4	1	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/19/14	20/17/13	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.47	0.32	



OIL ANALYSIS REPORT

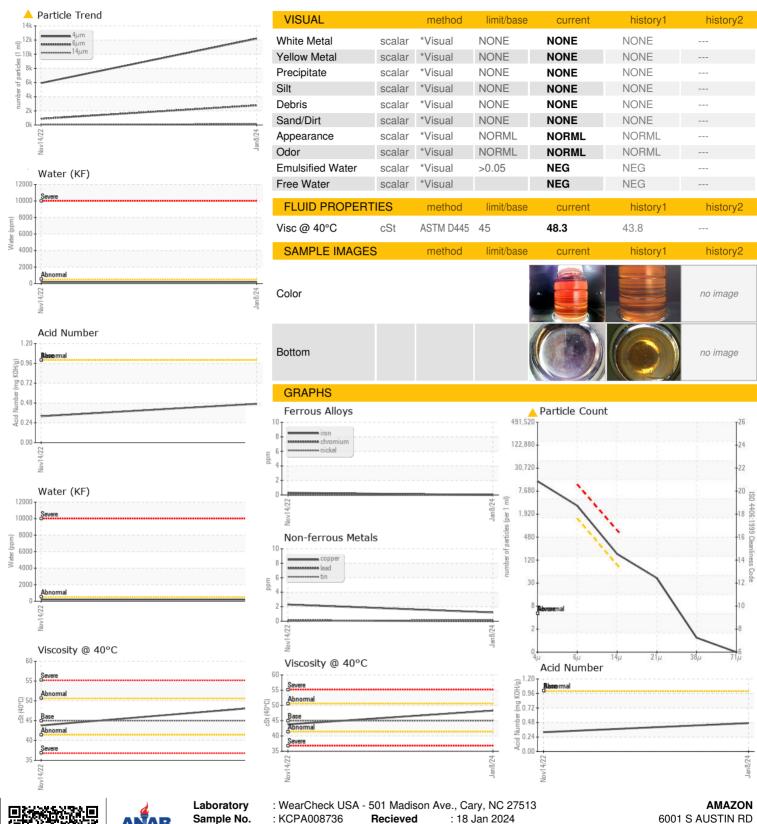



Certificate L2367

Sample No. Lab Number **Unique Number**

: KCPA008736 : 06064363

: 10835745

Recieved

Diagnosed

: 19 Jan 2024 Diagnostician : Doug Bogart

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

STOCKTON, CA US 95215

Contact: Service Manager

T:

F: