


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

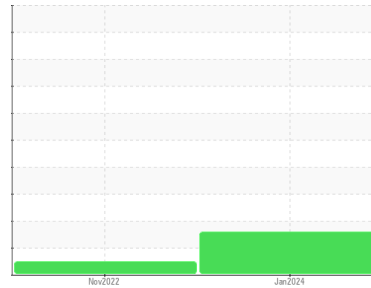

Machine Id
KAESER 7550717

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

▲ **Recommendation**

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ **Contamination**

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info		KCPA010283	KCP47162	---
Sample Date	Client Info		08 Jan 2024	14 Nov 2022	---
Machine Age	hrs	Client Info	1641	523	---
Oil Age	hrs	Client Info	0	523	---
Oil Changed		Client Info	N/A	Changed	---
Sample Status			ABNORMAL	NORMAL	---

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	0	0	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	<1	<1	---
Lead	ppm	ASTM D5185m	>10	<1	0	---
Copper	ppm	ASTM D5185m	>50	1	<1	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185m	0	0	0	---
Barium	ppm	ASTM D5185m	90	65	35	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m	100	90	80	---
Calcium	ppm	ASTM D5185m	0	5	3	---
Phosphorus	ppm	ASTM D5185m	0	0	2	---
Zinc	ppm	ASTM D5185m	0	0	<1	---
Sulfur	ppm	ASTM D5185m	23500	18820	21646	---

CONTAMINANTS method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	5	2	---
Sodium	ppm	ASTM D5185m		20	13	---
Potassium	ppm	ASTM D5185m	>20	4	7	---
Water	%	ASTM D6304	>0.05	0.025	0.018	---
ppm Water	ppm	ASTM D6304	>500	251	185.7	---






FLUID CLEANLINESS method limit/base current history1 history2

Particles >4µm		ASTM D7647		15665	5206	---
Particles >6µm		ASTM D7647	>1300	▲ 4533	760	---
Particles >14µm		ASTM D7647	>80	▲ 282	44	---
Particles >21µm		ASTM D7647	>20	▲ 59	14	---
Particles >38µm		ASTM D7647	>4	1	1	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/19/15	20/17/13	---

FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.43	0.32	---
------------------	----------	------------	-----	-------------	------	-----


OIL ANALYSIS REPORT

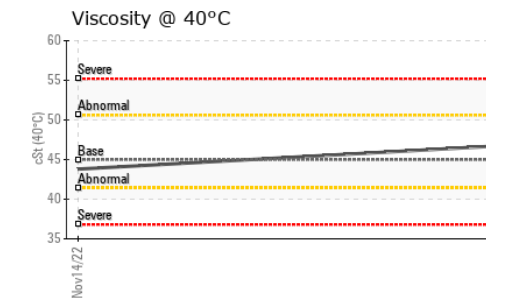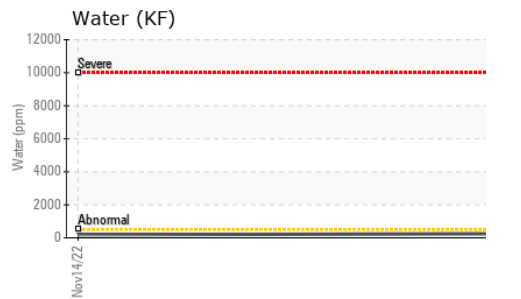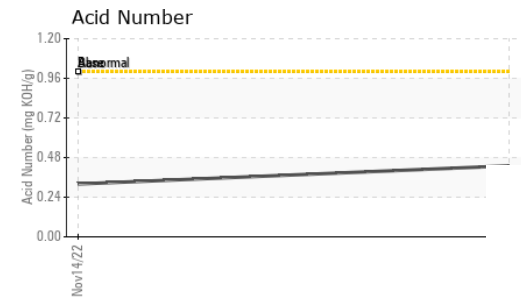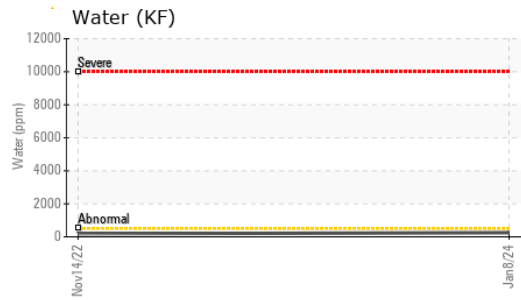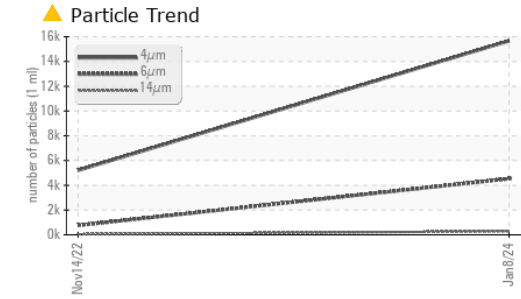





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.8	43.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

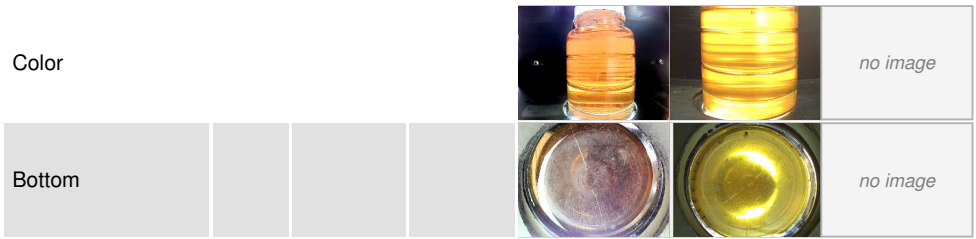

GRAPHS

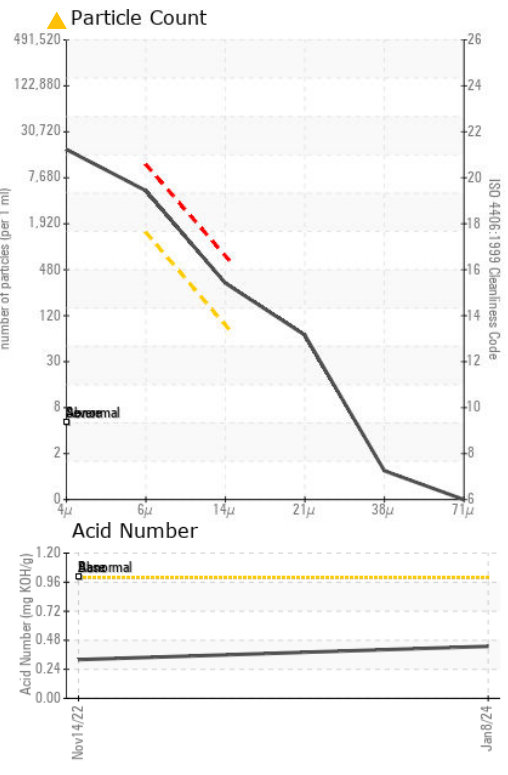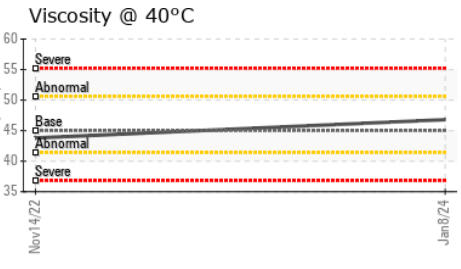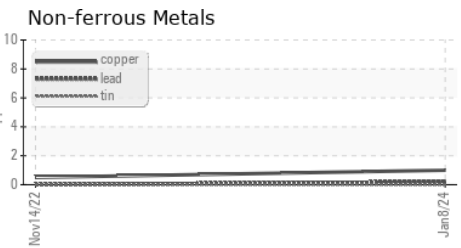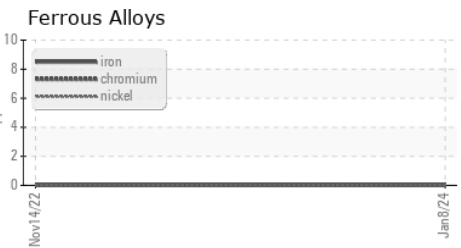

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA010283 **Recieved** : 18 Jan 2024
Lab Number : 06064364 **Diagnosed** : 19 Jan 2024
Unique Number : 10835746 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AMAZON
 6001 S AUSTIN RD
 STOCKTON, CA
 US 95215
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)