




# OIL ANALYSIS REPORT

Sample Rating Trend

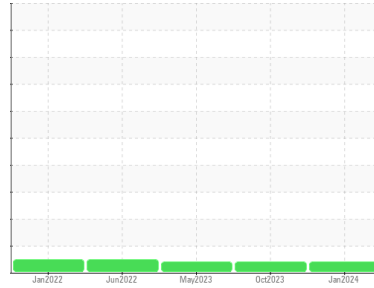

VISCOSITY



Machine Id  
**10 BUSCH L-4 STG-1 (S/N USM121420153)**

Component

**Pump**

Fluid

**USPI VAC 100 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### ▲ Fluid Condition

The oil viscosity is lower than normal. Confirmed. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM30681</b>	USPM29839	USPM28303
Sample Date	Client Info		<b>17 Jan 2024</b>	02 Oct 2023	25 May 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ATTENTION</b>	ATTENTION	ATTENTION

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	<b>0</b>	6	5
Chromium	ppm	ASTM D5185m >5	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >5	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >7	<b>0</b>	<1	2
Lead	ppm	ASTM D5185m >12	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >30	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m >9	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	2	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m 1800	<b>468</b>	643	656
Zinc	ppm	ASTM D5185m 0	<b>0</b>	1	0
Sulfur	ppm	ASTM D5185m 0	<b>69</b>	276	48

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	<b>22</b>	33	14
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	2
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	1	<1
Water	%	ASTM D6304 >.1	<b>0.009</b>	0.021	0.026
ppm Water	ppm	ASTM D6304 >1000	<b>91</b>	215.6	267.2

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>265</b>	184	347
Particles >6µm	ASTM D7647	>1300	<b>75</b>	45	80
Particles >14µm	ASTM D7647	>160	<b>8</b>	7	8
Particles >21µm	ASTM D7647	>40	<b>3</b>	3	3
Particles >38µm	ASTM D7647	>10	<b>1</b>	1	0
Particles >71µm	ASTM D7647	>3	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>15/13/10</b>	15/13/10	16/13/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>0.087</b>	0.172	0.04




# OIL ANALYSIS REPORT

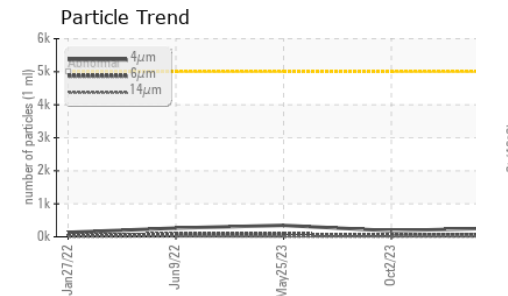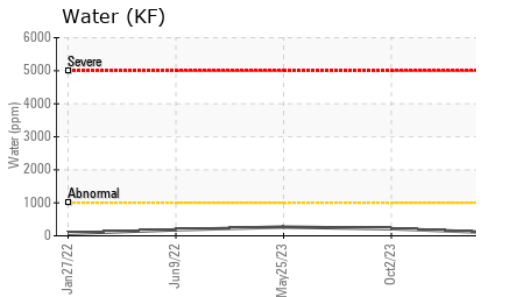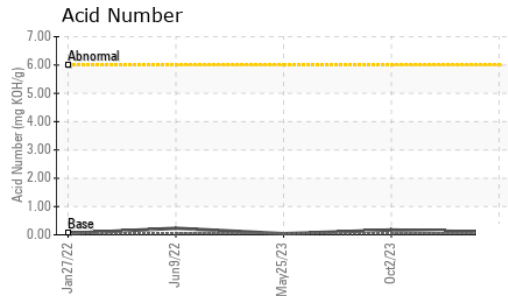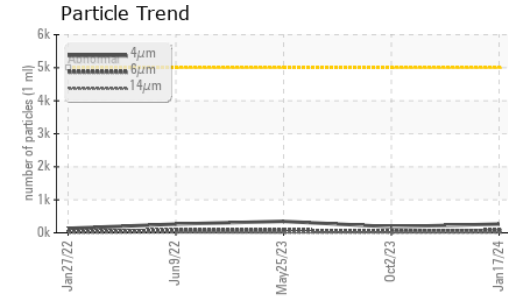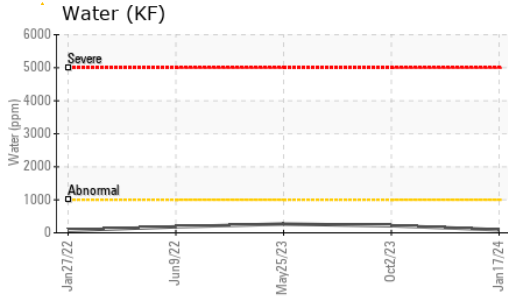






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	▲ 46.5	▲ 55.71	▲ 65.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

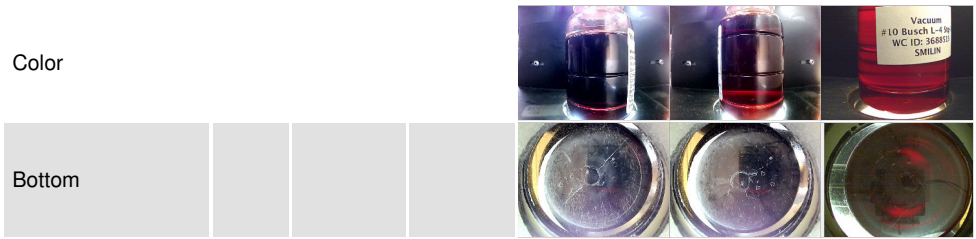

## GRAPHS

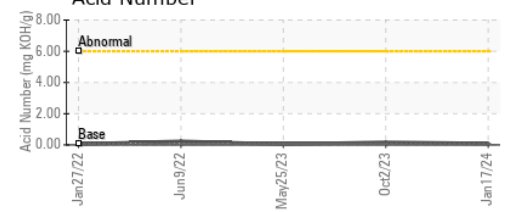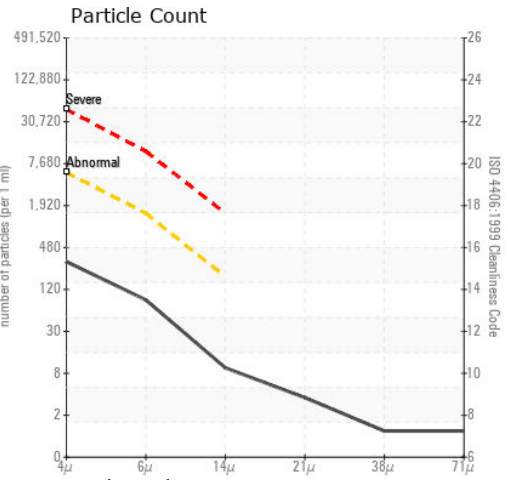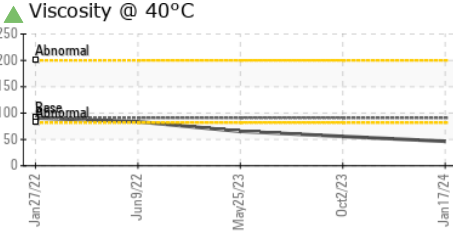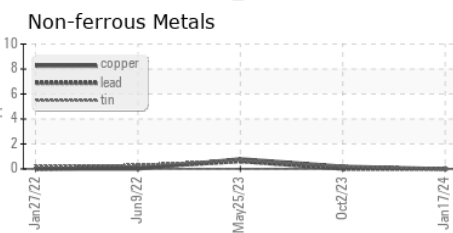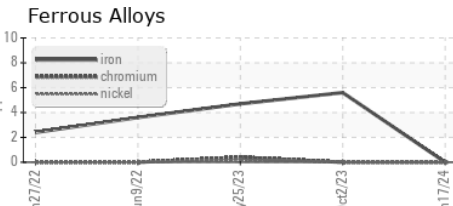

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USPM30681 Recieved : 18 Jan 2024  
 Lab Number : 06064394 Diagnosed : 25 Jan 2024  
 Unique Number : 10835776 Diagnostician : Doug Bogart  
 Test Package : IND 2

SMITHFIELD - LINCOLN  
 200 S 2ND ST  
 LINCOLN, NE  
 US 68508  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: