


OIL ANALYSIS REPORT

[604063007 SDR] **COLD WATER PUMP 2 (S/N 20050175)**

Secondary Pump

ISO 68 (--- GAL)





Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

Confirm oil type. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0854250	WC0605519	
Sample Date		Client Info		28 Dec 2023	22 Jun 2023	
Machine Age	mls	Client Info		0	0	
Oil Age	mls	Client Info		0	0	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	ATTENTION	
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
			>90			•
Iron	ppm	ASTM D5185m		0	0	
Chromium	ppm	ASTM D5185m	>5	0	0	
Nickel	ppm	ASTM D5185m	>5	0	0	
Titanium	ppm	ASTM D5185m	>3	0	<1	
Silver	ppm	ASTM D5185m	>3	0	0	
Aluminum	ppm	ASTM D5185m		0	1	
Lead	ppm	ASTM D5185m	>12	0	0	
Copper	ppm	ASTM D5185m	>30	0	0	
Tin	ppm	ASTM D5185m	>9	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m		0	0	
Calcium	ppm	ASTM D5185m		13	0	
Phosphorus	ppm	ASTM D5185m		12	12	
Zinc	ppm	ASTM D5185m		0	<1	
Sulfur	ppm	ASTM D5185m		541	720	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	0	<1	
Sodium	ppm	ASTM D5185m		<1	0	
Potassium	ppm	ASTM D5185m	>20	<1	<1	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.091	0.087	



OIL ANALYSIS REPORT

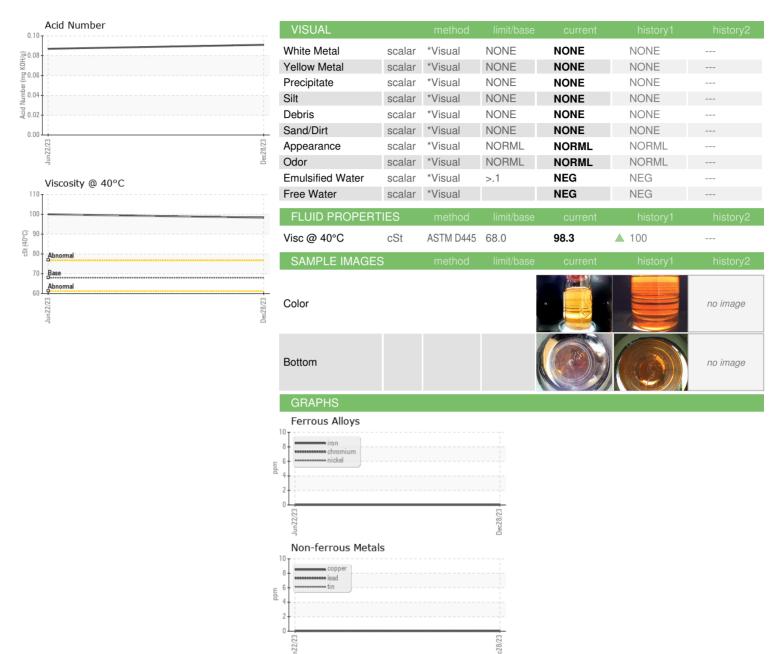





Certificate L2367

Laboratory Sample No. Lab Number

Unique Number Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : WC0854250 : 06064445

Viscosity @ 40°C

110

90

70

60 Abnor

평 80

Recieved : 10835827

Diagnosed Diagnostician

: 18 Jan 2024 : 22 Jan 2024 : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) MARS CHOCOLATE

2019 NORTH OAK PARK CHICAGO, IL US 60707

Contact: TONY FIORE tony.fiore@effem.com T: (773)745-2279

Contact/Location: TONY FIORE - MARSCHI

Acid Number

0.10 0.08 0.08

€0.06

은 0.04

0.02

0.00

F: