

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



4389422 (S/N 1068)

Component

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Nov2022	Jan2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA009929	KCP47947D	
Sample Date		Client Info		04 Jan 2024	17 Nov 2022	
Machine Age	hrs	Client Info		15891	15255	
Oil Age	hrs	Client Info		0	15000	
Oil Changed		Client Info		N/A	Changed	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	<1	
Lead	ppm	ASTM D5185m	>10	<1	0	
Copper	ppm	ASTM D5185m	>50	2	7	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	40	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	71	9	
Calcium	ppm	ASTM D5185m	0	3	0	
Phosphorus	ppm	ASTM D5185m	0	30	0	
Zinc	ppm	ASTM D5185m	0	3	47	
Sulfur	ppm	ASTM D5185m	23500	21845	24310	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	2	
Sodium	ppm	ASTM D5185m		17	2	
Potassium	ppm	ASTM D5185m	>20	4	0	
Water	%	ASTM D6304	>0.05	0.030	0.011	
ppm Water	ppm	ASTM D6304	>500	302	116.9	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1068	2097	
Particles >6µm		ASTM D7647	>1300	102	397	
Particles >14µm		ASTM D7647	>80	12	23	
Particles >21µm		ASTM D7647	>20	4	4	
Particles >38µm		ASTM D7647	>4	0	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/14/11	18/16/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.36	0.42	



OIL ANALYSIS REPORT

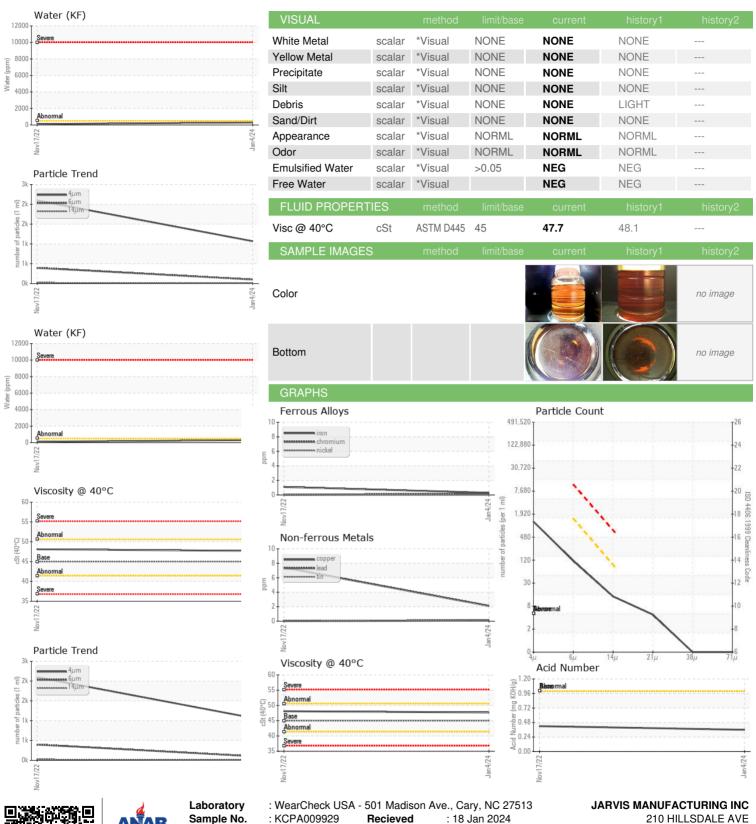





Certificate L2367

Sample No. Lab Number **Unique Number**

: KCPA009929

: 06065027 : 10836409

Diagnosed Diagnostician : Don Baldridge

: 22 Jan 2024

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) SAN JOSE, CA US 95136

Contact: C. MUNGIA cmungia@jarvismfg.com

T:

F: