



# OIL ANALYSIS REPORT


Sample Rating Trend

**NORMAL**



Machine Id  
**HOWDEN RC-6 (S/N MK4/XRV127R3/1571)**

Component  
**Refrigeration Compressor**  
Fluid  
**CAMCO 717 HT (45 GAL)**

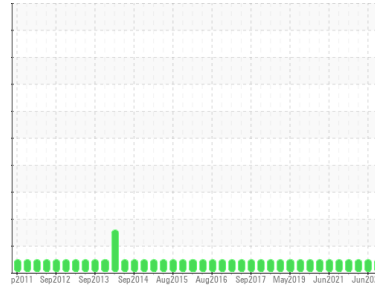

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>USP0004854</b>	USP243615	USP247965
Sample Date	Client Info			<b>10 Jan 2024</b>	12 Jun 2023	28 Nov 2022
Machine Age	hrs	Client Info		<b>0</b>	0	46045
Oil Age	hrs	Client Info		<b>0</b>	0	46045
Oil Changed	Client Info			<b>N/A</b>	N/A	Not Changd
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>8	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	1
Calcium	ppm	ASTM D5185m		<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	0	0
Zinc	ppm	ASTM D5185m		<b>0</b>	0	5
Sulfur	ppm	ASTM D5185m		<b>0</b>	0	0






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Water	%	ASTM D6304	>0.01	<b>0.002</b>	0.002	0.006
ppm Water	ppm	ASTM D6304	>100	<b>20</b>	18.6	65.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>410</b>	1521	1226
Particles >6µm		ASTM D7647	>2500	<b>96</b>	408	357
Particles >14µm		ASTM D7647	>320	<b>17</b>	15	17
Particles >21µm		ASTM D7647	>80	<b>4</b>	2	2
Particles >38µm		ASTM D7647	>20	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>16/14/11</b>	18/16/11	17/16/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.007	<b>0.014</b>	0.014	0.014




# OIL ANALYSIS REPORT

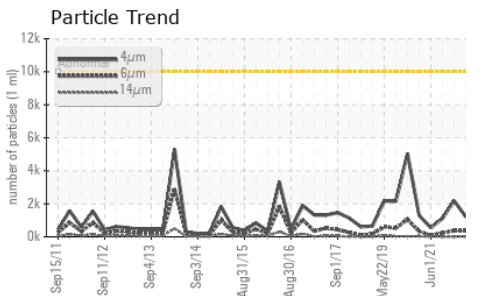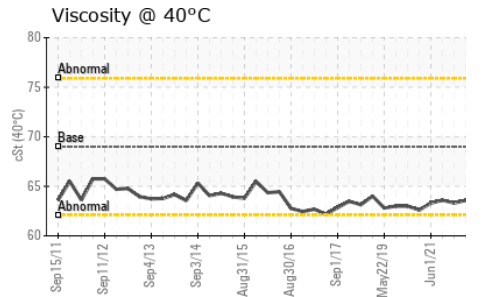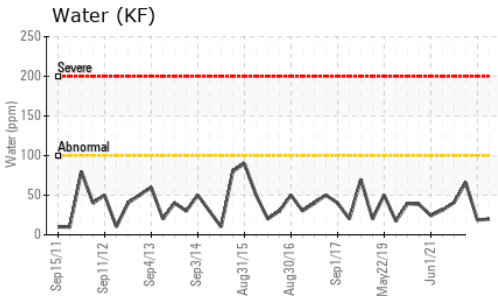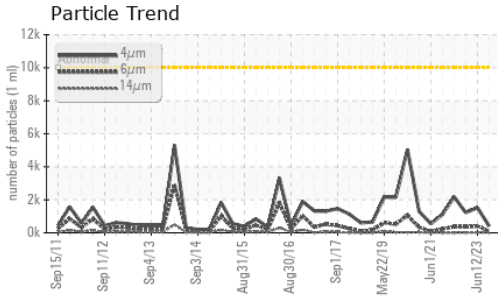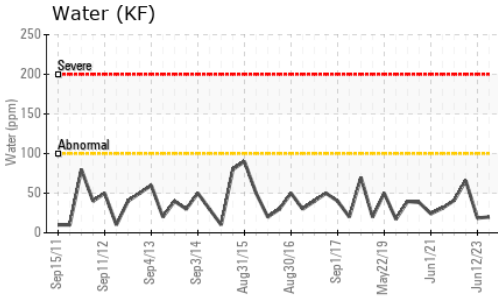






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 69	64.0	63.6	63.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

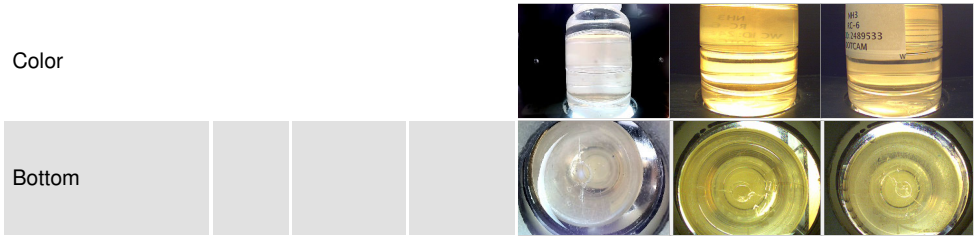

## GRAPHS

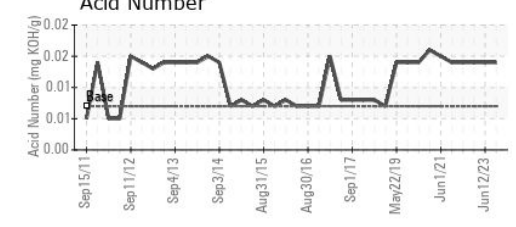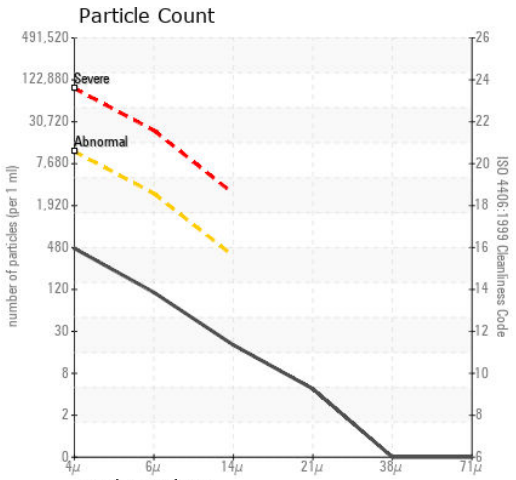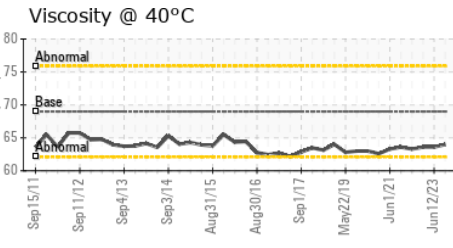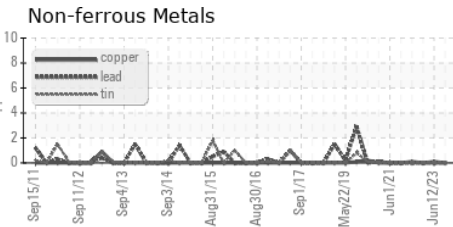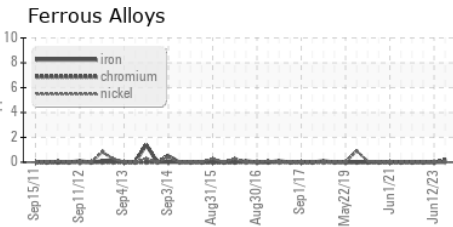

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0004854 **Recieved** : 18 Jan 2024  
**Lab Number** : 06065047 **Diagnosed** : 22 Jan 2024  
**Unique Number** : 10836429 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**DOT FOODS**  
 CAMBRIDGE CITY,  
 US  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)