




OIL ANALYSIS REPORT

Sample Rating Trend

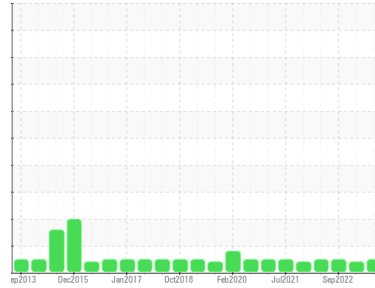

NORMAL



Area
A3
 Machine Id
UNION PUMP PWIP-42001A
 Component
Pump
 Fluid
GEAR OIL ISO 150 (26 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0771983	WC0378393	WC0670619
Sample Date	Client Info			07 Jan 2024	12 Dec 2022	21 Sep 2022
Machine Age	mths	Client Info		0	0	0
Oil Age	mths	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	ABNORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>.1	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	0	1	0
Chromium	ppm	ASTM D5185m	>5	<1	0	0
Nickel	ppm	ASTM D5185m	>5	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>7	2	0	0
Lead	ppm	ASTM D5185m	>12	<1	<1	0
Copper	ppm	ASTM D5185m	>30	2	4	3
Tin	ppm	ASTM D5185m	>9	<1	0	0
Antimony	ppm	ASTM D5185m		---	---	---
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	0	0	0
Barium	ppm	ASTM D5185m	15	1	0	0
Molybdenum	ppm	ASTM D5185m	15	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	50	89	69	72
Calcium	ppm	ASTM D5185m	50	18	2	2
Phosphorus	ppm	ASTM D5185m	350	31	14	0
Zinc	ppm	ASTM D5185m	100	0	0	0
Sulfur	ppm	ASTM D5185m	12500	21148	21512	21385

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	0	2	<1
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	6	10	12

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	252	---	441
Particles >6µm		ASTM D7647	>1300	77	---	71
Particles >14µm		ASTM D7647	>160	13	---	3
Particles >21µm		ASTM D7647	>40	4	---	1
Particles >38µm		ASTM D7647	>10	0	---	0
Particles >71µm		ASTM D7647	>3	0	---	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	15/13/11	---	16/13/9



OIL ANALYSIS REPORT

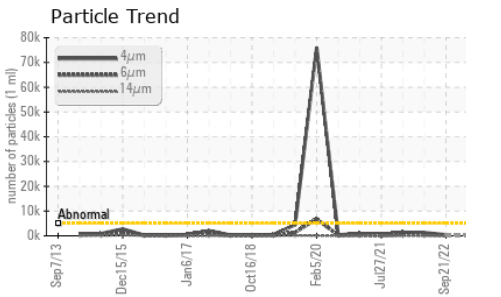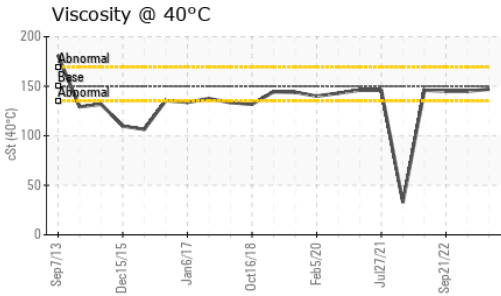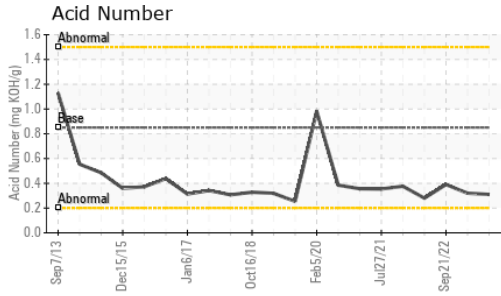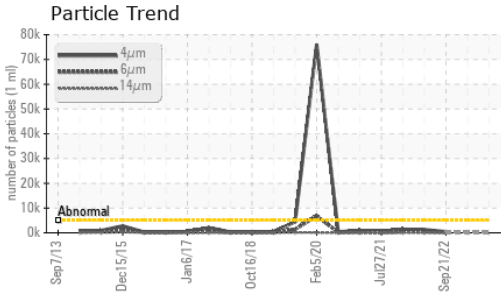


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	0.31	0.32	0.39






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	147	145	145

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

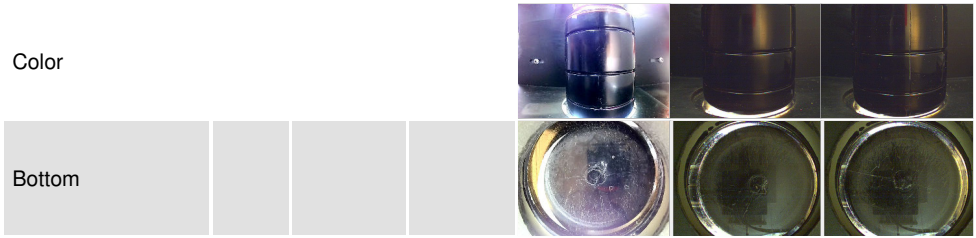

GRAPHS

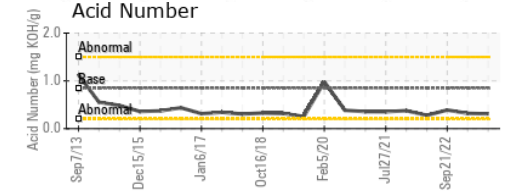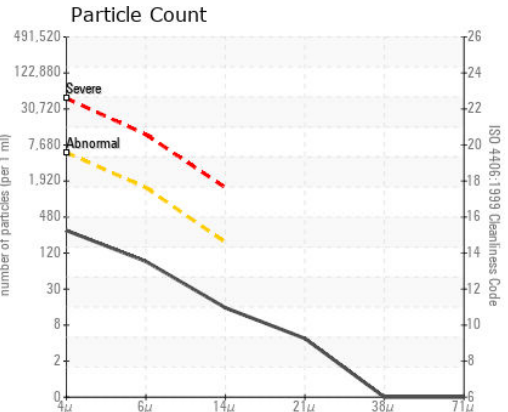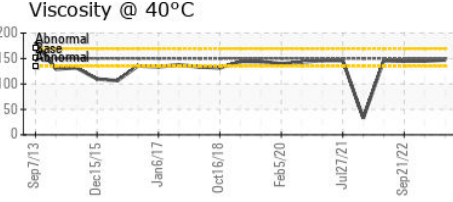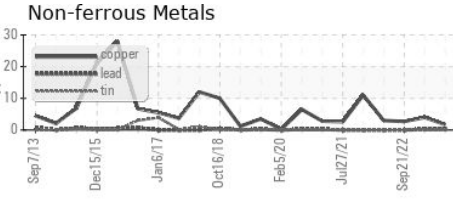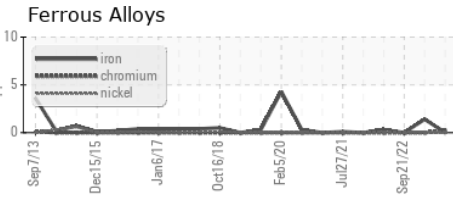

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0771983 **Received** : 18 Jan 2024
Lab Number : **06065057** **Diagnosed** : 22 Jan 2024
Unique Number : 10836439 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

Conoco Phillips ALASKA INC
 C/O LAF (ALPINE), 6441 S AIRPARK PL
 ANCHORAGE, AK
 US 99502
 Contact: Chris Van Ryzin Ben DeRaeve
 alp1084@conocophillips.com
 T: (907)670-4128
 F: (907)670-4137

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)