




OIL ANALYSIS REPORT

Sample Rating Trend

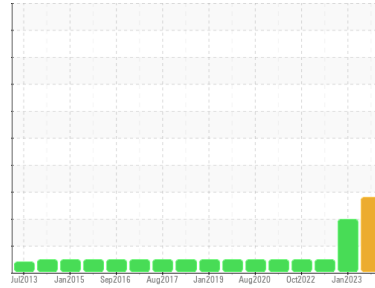

DIRT



Area

E-2

Machine Id

ATLAS COPCO Atlas Copco Inst Air Compressor-65003

Component

Air Compressor

Fluid

{not provided} (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. Elemental level of silicon (Si) above normal.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0771978	WC0670644	WC0670646
Sample Date	Client Info		14 Jan 2024	14 Jan 2023	31 Dec 2022
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>70	0	3	0
Chromium	ppm	ASTM D5185m	>15	<1	<1	0
Nickel	ppm	ASTM D5185m	>6	0	<1	0
Titanium	ppm	ASTM D5185m		<1	▲ 87	0
Silver	ppm	ASTM D5185m		0	<1	0
Aluminum	ppm	ASTM D5185m	>10	2	1	0
Lead	ppm	ASTM D5185m	>20	<1	1	0
Copper	ppm	ASTM D5185m	>80	<1	<1	0
Tin	ppm	ASTM D5185m	>15	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	1	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	148	0
Barium	ppm	ASTM D5185m		1	4	0
Molybdenum	ppm	ASTM D5185m		0	1	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		<1	629	0
Calcium	ppm	ASTM D5185m		<1	1306	<1
Phosphorus	ppm	ASTM D5185m		29	934	7
Zinc	ppm	ASTM D5185m		0	1145	<1
Sulfur	ppm	ASTM D5185m		444	3988	248

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>12	▲ 14	4	<1
Sodium	ppm	ASTM D5185m		0	2	<1
Potassium	ppm	ASTM D5185m	>20	<1	4	0

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 19773	▲ 44171	404
Particles >6µm	ASTM D7647	>2500	▲ 3466	303	82
Particles >14µm	ASTM D7647	>320	141	6	8
Particles >21µm	ASTM D7647	>80	34	1	2
Particles >38µm	ASTM D7647	>20	1	0	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 21/19/14	▲ 23/15/10	16/14/10


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.047	3.15	0.058




OIL ANALYSIS REPORT


▲ Silicon (ppm)

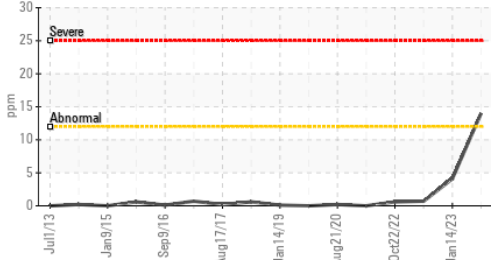


▲ Particle Trend

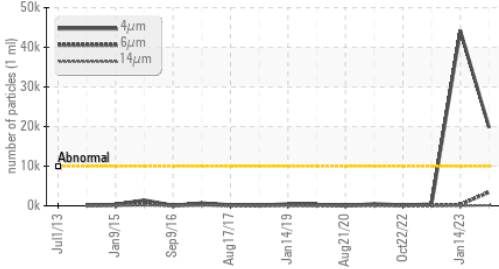


▲ Particle Trend

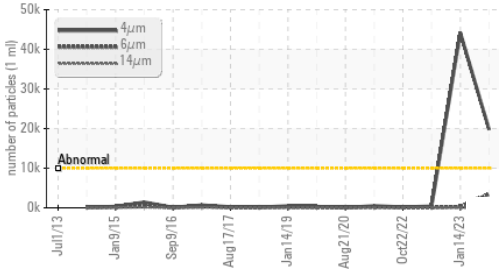

Acid Number

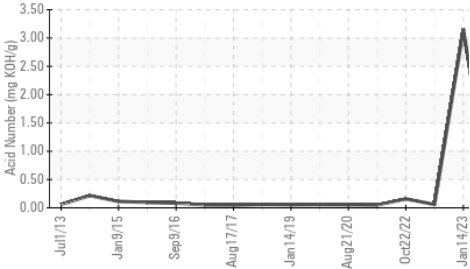


Viscosity @ 40°C

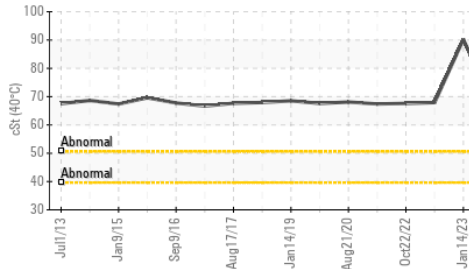






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68.0	▲ 90.22	67.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

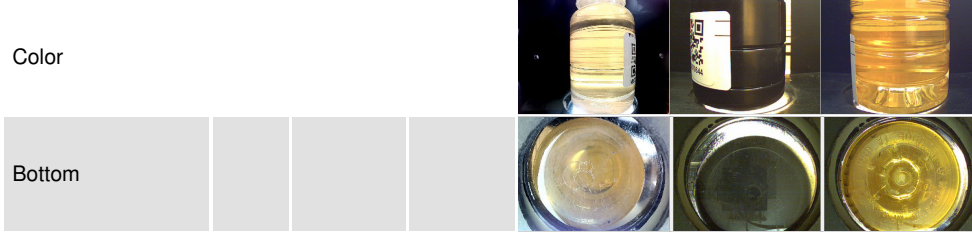

GRAPHS

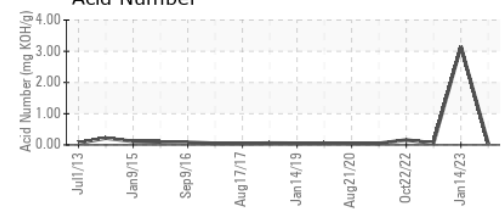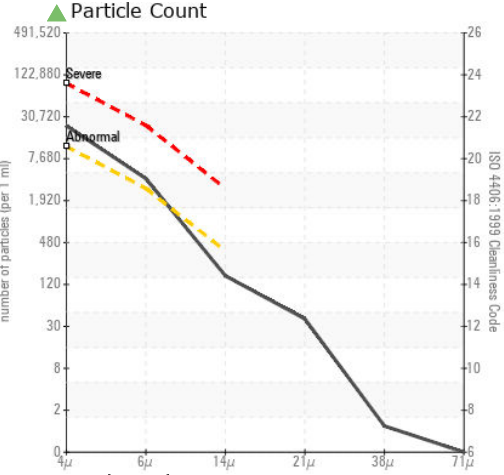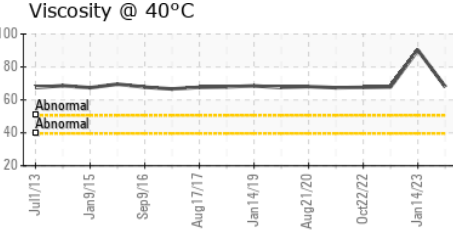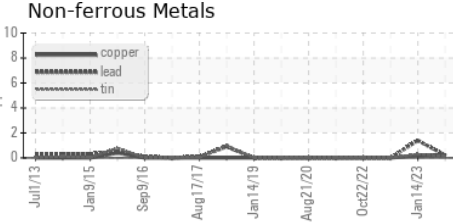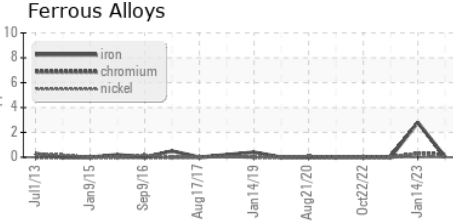

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0771978 **Received** : 18 Jan 2024
Lab Number : 06065061 **Diagnosed** : 22 Jan 2024
Unique Number : 10836443 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

Conoco Phillips ALASKA INC
 C/O LAF (ALPINE), 6441 S AIRPARK PL
 ANCHORAGE, AK
 US 99502
 Contact: GREG MARKLE HEATH CABANSKI
 alp1279@conocophillips.com
 T: (907)670-4143
 F: (907)670-4143

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)