



OIL ANALYSIS REPORT

Sample Rating Trend


SEDIMENT



Machine Id
SULLAIR M1037

Component
Compressor

Fluid
ROYAL PURPLE SYNFILM 46 (15 GAL)

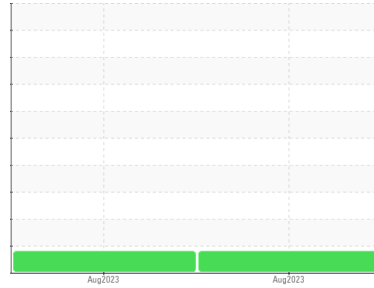

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of visible silt present in the sample.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			RP0033683	RP0033680	---
Sample Date	Client Info			28 Aug 2023	28 Aug 2023	---
Machine Age	hrs	Client Info		50916	50916	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			N/A	N/A	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	---
Chromium	ppm	ASTM D5185m	>10	<1	<1	---
Nickel	ppm	ASTM D5185m		0	<1	---
Titanium	ppm	ASTM D5185m		<1	<1	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	2	2	---
Lead	ppm	ASTM D5185m	>25	<1	0	---
Copper	ppm	ASTM D5185m	>50	3	8	---
Tin	ppm	ASTM D5185m	>15	0	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	<1	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		<1	0	---
Molybdenum	ppm	ASTM D5185m		0	<1	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		<1	<1	---
Calcium	ppm	ASTM D5185m		0	<1	---
Phosphorus	ppm	ASTM D5185m		27	7	---
Zinc	ppm	ASTM D5185m		0	4	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	---
Sodium	ppm	ASTM D5185m		0	1	---
Potassium	ppm	ASTM D5185m	>20	<1	1	---
Water	%	ASTM D6304	>0.1	0.011	0.021	---
ppm Water	ppm	ASTM D6304	>1000	119	214	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.25	0.37	0.29	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	▲ MODER	▲ MODER	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

OIL ANALYSIS REPORT

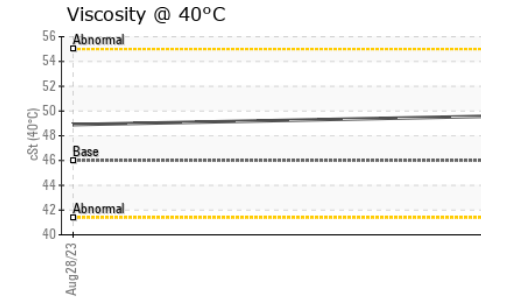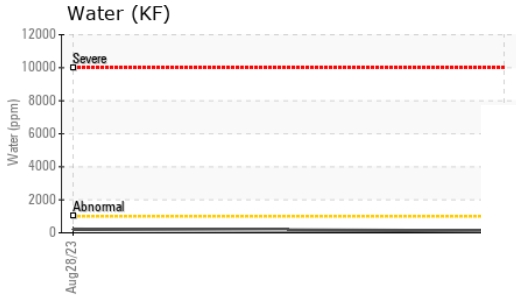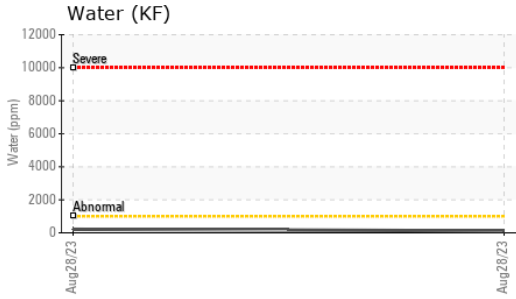





FLUID PROPERTIES

method	limit/base	current	history1	history2	
Visc @ 40°C	cSt ASTM D445	46	49.6	48.9	---

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				no image
Bottom				no image

GRAPHS

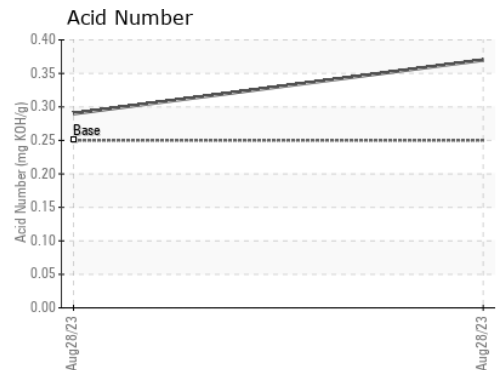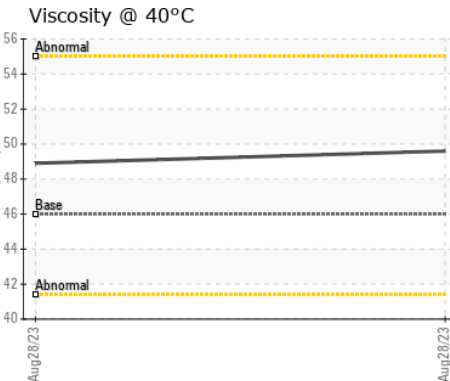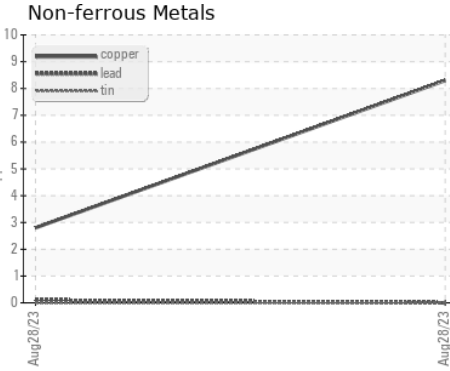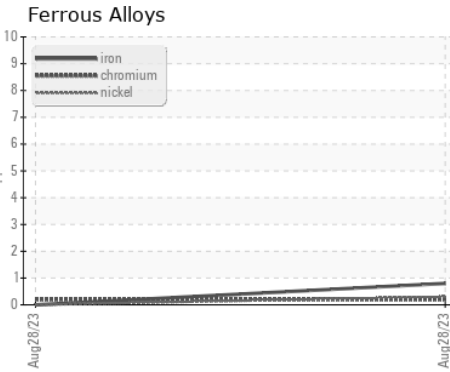

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0033683 **Received** : 18 Jan 2024
Lab Number : **06065068** **Diagnosed** : 22 Jan 2024
Unique Number : 10836450 **Diagnostician** : Don Baldrige
Test Package : IND 2

SULZER HICKHAM
 11518 OLD LAPORTE RD.
 LAPORTE, TX
 US 77571
 Contact: EVER GARZA
 ever.garza@sulzer.com
 T: (713)567-2807
 F: (713)567-2846

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)