




# OIL ANALYSIS REPORT

Sample Rating Trend

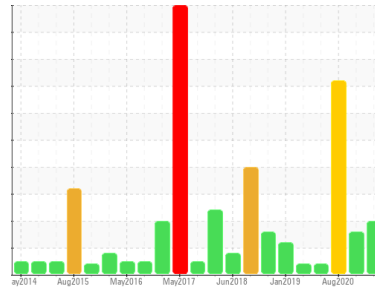

ISO



Machine Id  
**KAESER SFC 55T 4670979 (S/N 2239)**

Component  
**Compressor**  
Fluid  
**FG ELITE (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC127431</b>	KC94203	KC84305
Sample Date	Client Info	<b>05 Jan 2024</b>	08 Oct 2020	27 Aug 2020
Machine Age	hrs	<b>60260</b>	38454	38053
Oil Age	hrs	<b>0</b>	7261	6860
Oil Changed	Client Info	<b>N/A</b>	Changed	Not Chngd
Sample Status		<b>ABNORMAL</b>	ABNORMAL	SEVERE

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	3	3
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m >50	<b>2</b>	11	15
Tin	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m	<b>---</b>	1	2
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	12	3
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>0</b>	14	12
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Phosphorus	ppm	ASTM D5185m	<b>28</b>	2	6
Zinc	ppm	ASTM D5185m	<b>33</b>	16	7

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	2	3
Sodium	ppm	ASTM D5185m	<b>0</b>	16	10
Potassium	ppm	ASTM D5185m >20	<b>0</b>	5	6
Water	%	ASTM D6304 >0.05	<b>0.031</b>	0.010	▲ 0.230
ppm Water	ppm	ASTM D6304 >500	<b>319</b>	106.8	▲ 2300


## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>7866</b>	11151	---
Particles >6µm	ASTM D7647 >1300	▲ <b>2402</b>	▲ 3143	---
Particles >14µm	ASTM D7647 >80	▲ <b>263</b>	▲ 282	---
Particles >21µm	ASTM D7647 >20	▲ <b>94</b>	▲ 94	---
Particles >38µm	ASTM D7647 >4	▲ <b>6</b>	▲ 9	---
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ <b>20/18/15</b>	▲ 19/15	---


## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.18</b>	0.346	0.335


# OIL ANALYSIS REPORT

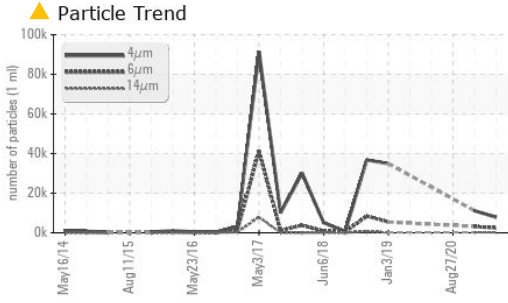


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	▲ MODER
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	1.0

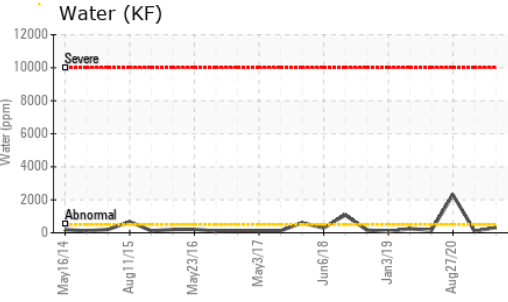







FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	48.4	44.2	44.1

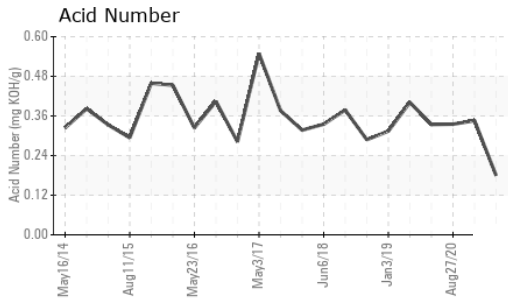

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

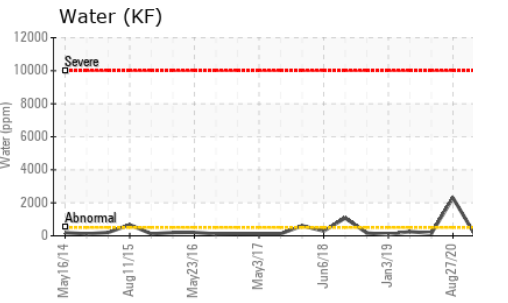

## GRAPHS

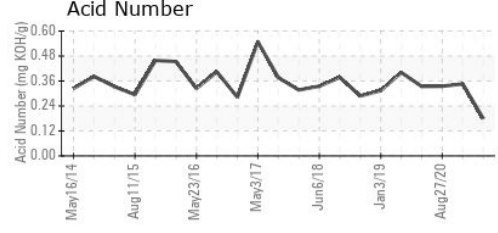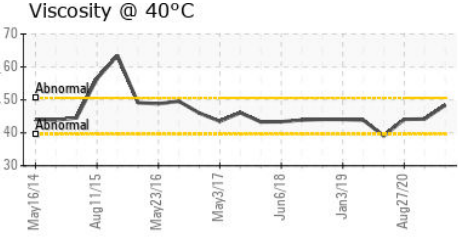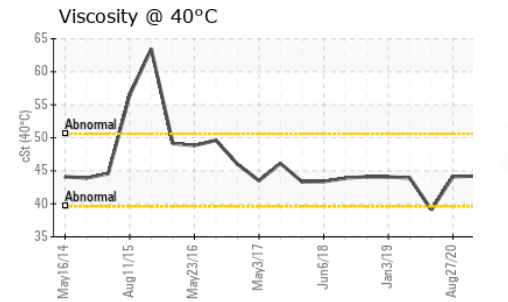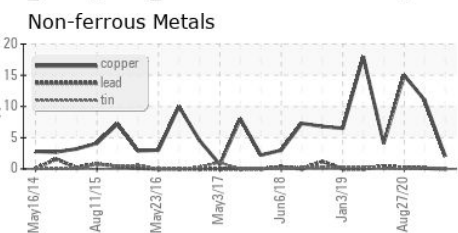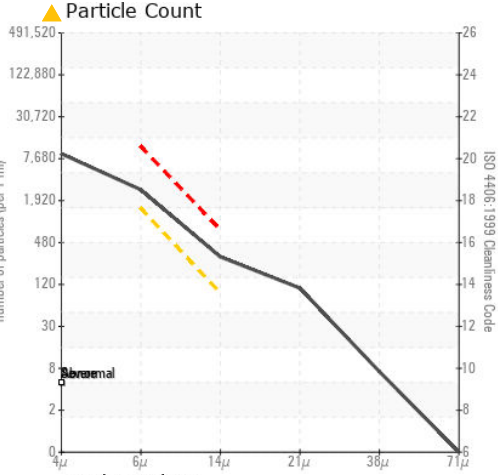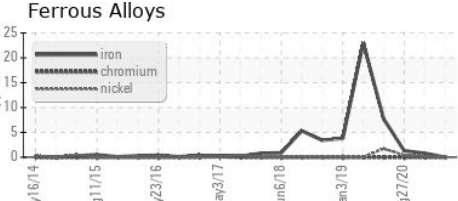

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC127431 **Recieved** : 19 Jan 2024  
**Lab Number** : 06065611 **Diagnosed** : 22 Jan 2024  
**Unique Number** : 10836993 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**CUSTOM MOLDERS**  
 160 MEISTER AVE #1  
 SOMERVILLE, NJ  
 US 08867  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: