




OIL ANALYSIS REPORT

Sample Rating Trend

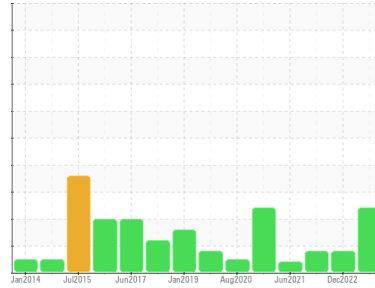

WEAR



Machine Id
KAESER SFC 18 4676173 (S/N 1018)

Component
Compressor

Fluid
KAESER SIGMA (OEM) FG-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

▲ Wear

The aluminum level is abnormal. All other component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC125915	KC101736	KC73479
Sample Date	Client Info			28 Dec 2023	28 Dec 2022	20 Dec 2021
Machine Age	hrs	Client Info		25115	23714	22696
Oil Age	hrs	Client Info		0	2100	497
Oil Changed	Client Info			N/A	Changed	Changed
Sample Status				ABNORMAL	ATTENTION	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	15	10	4
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	0	<1	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	▲ 22	5	2
Lead	ppm	ASTM D5185m	>10	0	1	0
Copper	ppm	ASTM D5185m	>50	8	<1	<1
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		<1	5	1
Calcium	ppm	ASTM D5185m		<1	0	0
Phosphorus	ppm	ASTM D5185m	500	366	420	473
Zinc	ppm	ASTM D5185m		237	134	105


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	0
Sodium	ppm	ASTM D5185m		0	4	4
Potassium	ppm	ASTM D5185m	>20	0	8	0
Water	%	ASTM D6304	>0.05	0.008	0.005	0.004
ppm Water	ppm	ASTM D6304	>500	80	54.3	46.2

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		12107	1821	2835
Particles >6µm		ASTM D7647	>1300	▲ 2239	738	904
Particles >14µm		ASTM D7647	>80	▲ 104	▲ 83	▲ 107
Particles >21µm		ASTM D7647	>20	▲ 25	20	▲ 32
Particles >38µm		ASTM D7647	>4	1	1	3
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/18/14	▲ 18/17/14	▲ 17/14


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.73	1.42	1.25

OIL ANALYSIS REPORT


▲ Aluminum (ppm)

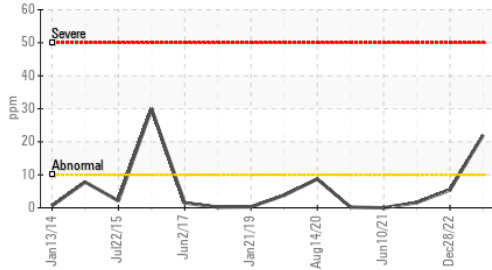


▲ Particle Trend

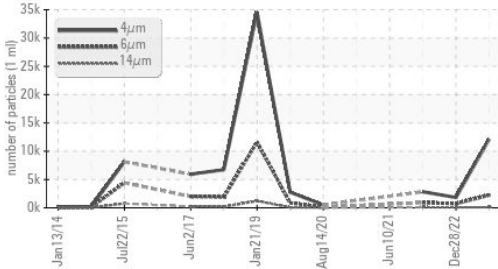


▲ Water (KF)

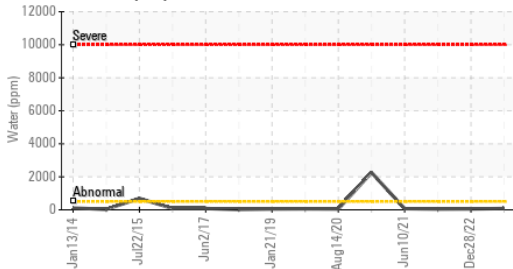

▲ Acid Number

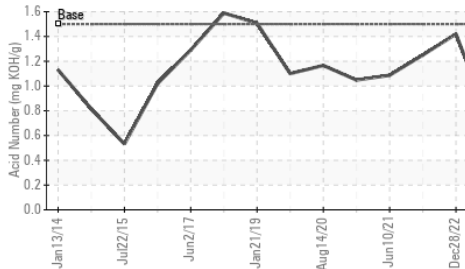

▲ Water (KF)

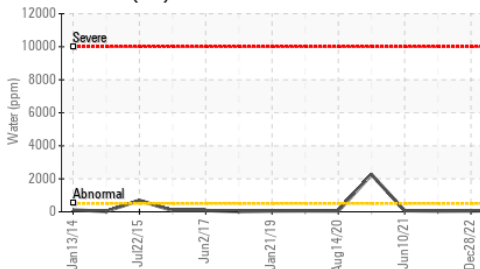

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	46.7	45.9	46.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

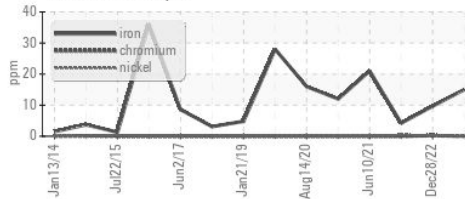


Non-ferrous Metals

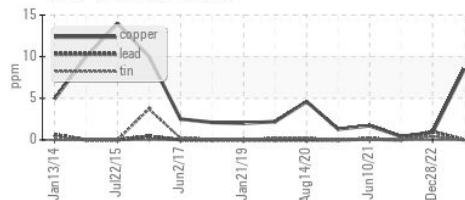


Viscosity @ 40°C

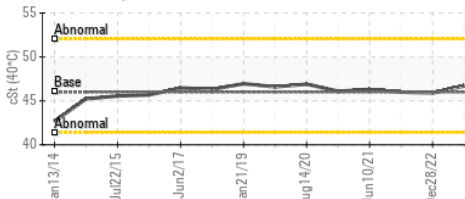

▲ Particle Count

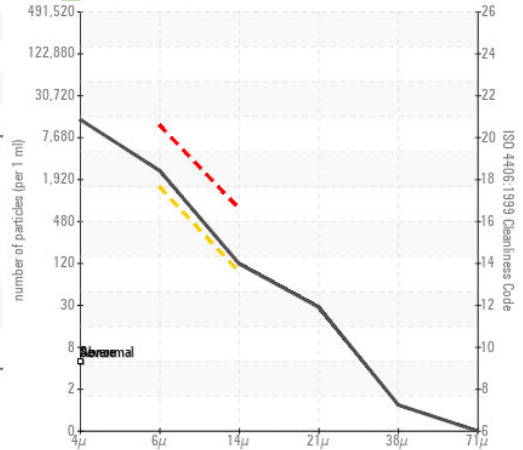

▲ Acid Number

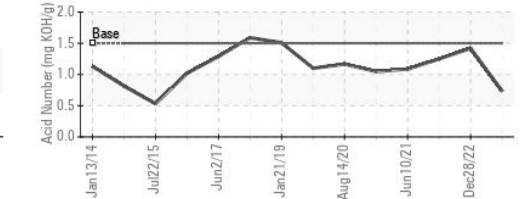

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC125915 **Received** : 19 Jan 2024
Lab Number : 06065618 **Diagnosed** : 22 Jan 2024
Unique Number : 10837000 **Diagnostician** : Don Baldrige
Test Package : IND 2

STAR KAY WHITE
 85 BRENNER DR
 CONGERS, NY
 US 10920
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: