

OIL ANALYSIS REPORT



ISO



KAESER 8208638

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Dec2022	Jan 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
07 mm 22 mm 01 m	MATION		IIIIIIIIIIIIIII			•
Sample Number		Client Info		KC127471	KC106876	
Sample Date		Client Info		10 Jan 2024	14 Dec 2022	
Machine Age	hrs	Client Info		4794	2396	
Oil Age	hrs	Client Info		0	2396	
Oil Changed		Client Info		N/A	Changed ABNORMAL	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	10	8	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	2	10	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	58	78	
Calcium	ppm	ASTM D5185m	2	2	3	
Phosphorus	ppm	ASTM D5185m		0	72	
Zinc	ppm	ASTM D5185m		6	14	
CONTAMINANTS	1	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	3	
Sodium	ppm	ASTM D5185m		9	18	
Potassium	ppm	ASTM D5185m	>20	0	5	
Water	%	ASTM D6304	>0.05	0.019	0.015	
ppm Water	ppm	ASTM D6304	>500	199	156.5	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		12697		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	1047		
Particles >21µm		ASTM D7647	>20	4 394		
Particles >38μm		ASTM D7647	>4	28		
Particles >71μm		ASTM D7647	>3	1		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32	0.36	



OIL ANALYSIS REPORT

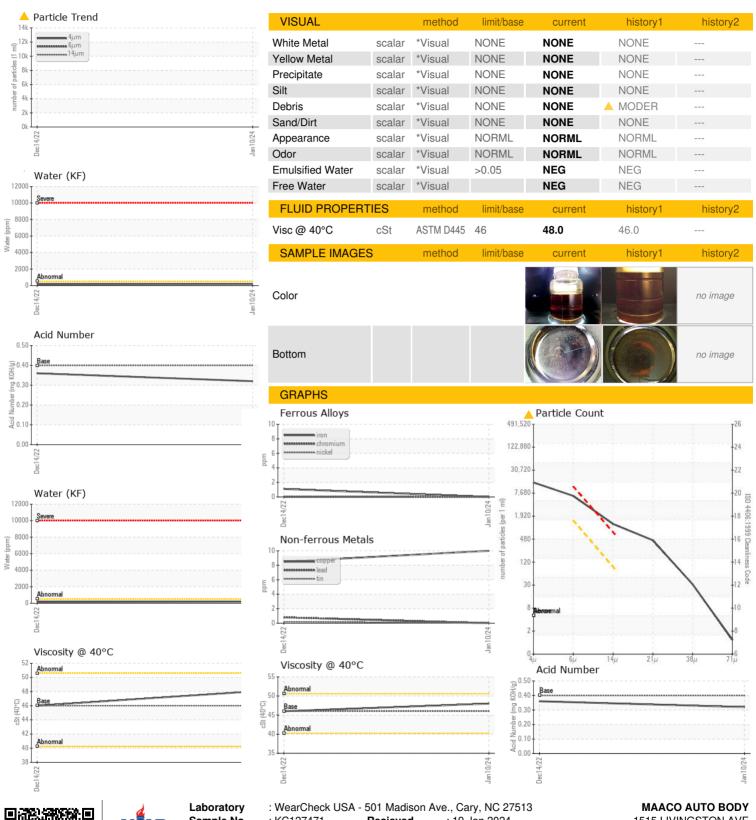



Certificate L2367

Sample No. Lab Number **Unique Number**

: KC127471 : 06065621

: 10837003 Test Package : IND 2

Recieved Diagnosed Diagnostician

: 19 Jan 2024 : 22 Jan 2024 : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

1515 LIVINGSTON AVE NORTH BRUNSWICK, NJ US 08902

Contact: Service Manager

T:

F: