




OIL ANALYSIS REPORT

Sample Rating Trend

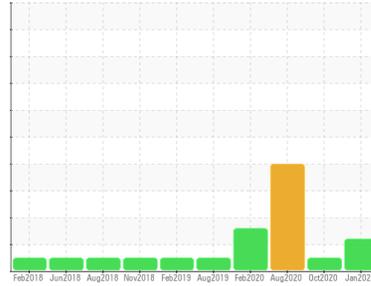

Machine Id
KAESER BSD 60T 5992853 (S/N 4120)
 Component
Compressor
 Fluid
FG ELITE (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC127465	KC94205	KC55977
Sample Date	Client Info		05 Jan 2024	16 Oct 2020	27 Aug 2020
Machine Age	hrs	Client Info	25085	12939	12410
Oil Age	hrs	Client Info	0	1771	1622
Oil Changed	Client Info		N/A	Changed	Not Chngd
Sample Status			ATTENTION	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	<1
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	<1	0
Aluminum	ppm	ASTM D5185m >10	0	0	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	1	8	6
Tin	ppm	ASTM D5185m >10	0	<1	0
Antimony	ppm	ASTM D5185m	---	<1	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1	<1
Barium	ppm	ASTM D5185m	0	<1	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	<1	35	34
Calcium	ppm	ASTM D5185m	<1	0	<1
Phosphorus	ppm	ASTM D5185m	26	4	<1
Zinc	ppm	ASTM D5185m	33	2	9

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	<1
Sodium	ppm	ASTM D5185m	<1	13	9
Potassium	ppm	ASTM D5185m >20	0	3	3
Water	%	ASTM D6304 >0.05	0.008	0.018	▲ 0.188
ppm Water	ppm	ASTM D6304 >500	80	182.1	▲ 1880

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		3524	2842	---
Particles >6µm	ASTM D7647 >1300		961	1036	---
Particles >14µm	ASTM D7647 >80		▲ 102	37	---
Particles >21µm	ASTM D7647 >20		▲ 28	9	---
Particles >38µm	ASTM D7647 >4		1	3	---
Particles >71µm	ASTM D7647 >3		0	3	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 19/17/14	17/12	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.18	0.352	0.328


OIL ANALYSIS REPORT

▲ Particle Trend

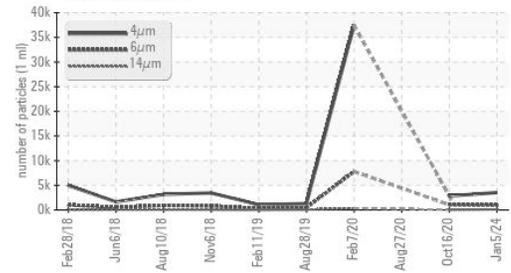


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	▲ MODER
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	▲ 1.0

Water (KF)

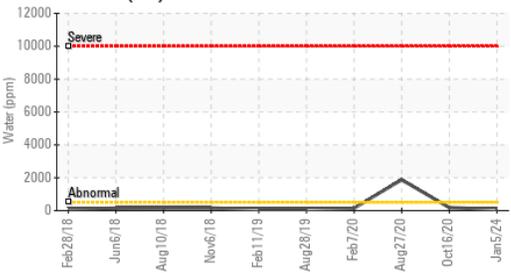


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	48.4	44.6	47.5


SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

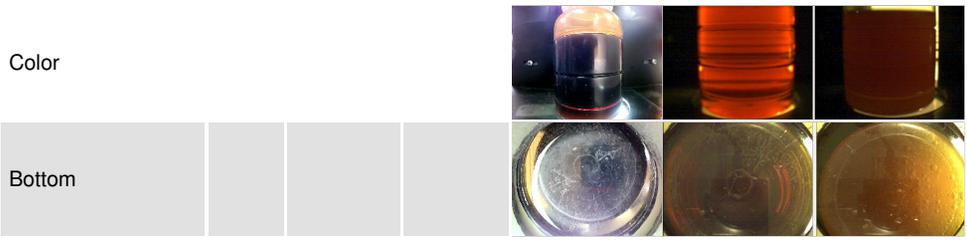

Acid Number

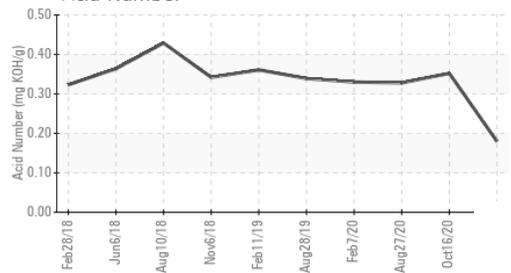


Water (KF)

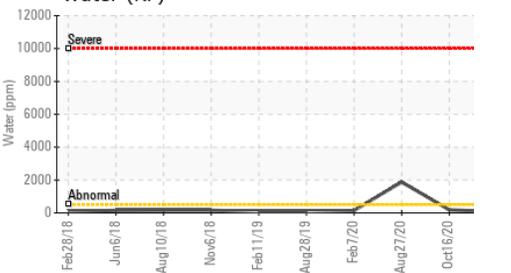


GRAPHS


Ferrous Alloys

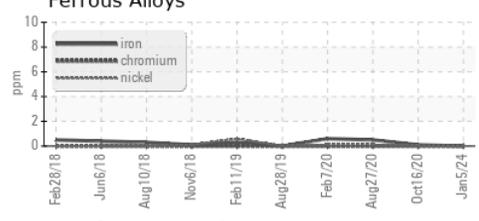


Non-ferrous Metals

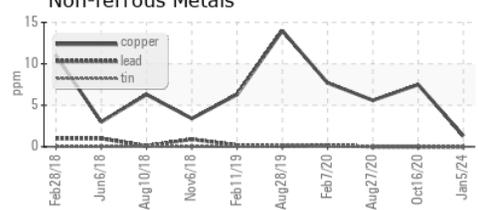


Viscosity @ 40°C

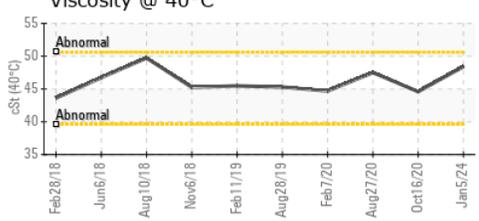

▲ Particle Count

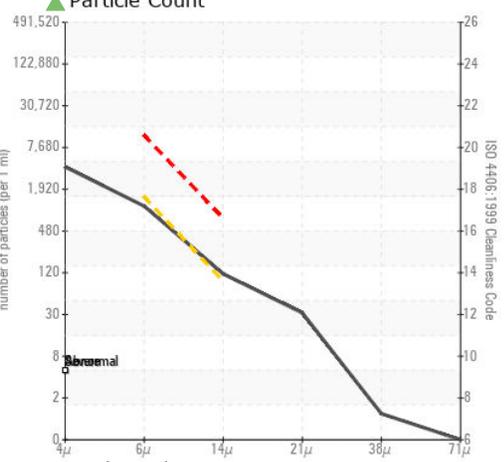

Acid Number

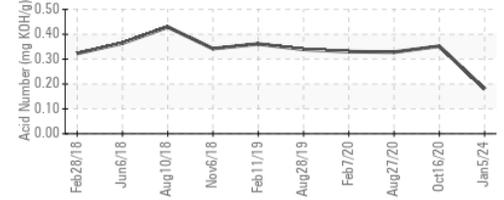

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC127465 **Received** : 19 Jan 2024
Lab Number : 06065626 **Diagnosed** : 22 Jan 2024
Unique Number : 10837008 **Diagnostician** : Don Baldrige
Test Package : IND 2

CUSTOM MOLDERS
 160 MEISTER AVE #1
 SOMERVILLE, NJ
 US 08867
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: