




# OIL ANALYSIS REPORT

Sample Rating Trend

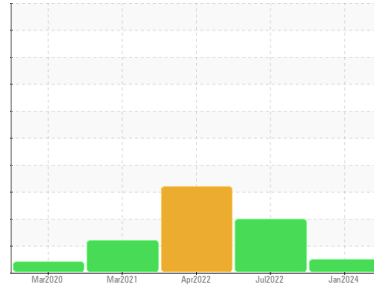

**NORMAL**



Machine Id  
**KAESER 6117169**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC127589</b>	KC96906	KC104134
Sample Date	Client Info		<b>03 Jan 2024</b>	28 Jul 2022	05 Apr 2022
Machine Age	hrs	Client Info	<b>6196</b>	4789	4344
Oil Age	hrs	Client Info	<b>0</b>	445	628
Oil Changed	Client Info		<b>N/A</b>	Not Changd	Not Changd
Sample Status			<b>NORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>18</b>	10	4
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m 90	<b>11</b>	33	42
Calcium	ppm	ASTM D5185m 2	<b>&lt;1</b>	0	<1
Phosphorus	ppm	ASTM D5185m	<b>0</b>	3	4
Zinc	ppm	ASTM D5185m	<b>5</b>	<1	1

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>2</b>	15	4
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Water	%	ASTM D6304 >0.05	<b>0.010</b>	0.020	▲ 0.245
ppm Water	ppm	ASTM D6304 >500	<b>109</b>	207.5	▲ 2450






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>1307</b>	50747	---
Particles >6µm	ASTM D7647 >1300		<b>434</b>	▲ 20082	---
Particles >14µm	ASTM D7647 >80		<b>38</b>	▲ 437	---
Particles >21µm	ASTM D7647 >20		<b>12</b>	▲ 43	---
Particles >38µm	ASTM D7647 >4		<b>1</b>	▲ 7	---
Particles >71µm	ASTM D7647 >3		<b>0</b>	1	---
Oil Cleanliness	ISO 4406 (c) >--/17/13		<b>18/16/12</b>	▲ 23/22/16	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.24</b>	0.30	0.29


# OIL ANALYSIS REPORT

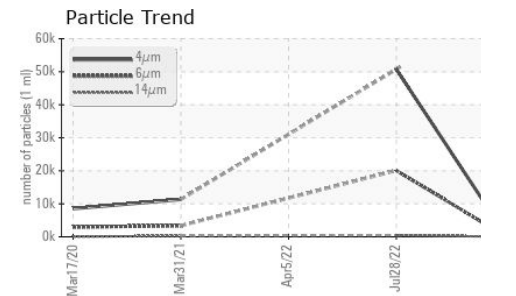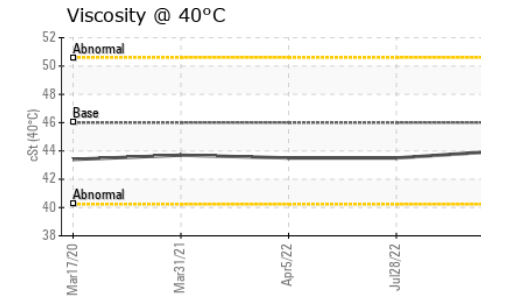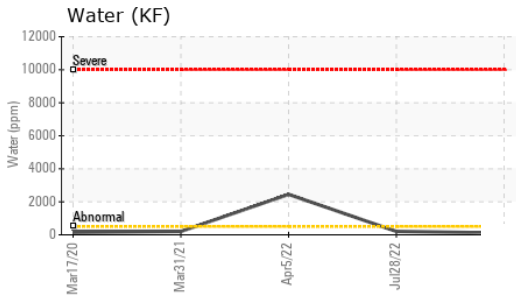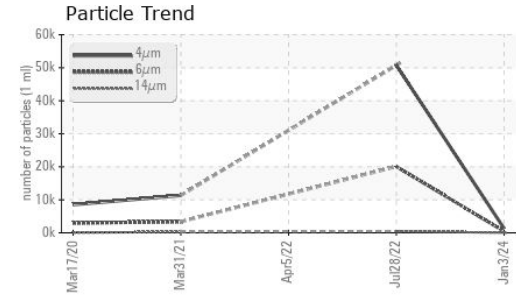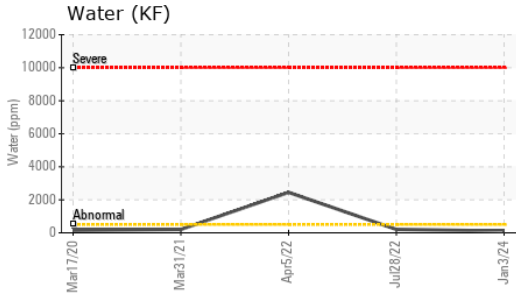






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	▲ 1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.0	43.5	43.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

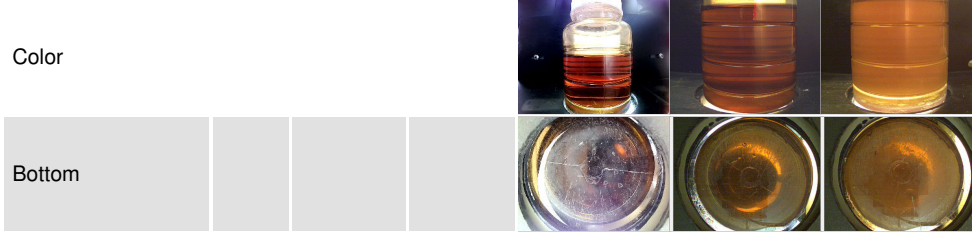

## GRAPHS

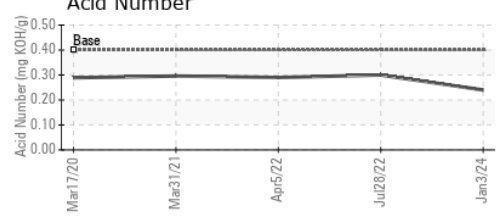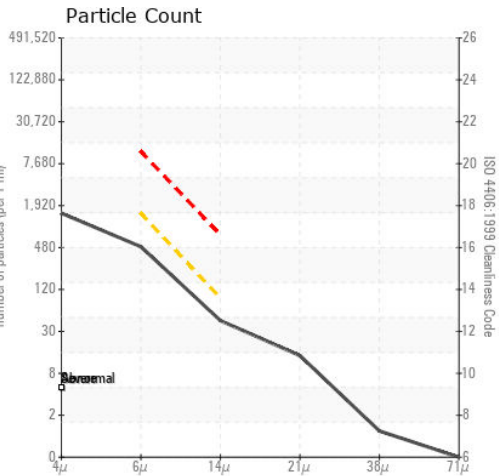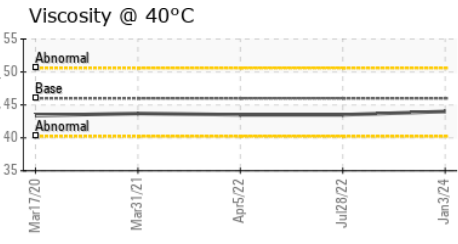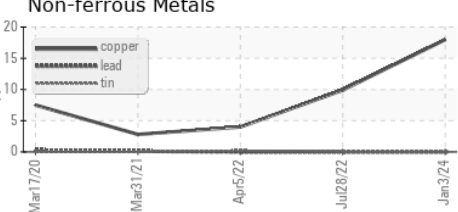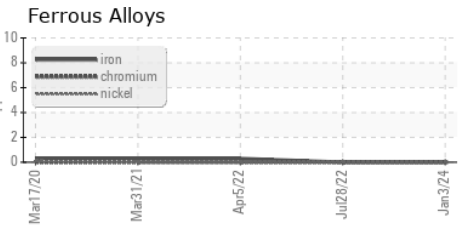

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC127589 **Received** : 19 Jan 2024  
**Lab Number** : 06065629 **Diagnosed** : 22 Jan 2024  
**Unique Number** : 10837011 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**NJIT - NEW JERSEY INSTITUTE OF TECHNOLOGY**  
 198-200 CENTRAL AVE  
 NEWARK, NJ  
 US 07103  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: