

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

KAESER AIRCENTER SM 12 294

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

17626 (S/N 113	37)		Jan2024		
SAMPLE INFORMAT	ION met	thod limit/	base cur		
Sample Number	Clien	it Info	KC1274	l51	
Sample Date	Clien	it Info	11 Jan	2024	
	0"				

OAMI LE IM OIT		method	IIIIII/Dase	Current	HISTOLAL	Historyz
Sample Number		Client Info		KC127451		
Sample Date		Client Info		11 Jan 2024		
Machine Age	hrs	Client Info		77751		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	18		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	16		
Calcium	ppm	ASTM D5185m	2	<1		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		23		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m	<i>></i> 20	4		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.008		
ppm Water		ASTM D6304 ASTM D6304	>50.03	82		
FLUID CLEANLIN	ppm					
	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	1005	2892		
Particles >6µm		ASTM D7647	>1300	785		
Particles >14µm		ASTM D7647	>80	83		
Particles >21µm		ASTM D7647	>20	22		
Particles >38µm		ASTM D7647	>4	1		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	1 9/17/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.30		



OIL ANALYSIS REPORT

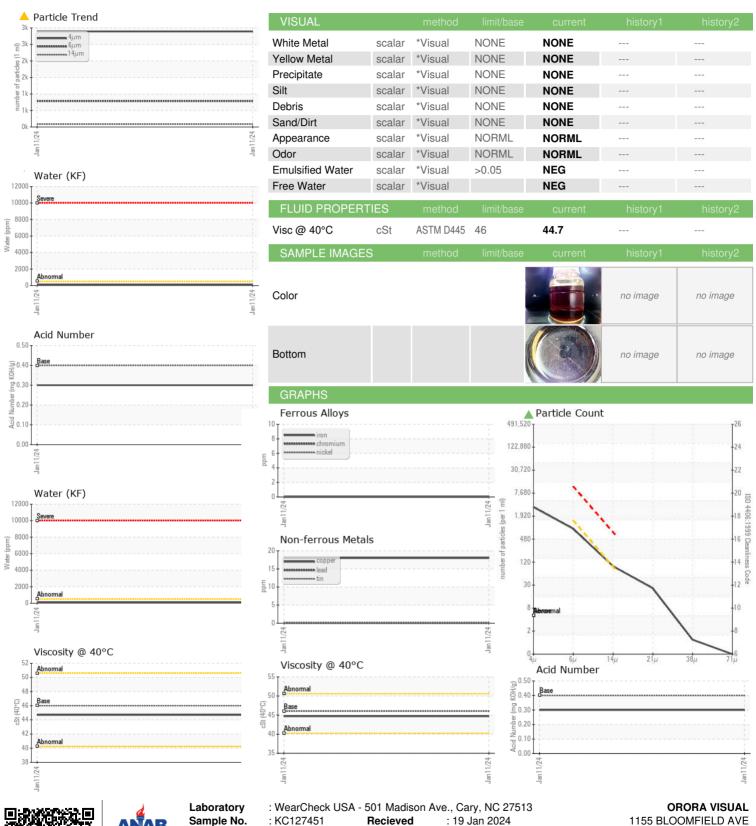



Certificate L2367

Sample No. Lab Number **Unique Number**

Test Package

: KC127451 : 06065630

: 10837012 : IND 2

Recieved Diagnosed Diagnostician

: 22 Jan 2024

: Don Baldridge

1155 BLOOMFIELD AVE CLIFTON, NJ US 07012

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: