




OIL ANALYSIS REPORT

Sample Rating Trend

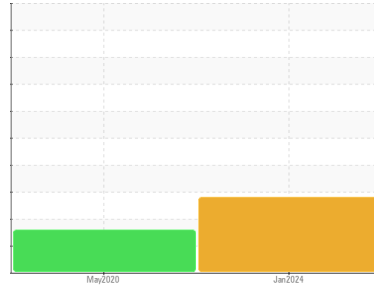

WEAR



Machine Id
KAESER 5745746
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. The filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

Wear
 The aluminum level is abnormal. All other component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA006533	KC88389	---
Sample Date	Client Info			10 Jan 2024	27 May 2020	---
Machine Age	hrs	Client Info		27086	15543	---
Oil Age	hrs	Client Info		0	15543	---
Oil Changed	Client Info			N/A	Not Changd	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	45	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	▲ 30	13	---
Lead	ppm	ASTM D5185m	>10	0	5	---
Copper	ppm	ASTM D5185m	>50	7	9	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	<1	---
Cadmium	ppm	ASTM D5185m		0	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		1	6	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m		6	11	---
Calcium	ppm	ASTM D5185m		<1	0	---
Phosphorus	ppm	ASTM D5185m	500	534	320	---
Zinc	ppm	ASTM D5185m		196	150	---
Sulfur	ppm	ASTM D5185m		2718	5369	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	---
Sodium	ppm	ASTM D5185m		2	1	---
Potassium	ppm	ASTM D5185m	>20	0	0	---
Water	%	ASTM D6304	>0.05	0.023	0.011	---
ppm Water	ppm	ASTM D6304	>500	234	118.2	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		73444	183695	---
Particles >6µm		ASTM D7647	>1300	▲ 26281	▲ 102184	---
Particles >14µm		ASTM D7647	>80	▲ 1276	▲ 7783	---
Particles >21µm		ASTM D7647	>20	▲ 321	▲ 1032	---
Particles >38µm		ASTM D7647	>4	▲ 23	▲ 14	---
Particles >71µm		ASTM D7647	>3	1	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 23/22/17	▲ 24/20	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	1.43	0.911	---


OIL ANALYSIS REPORT

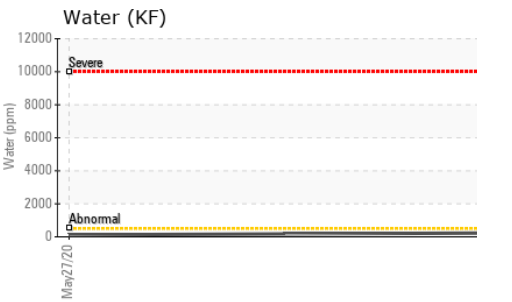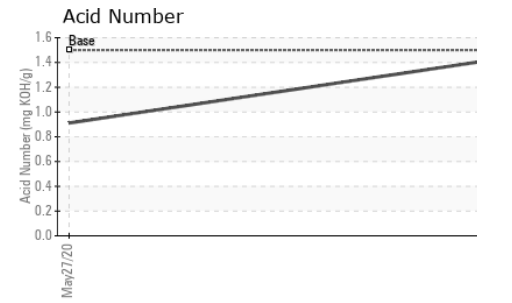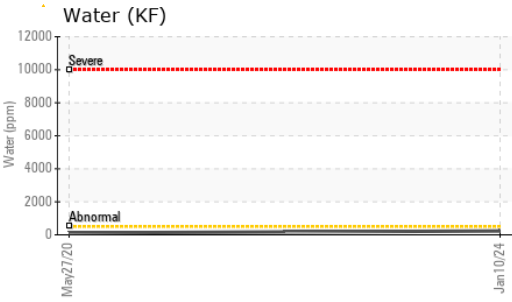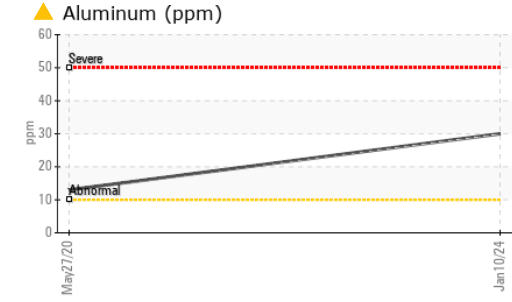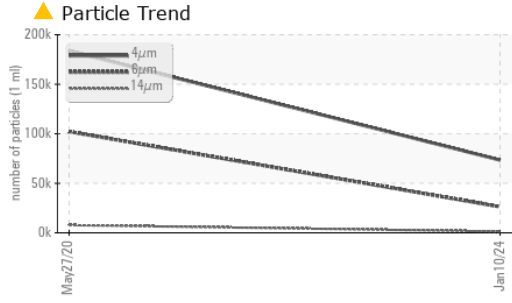






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	49.3	50.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

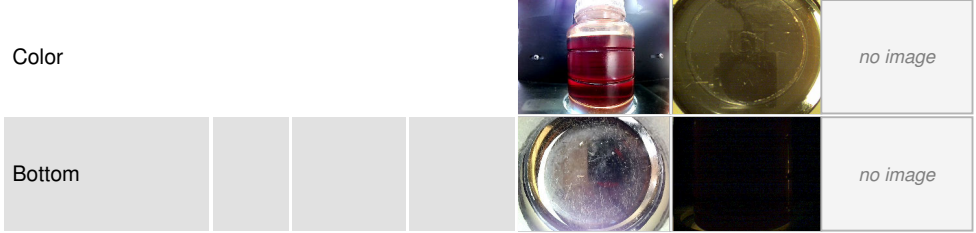

GRAPHS

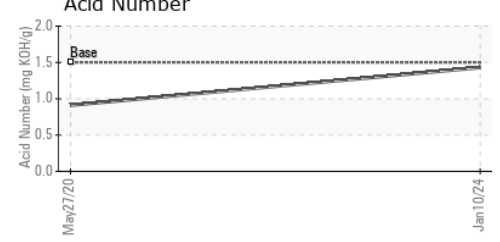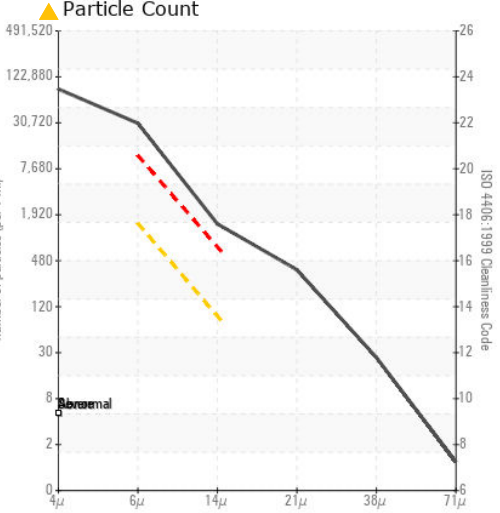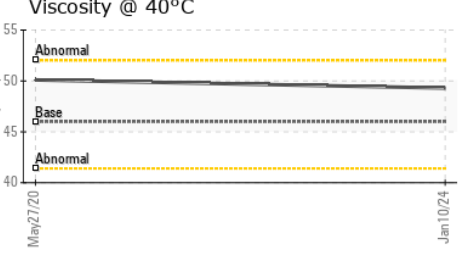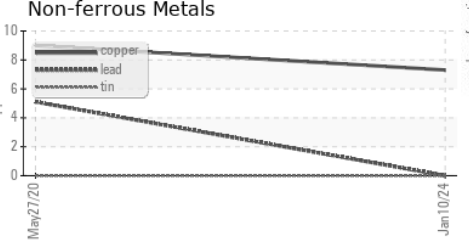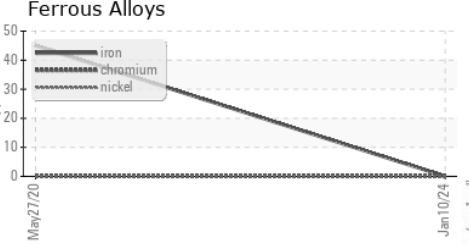

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA006533 **Received** : 19 Jan 2024
Lab Number : 06065639 **Diagnosed** : 22 Jan 2024
Unique Number : 10837021 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

COAST PACKING CO
 3275 E VERNON AVE
 VERNON, CA
 US 90058
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)