




# OIL ANALYSIS REPORT

Sample Rating Trend

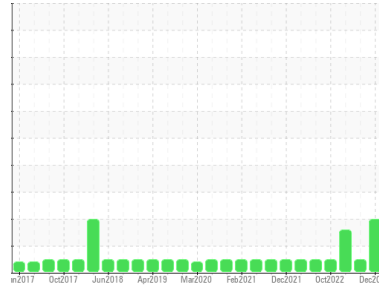

Area  
**BATTERY ROOM**  
 Machine Id  
**ECCM06 (S/N H1042488A)**  
 Component  
**Air Compressor**  
 Fluid  
**USPI MAX FG AIR 46 (5 GAL)**

## DIAGNOSIS

**Recommendation**  
 We recommend you service the filters on this component. Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is a high amount of particulates present in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USPM30692</b>	USPM28584	USPM26153
Sample Date	Client Info	<b>24 Dec 2023</b>	04 Jun 2023	16 Jan 2023
Machine Age	hrs	Client Info	<b>49478</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >4	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >20	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >40	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m >5	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m 0	<b>&lt;1</b>	2	2
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Sulfur	ppm	ASTM D5185m 0	<b>4</b>	8	0

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Water	%	ASTM D6304 >0.6	<b>0.008</b>	0.005	0.253
ppm Water	ppm	ASTM D6304 >6000	<b>81</b>	55.6	2530






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>▲ 82547</b>	843	▲ 17516
Particles >6µm	ASTM D7647 >2500	<b>▲ 20531</b>	253	▲ 2616
Particles >14µm	ASTM D7647 >320	<b>▲ 835</b>	22	28
Particles >21µm	ASTM D7647 >80	<b>▲ 148</b>	6	4
Particles >38µm	ASTM D7647 >20	<b>3</b>	1	0
Particles >71µm	ASTM D7647 >4	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	<b>▲ 24/22/17</b>	17/15/12	▲ 21/19/12

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.16	<b>0.54</b>	0.11	0.35


# OIL ANALYSIS REPORT

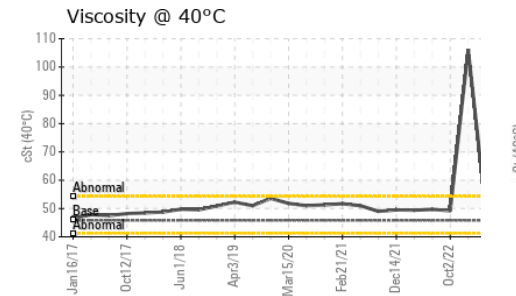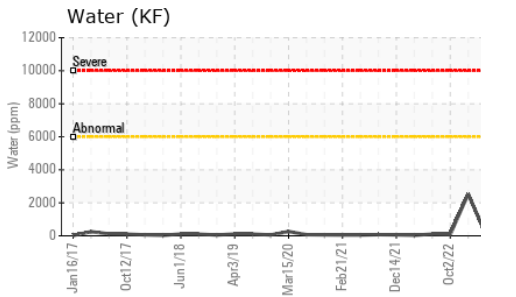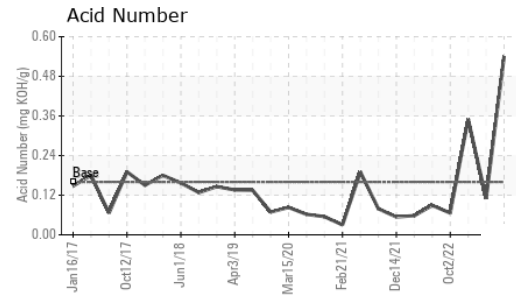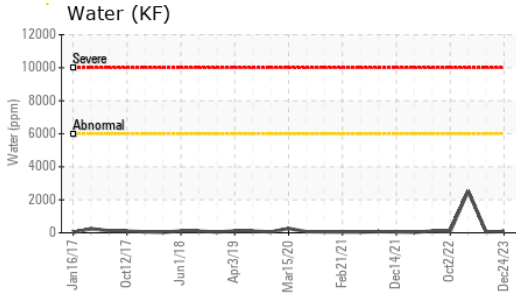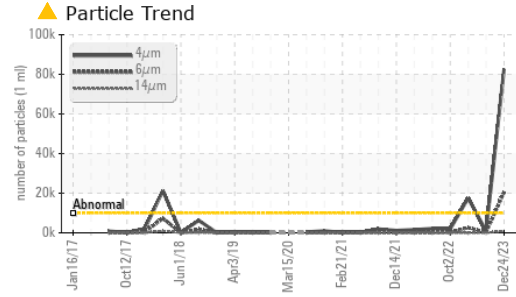





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.8	52.1	48.7 ▲ 106.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

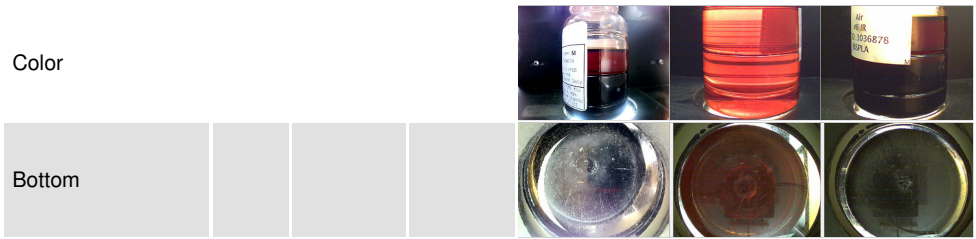

## GRAPHS

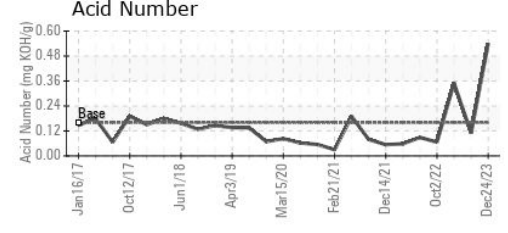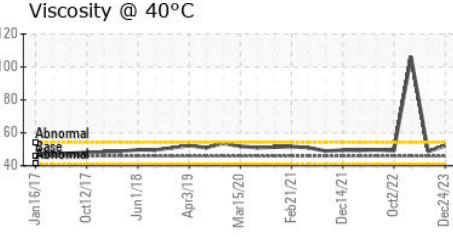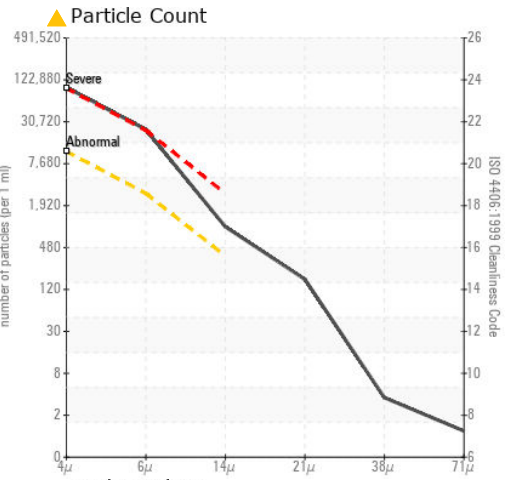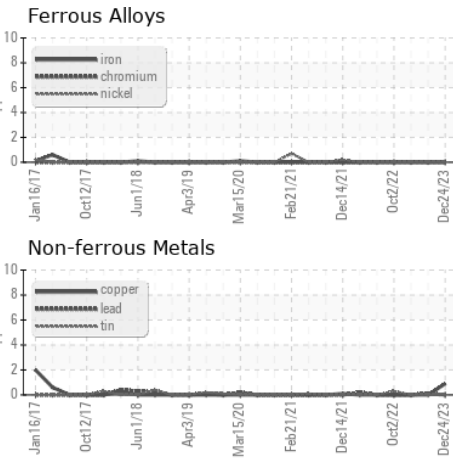

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM30692 **Recieved** : 19 Jan 2024  
**Lab Number** : 06065651 **Diagnosed** : 22 Jan 2024  
**Unique Number** : 10837033 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**JBS**  
 11 ELEVENTH ST  
 PLAINWELL, MI  
 US 49080  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: