


# **OIL ANALYSIS REPORT**

# S-460 [1403471] Machine Id KAESER YVP03 - BAE SYSTEMS (S/N 1035-8253926)

Component

Compressor





### DIAGNOSIS

## Recommendation

Resample at the next service interval to monitor.

#### Moor

All component wear rates are normal.

## Contamination

There is no indication of any contamination in the oil


# **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06065742		
Sample Date		Client Info		04 Jan 2024		
Machine Age	hrs	Client Info		8627		
Oil Age	hrs	Client Info		5348		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	101		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	93		
Calcium	ppm	ASTM D5185m	2	2		
Phosphorus	ppm	ASTM D5185m		<1		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		17539		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		14		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.30		



# **OIL ANALYSIS REPORT**

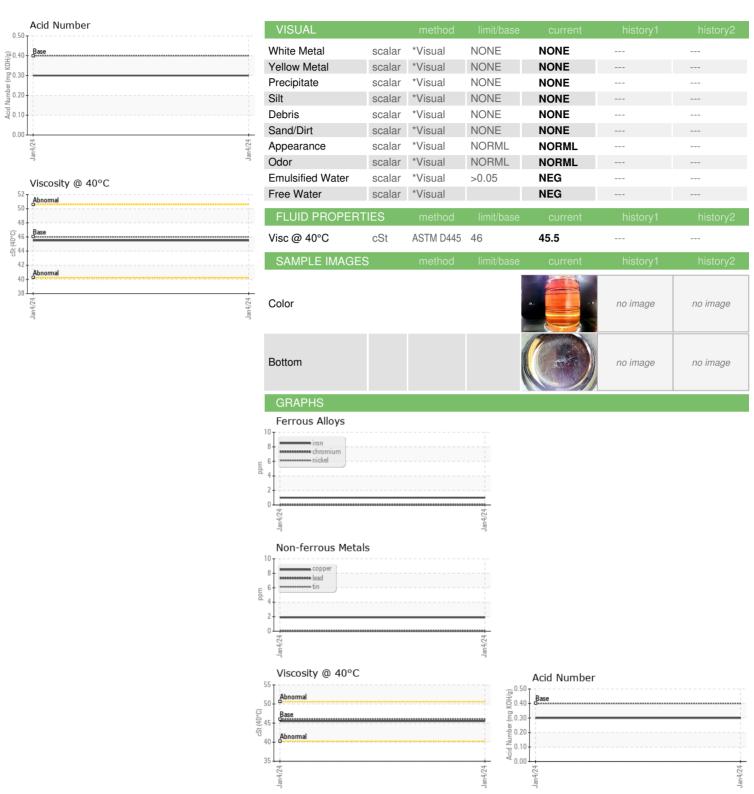





Certificate L2367

Laboratory Sample No. Lab Number Unique Number Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06065742 : 06065742 : 10837124

: 19 Jan 2024 Recieved Diagnosed : 22 Jan 2024 Diagnostician : Don Baldridge **AIR TECHNOLOGIES INC (IND)** 

8405 E 30TH ST INDIANAPOLIS, IN US 46219

Contact: GLEN PARKER

glen.parker@aircompressors.com T: (765)516-4920

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: