




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

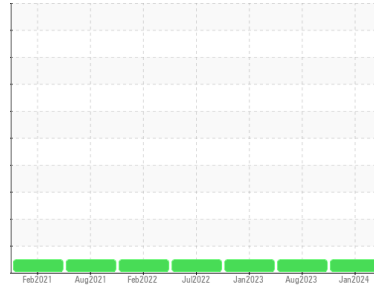

Machine Id  
**FDG JAX 150**  
 Component  
**Fluid**  
 Fluid  
**{not provided} (70 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the fluid. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the fluid is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0853633</b>	WC0808225	WC0753868
Sample Date	Client Info	<b>23 Jan 2024</b>	02 Aug 2023	31 Jan 2023
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	1	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>622</b>	640	539
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>626</b>	785	493

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	1	0
Potassium	ppm	ASTM D5185m	<b>&gt;20</b>	<1	0
Water	%	ASTM D6304	<b>0.004</b>	0.003	0.003
ppm Water	ppm	ASTM D6304	<b>42</b>	38.8	33.5

## FLUID CLEANLINESS






method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>5000	<b>1905</b>	1901	907
Particles >6µm	ASTM D7647	>1300	<b>489</b>	427	177
Particles >14µm	ASTM D7647	>160	<b>43</b>	14	8
Particles >21µm	ASTM D7647	>40	<b>11</b>	2	2
Particles >38µm	ASTM D7647	>10	<b>1</b>	0	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>18/16/13</b>	18/16/11	17/15/10

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.69</b>	0.72	0.86



# OIL ANALYSIS REPORT

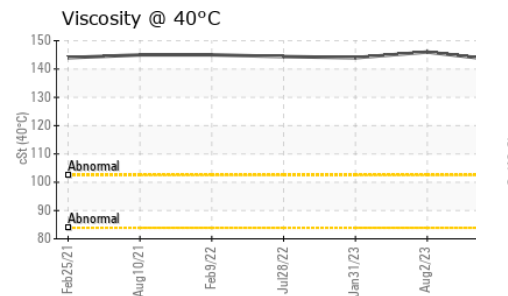
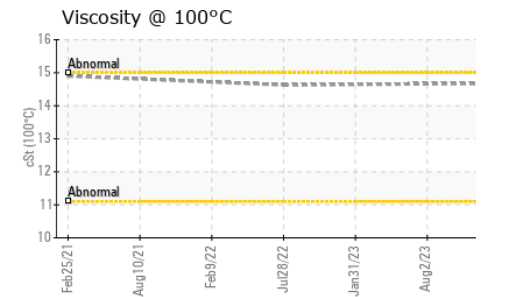
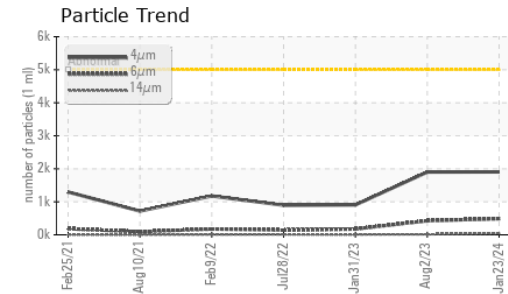
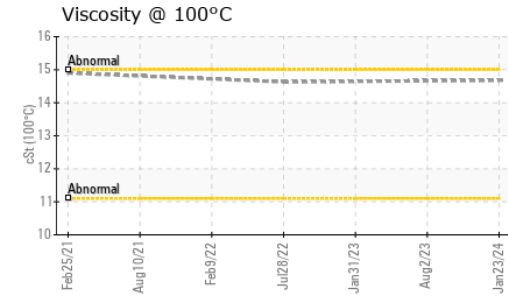
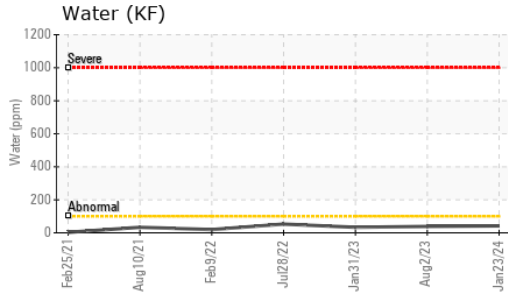


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	143.1	146	144
Visc @ 100°C	cSt	ASTM D445	14.68	---	---
Viscosity Index (VI)	Scale	ASTM D2270	101	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

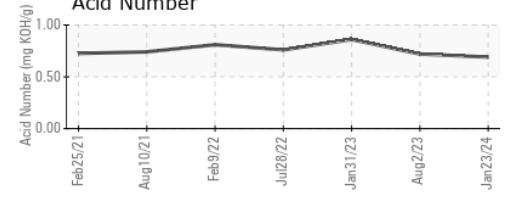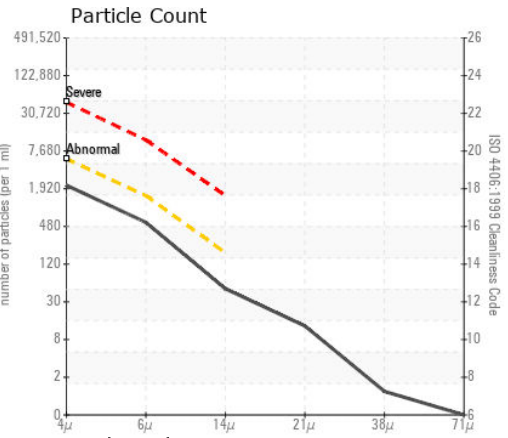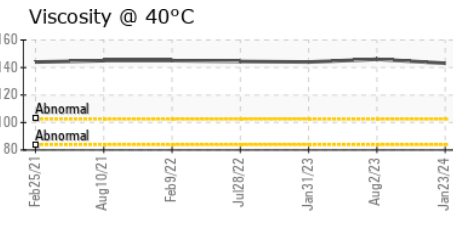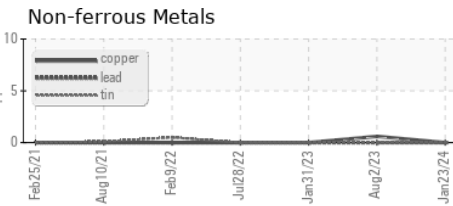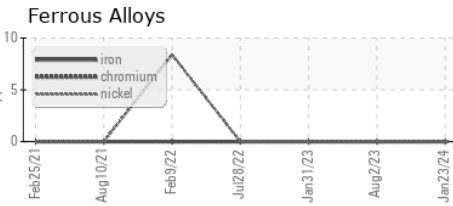

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0853633 **Received** : 29 Jan 2024  
**Lab Number** : 06073425 **Diagnosed** : 31 Jan 2024  
**Unique Number** : 10850102 **Diagnostician** : Jonathan Hester

**Test Package** : IND 2 ( Additional Tests: KF, KV100, PrtCount, VI )  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**NOVOZYMES**  
 P.O. BOX 576, 77 PERRY CHAPEL CHURCH ROAD  
 FRANKLINTON, NC  
 US 27525  
 Contact: BRUCE THOMAS  
 brct@novozymes.com  
 T: (919)494-3146  
 F: (919)494-3456