

FUEL REPORT

NYU CANCER CLINICAL CENTER 250 GALLON Component

Diesel Fuel Fluic

{not provided} (250 GAL)

DIAGNOSIS

Recommendation

We advise that you filter this fluid before use. All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

Corrosion


All metal levels are normal indicating no corrosion in the system.

Contaminants

There is a high amount of particulates present in the fuel. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.



SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC06073442		
Sample Date		Client Info		29 Jan 2024		
Machine Age	hrs	Client Info		0		
Sample Status				ATTENTION		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		0.843		
Fuel Color	text	*Visual Screen		Red		
ASTM Color	scalar	*ASTM D1500		L4.0		
Visc @ 40°C	cSt	ASTM D445		2.5		
SULFUR CONTER	NT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		0		
Sulfur (UVF)	ppm	ASTM D5453		18		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		164		
5% Distillation Point	°C	ASTM D86		189		
10% Distill Point	°C	ASTM D86		200		
15% Distillation Point	°C	ASTM D86		210		
20% Distill Point	°C	ASTM D86		219		
30% Distill Point	°C	ASTM D86		234		
40% Distill Point	°C	ASTM D86		248		
50% Distill Point	°C	ASTM D86		262		
60% Distill Point	°C	ASTM D86		277		
70% Distill Point	°C	ASTM D86		291		
80% Distill Point	°C	ASTM D86		308		
85% Distillation Point	°C	ASTM D86		317		
90% Distill Point	°C	ASTM D86		327		
95% Distillation Point	°C	ASTM D86		340		
Final Boiling Point	°C	ASTM D86		348		
Distillation Residue	%	ASTM D86		1.4		
Distillation Loss	%	ASTM D86		0.7		
IGNITION QUALIT	ΓY	method	limit/base	current	history1	history2
API Gravity		ASTM D7777		36.4		
Cetane Index		ASTM D4737	<40.0	47.7		
CONTAMINANTS		method	limit/base	current	history1	history2

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0		
Sodium	ppm	ASTM D5185m	<0.1	0		
Potassium	ppm	ASTM D5185m	<0.1	0		
Water	%	ASTM D6304	<0.05	0.006		
ppm Water	ppm	ASTM D6304	<500	68		
% Gasoline	%	*In-House	<0.50	0.0		
% Biodiesel	%	*In-House	<20.0	4.0		



number of particles (per 1


Water

150°


10

回告

FUEL REPORT

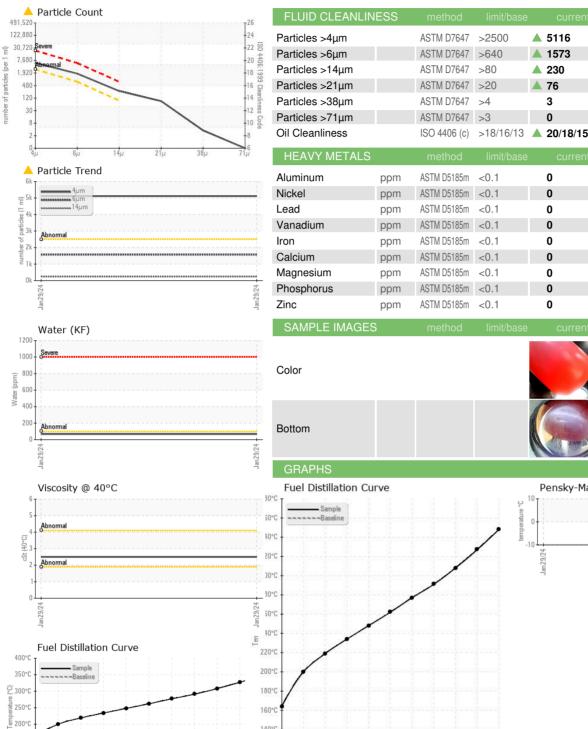

no image no image no image no image

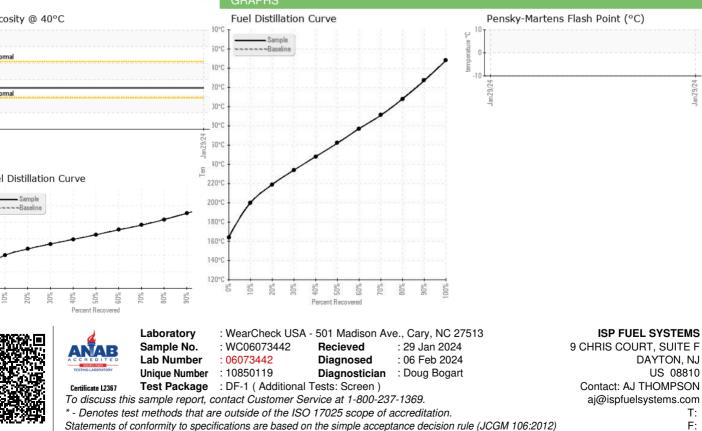

Contact/Location: AJ THOMPSON - ISPDAY